

CFR 47 FCC PART 15 SUBPART C

TEST REPORT

For

Motorized Penis Stroking Machine With Detachable Stroker

MODEL NUMBER: Autoblow AI ULTRA, Autoblow AI ULTRA Clear, CG668

REPORT NUMBER: E04A23080403F01404

ISSUE DATE: September 2, 2023

FCC ID:2A4AW-AUTOBLOWULTRA

Trademark: Autoblow®

Prepared for

**VERY INTELLIGENT ECOMMERCE INC.
109 E, 17th St, Suite 4, Cheyenne, WY 82001, United States**

Prepared by

Guangdong Global Testing Technology Co., Ltd.

**Room 101-105, 203-210, Building 1, No.2, Keji 8 Road, Songshan
Lake Park, Dongguan city, Guangdong, People' s Republic of China,
523808**

**This report shall not be reproduced, except in full, without the written approval of
Guangdong Global Testing Technology Co., Ltd.**

Revision History

<u>Rev.</u>	<u>Issue Date</u>	<u>Revisions</u>	<u>Revised By</u>
<u>V0</u>	<u>September 2, 2023</u>	<u>Initial Issue</u>	<u>Jok Yang</u>

Appendix A PHOTOGRAPHS OF THE EUT

External-1



Adapter(BI36L-120300-I)

External-2



Adapter(GQ36-120300-AX)


External-3




External-4




External-5

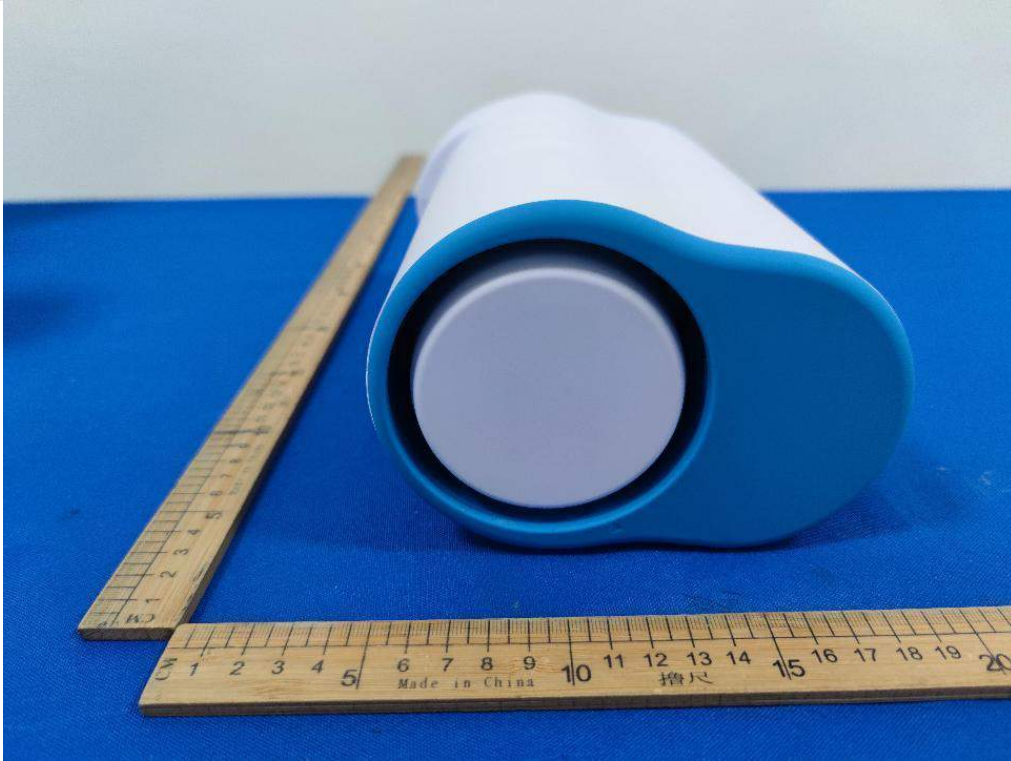

External-6

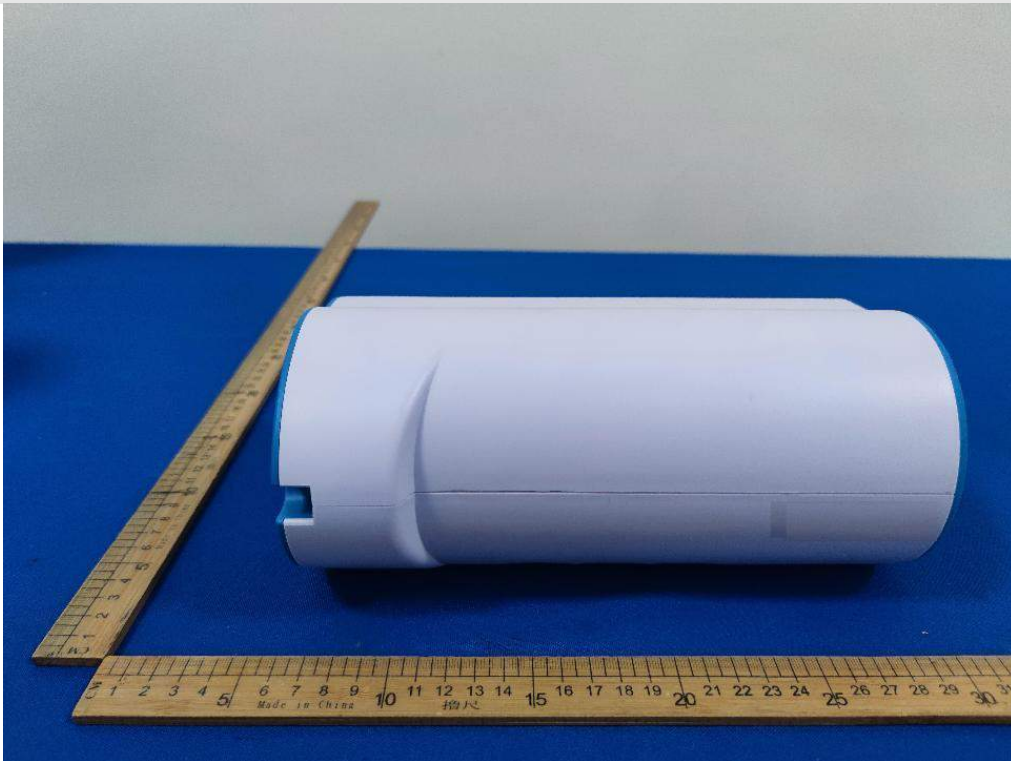

External-7

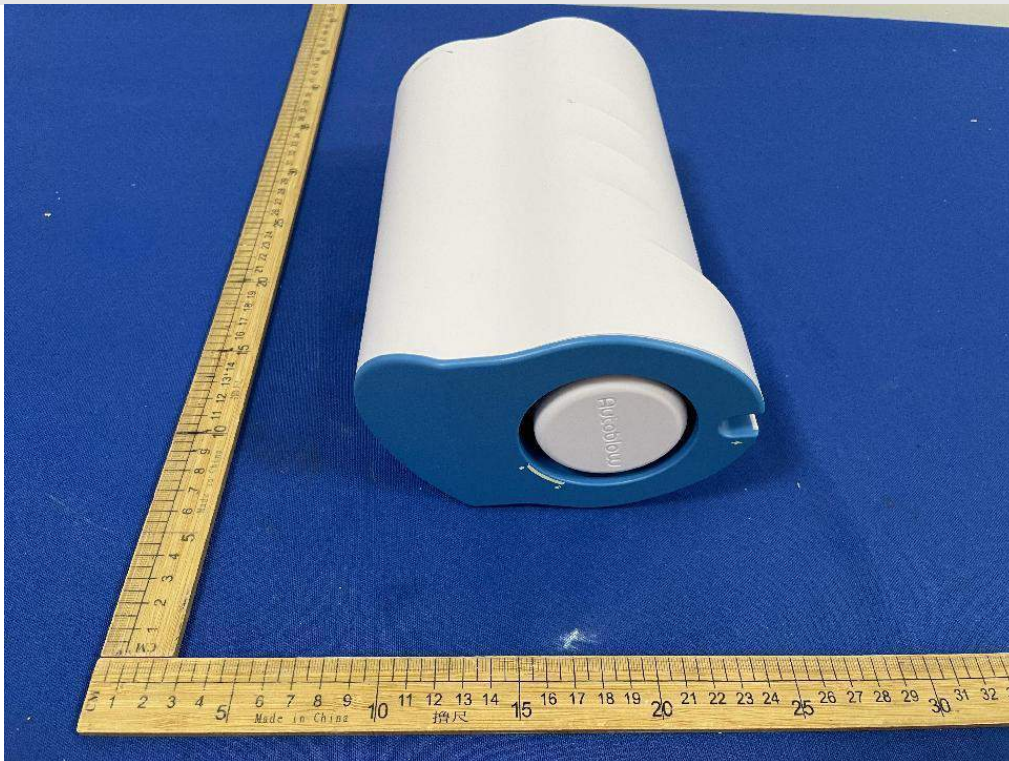

External-8



External-9




Adapter(BI36L-120300-I)

External-10




Adapter(GQ36-120300-AX)


External-11

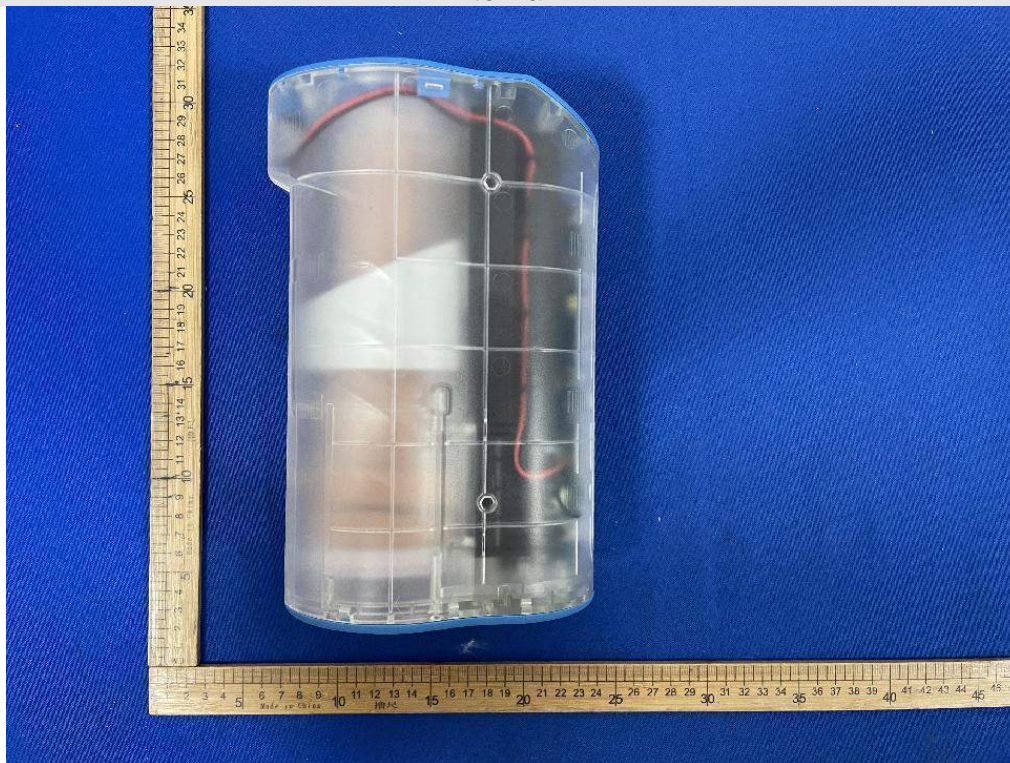


External-12

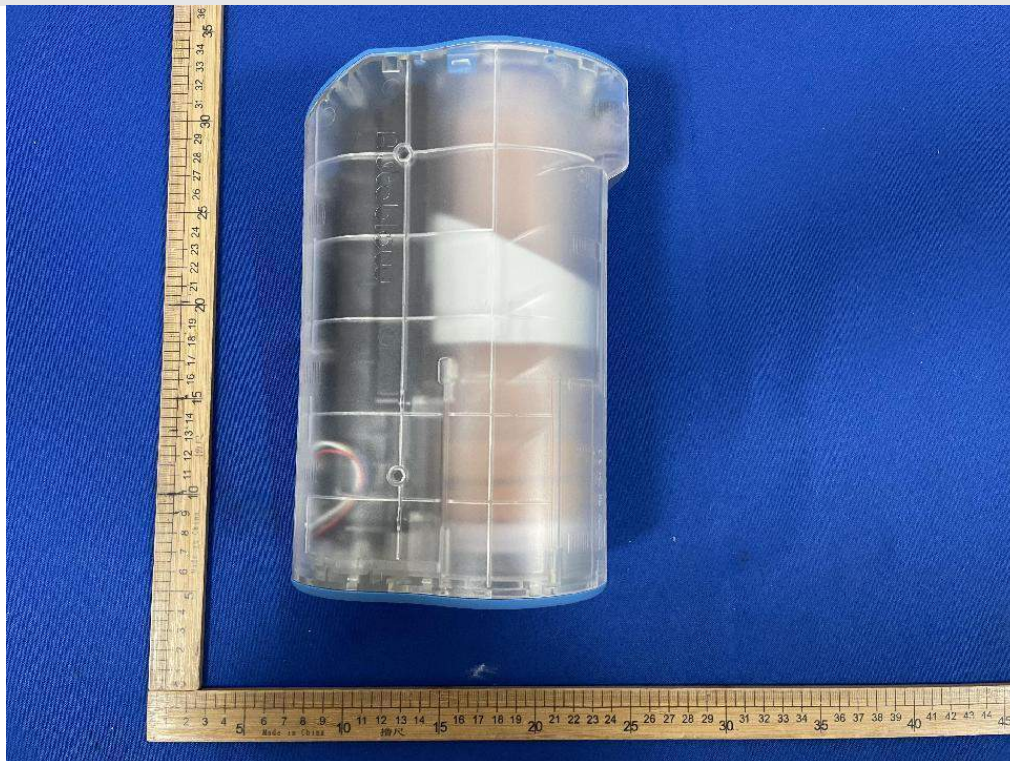


External-13

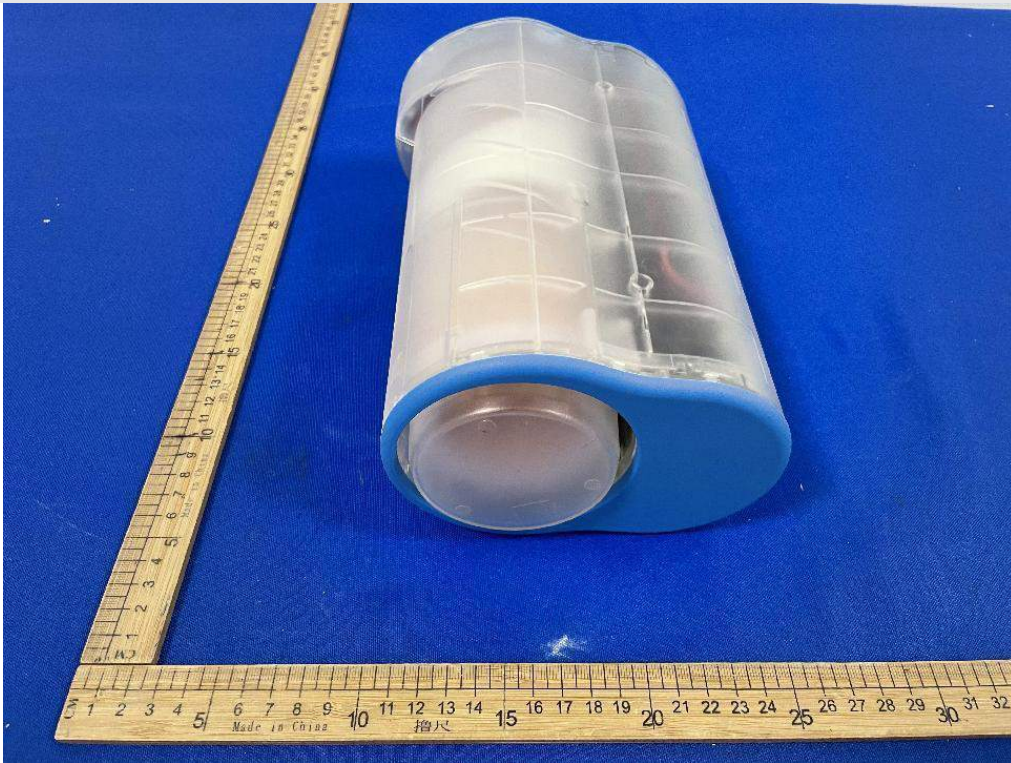


External-14

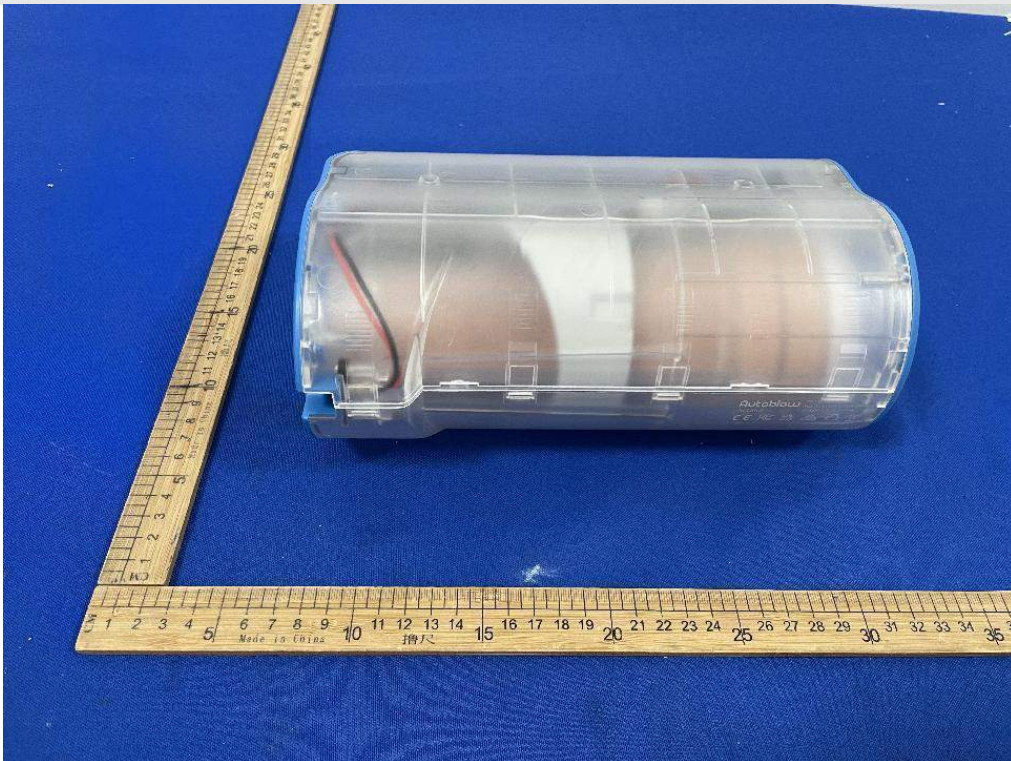

External-15

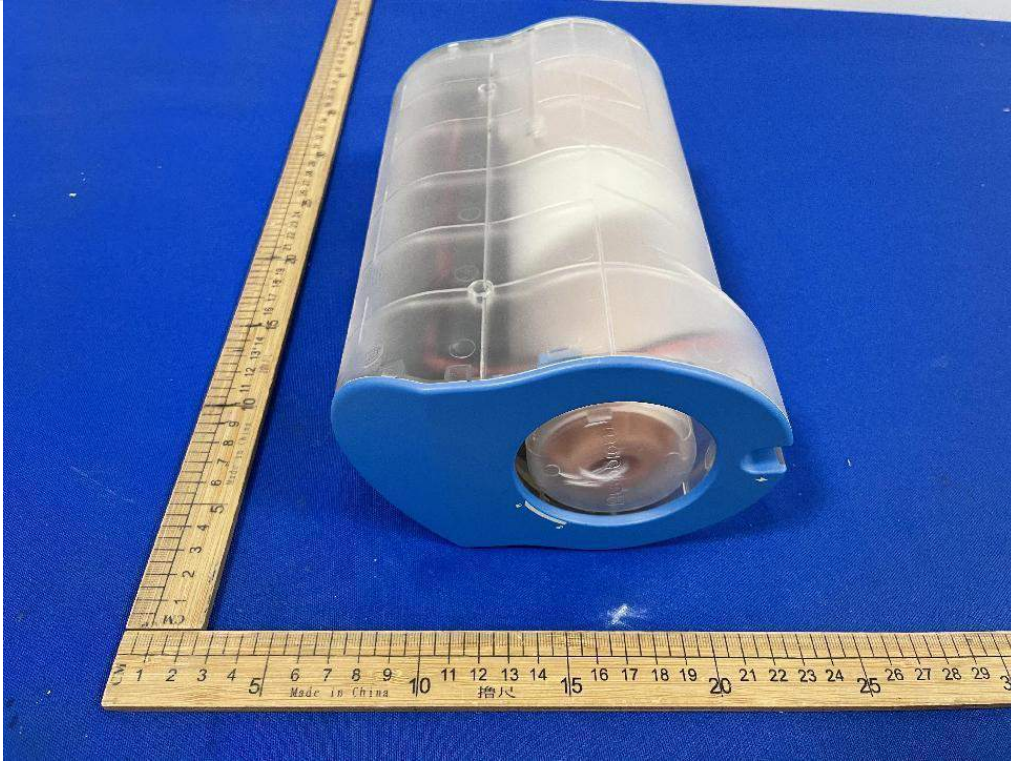

External-16

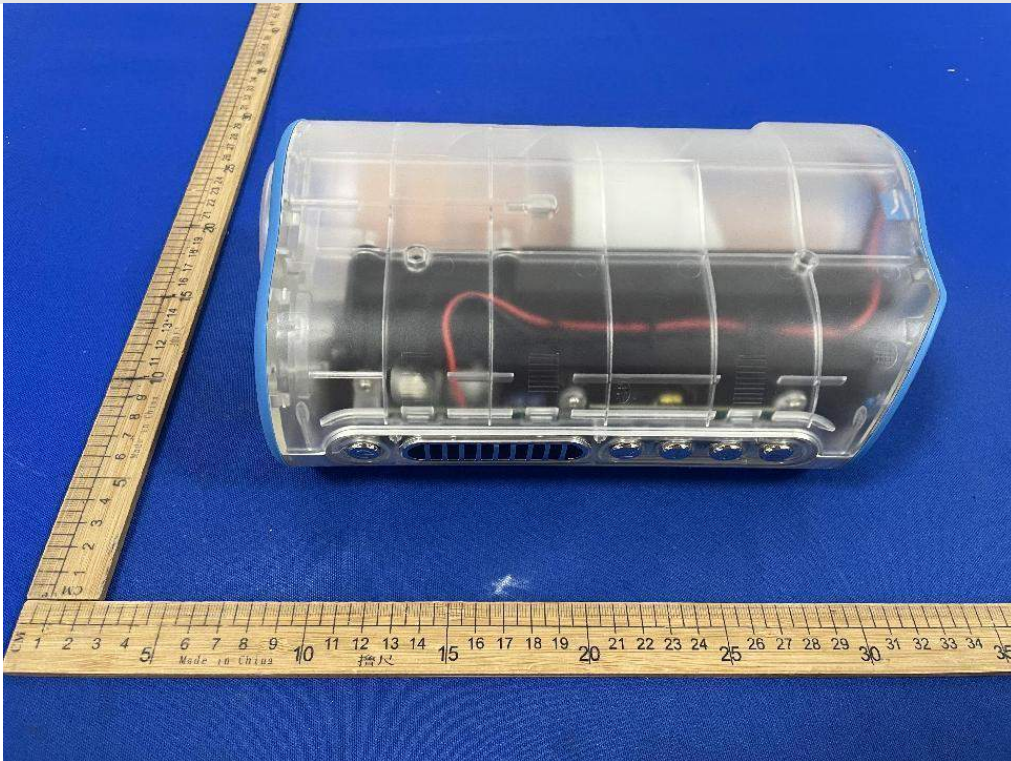

External-17




Adapter(BI36L-120300-I)

External-18




Adapter(GQ36-120300-AX)


Internal-1

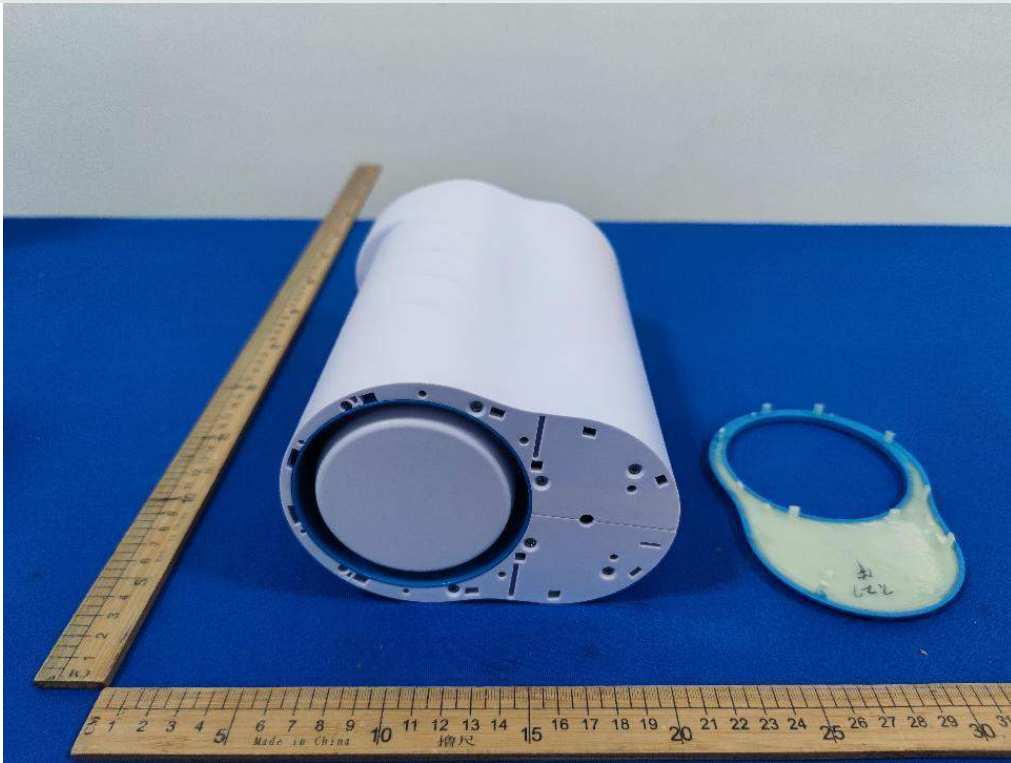


Internal-2

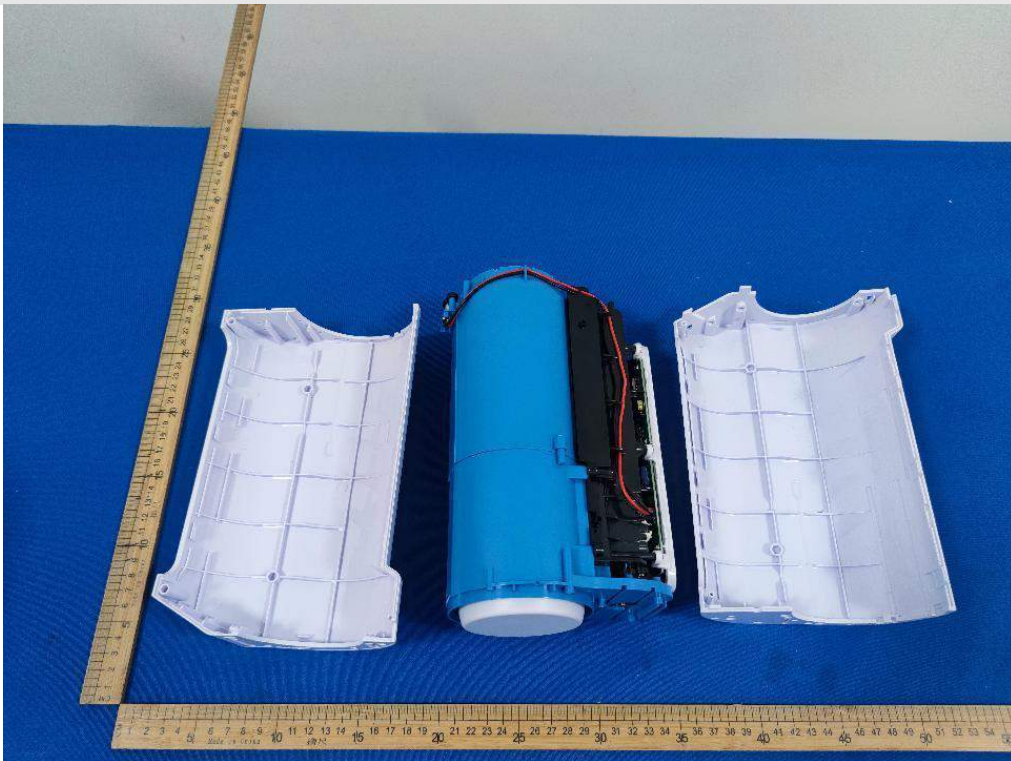


Internal-3

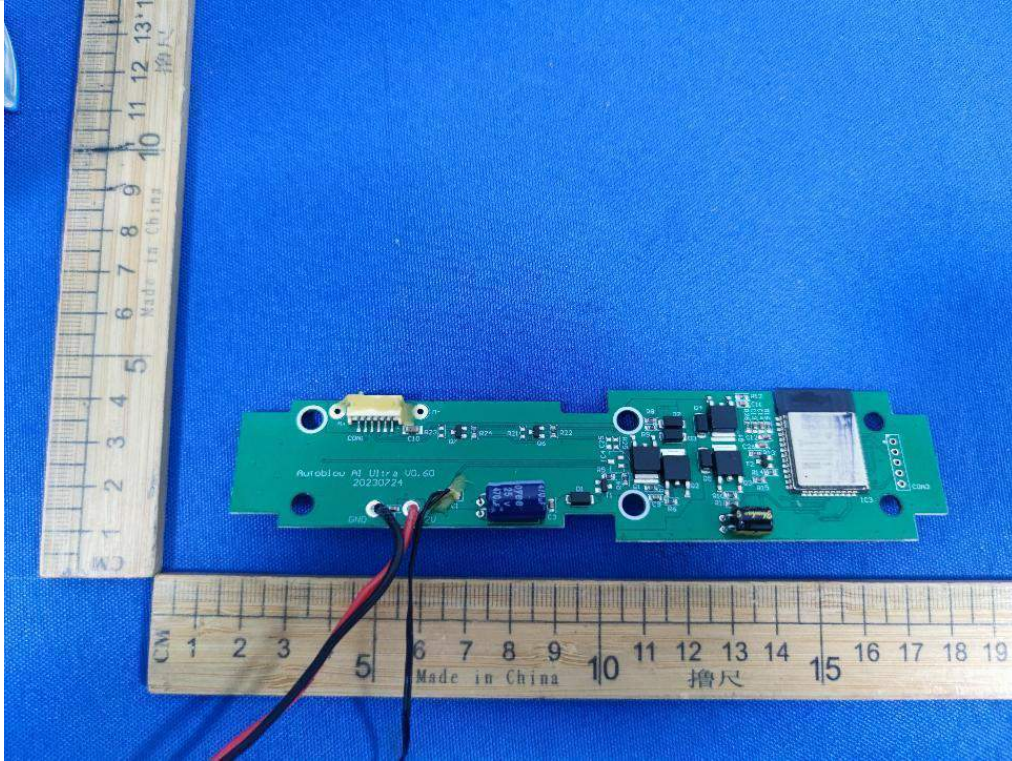


Internal-4

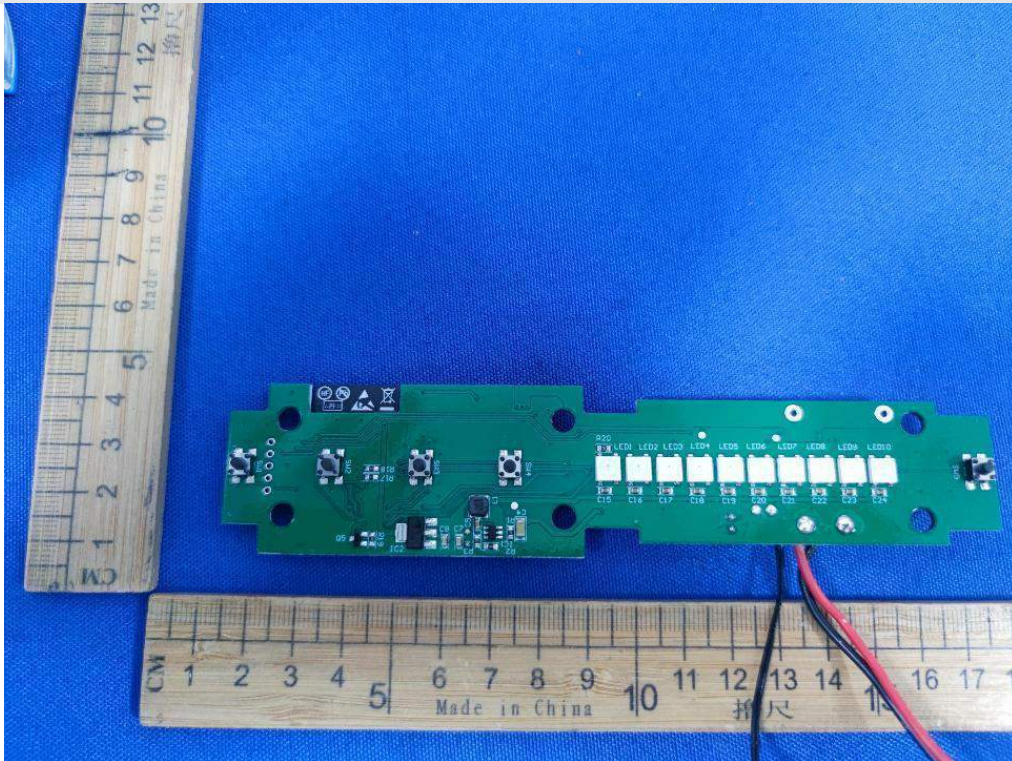


Internal-5

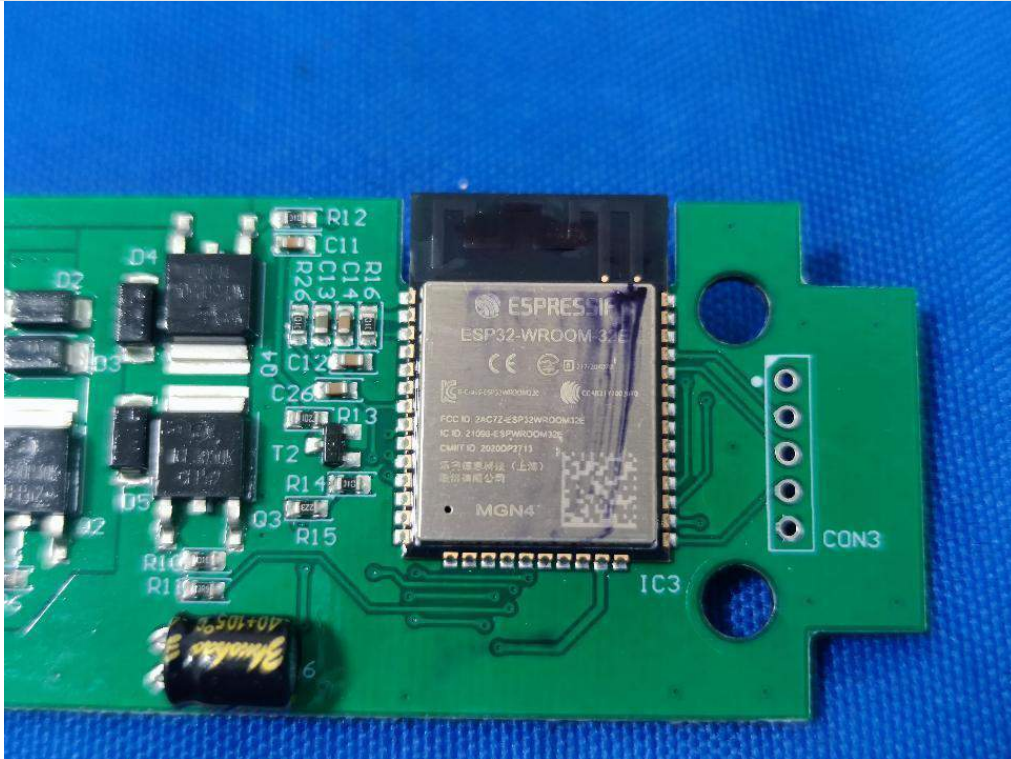

Internal-6

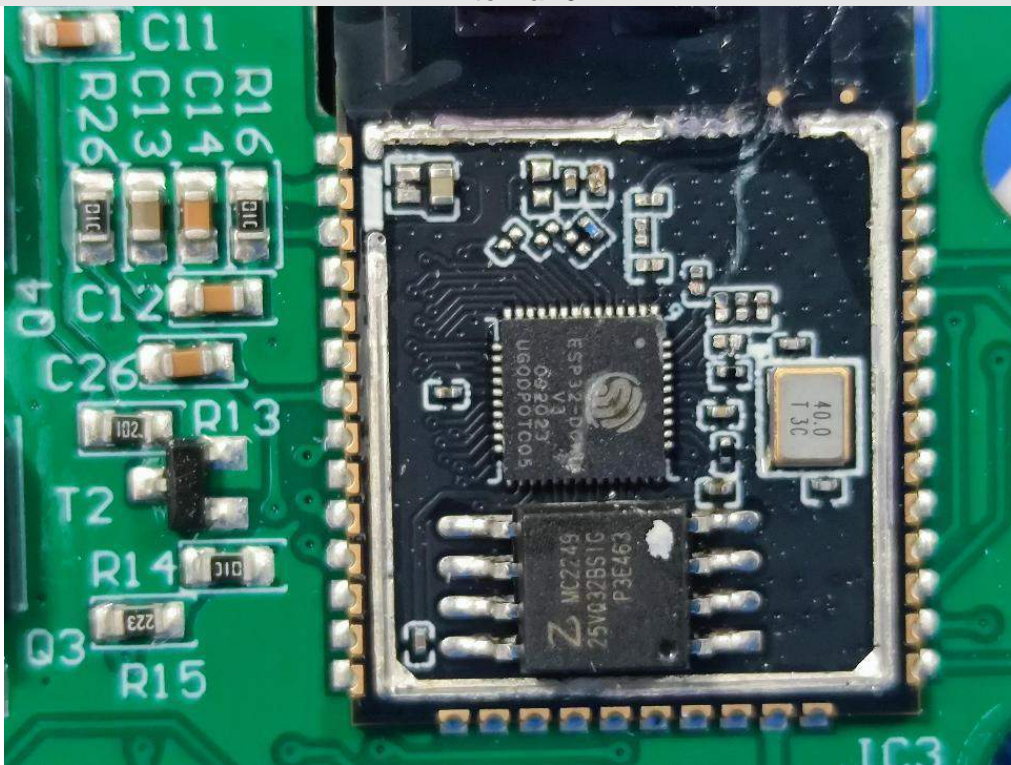

Internal-7

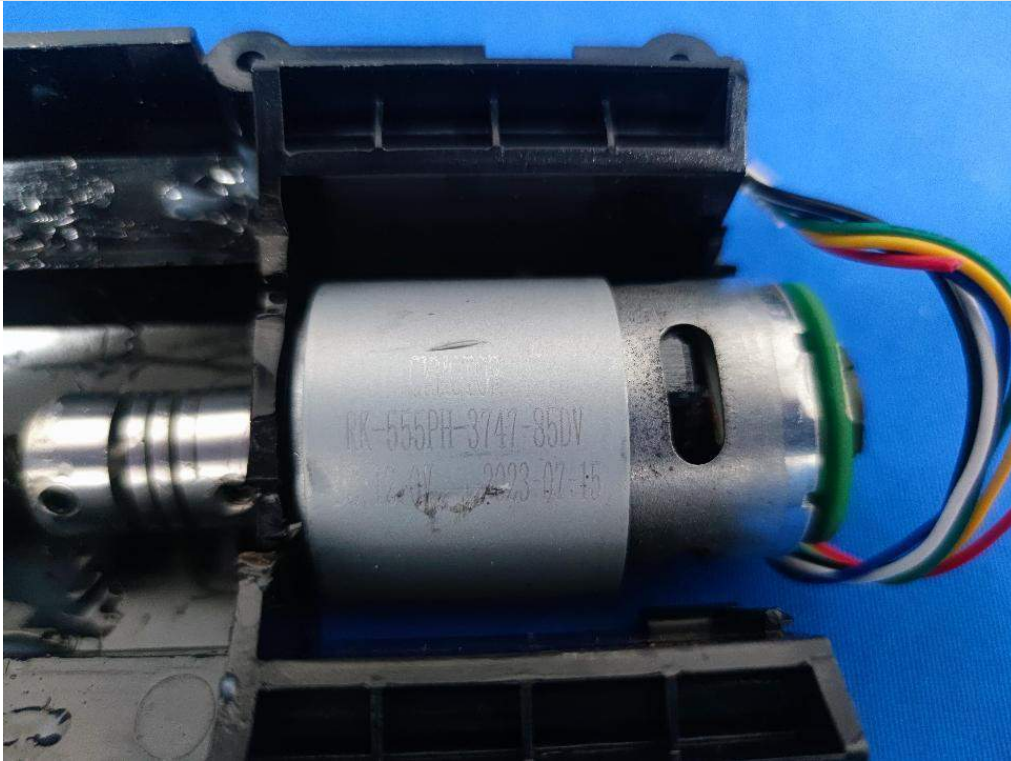


Motor(CK-RK-555PH-3747-85DV)

Internal-8



Motor(R555-3748)

Internal-9

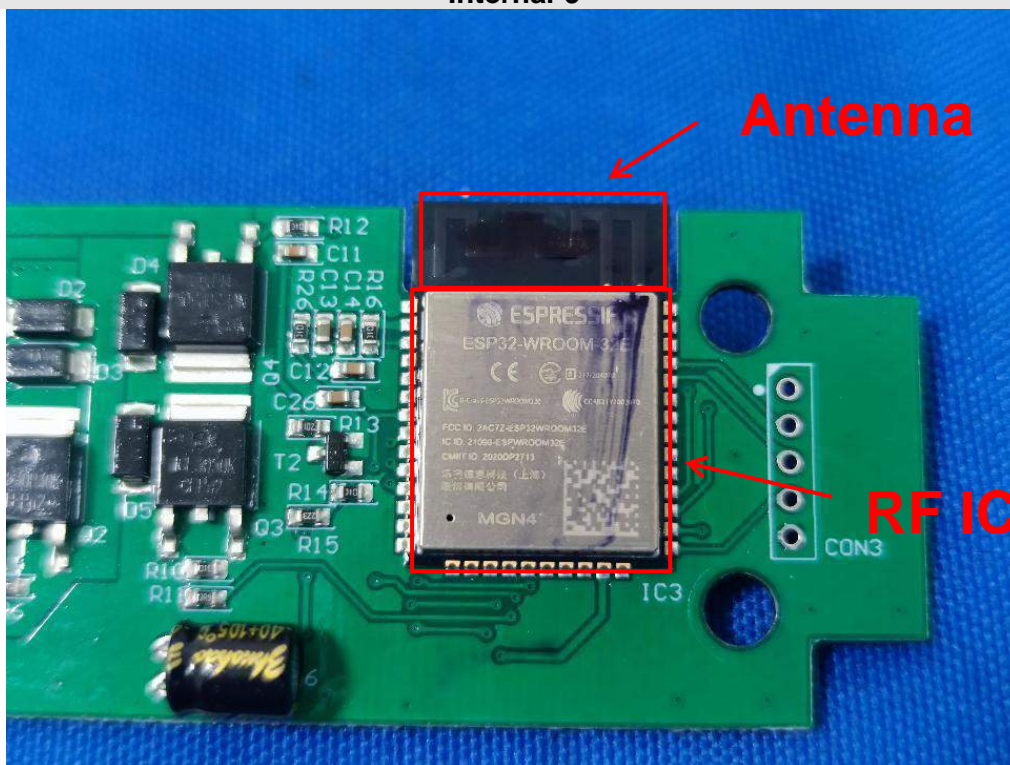

--- END OF REPORT---