


EXTERIOR OF BACK PLATE

Label 1



Font: Arial(Bold), letter size:1.8mm
label size: 40*40mm

Label 2

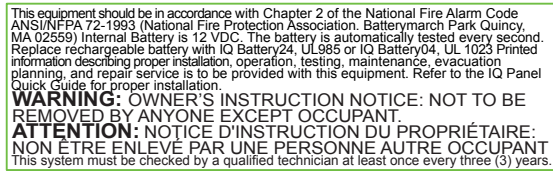

WARNING, ATTENTION

Font: Arial Bold, letter size:2.8mm


OWNER'S INSTRUCTION NOTICE: NOT TO BE REMOVED BY ANYONE EXCEPT OCCUPANT.

NOTICE D'INSTRUCTION DU PROPRIÉTAIRE: NON ÊTRE ENLEVÉ PAR UNE PERSONNE AUTRE OCCUPANT

Font: Arial, letter size:2.4mm

Remainder Font: Arial, letter size:1.8mm

label size: 22*72.5mm

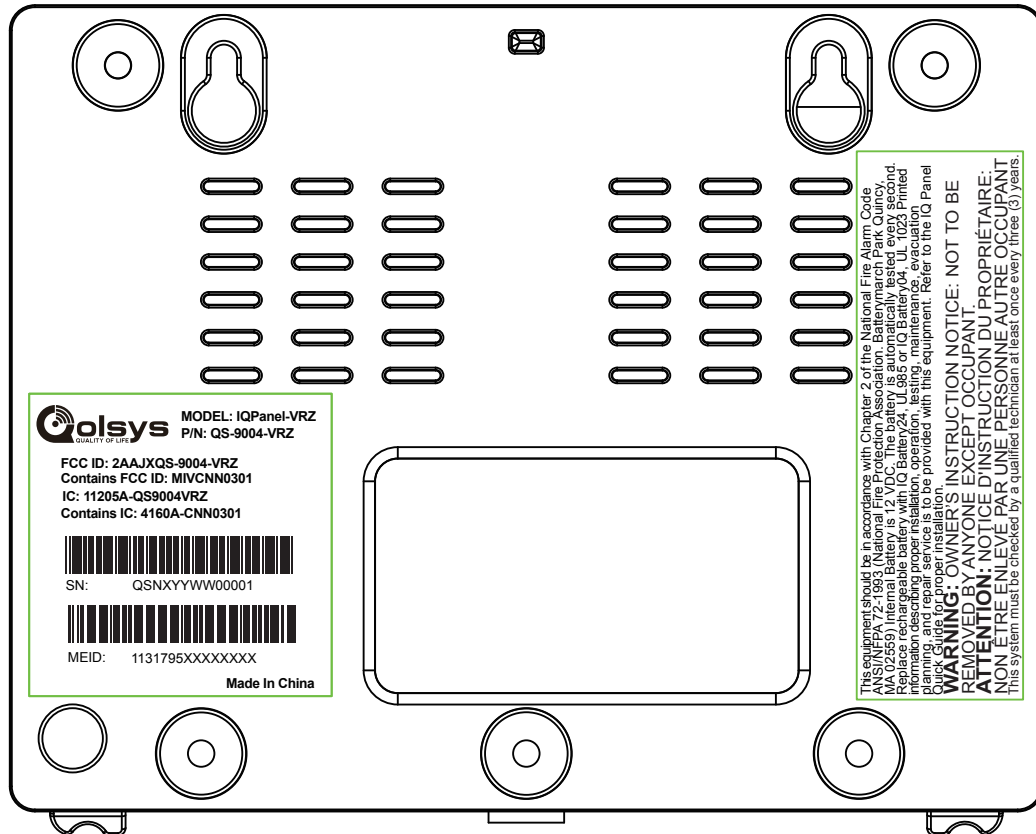

label location

INTERIOR OF BACK PLATE

Label 1

This device complies with FCC part 15 and industry canada rules and regulations. Operation is subject to the following two conditions: (1) This device may not cause harmful interference (2) This device must accept any interference received, including interference that may cause undesired operation. Certified to comply with the limits for a class B digital device pursuant to part 15 of the FCC rules.

Security Signaling Residential Fire Alarm and Security Equipment
ETL Listed Control#



Conforms to ANSI/UL Std

Label size: 40*40MM
Font size:
"THIS device.....FCC rules." size is 2mm
The remainder size is 2.4mm

Label 2

WARNING: DO NOT CONNECT TO A RECEPTACLE CONTROLLED BY A SWITCH OR HIGH VOLTAGE.
(IQ Panel Installation manual July 2013)


IMPORTANT NOTE: Weekly testing is required to ensure proper operation

Model Number IQPanel-VRZ
Power Input:100-240v-50/60Hz
Power Supply:12.0 VDC 2.0 A
Part# QS-9004-VRZ

Label size: 22*72.5MM
Font size: WARNING: size is 3.2mm

DO NOT CONNECT TO A RECEPTACLE CONTROLLED BY A SWITCH OR HIGH VOLTAGE....size is 2.8mm

IMPORTANT NOTE:.....size is 2.8mm
The rest size is 2.4mm

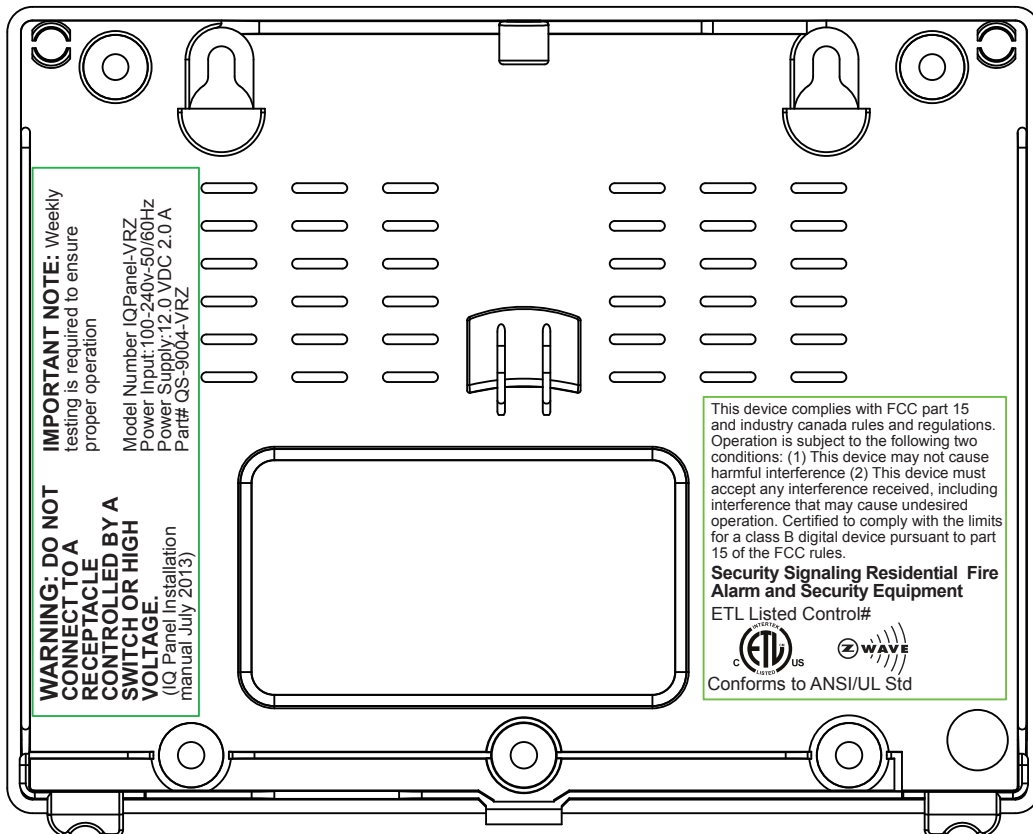

Scale: 1:1

Location