


**CAUTION**  
  
HAZARD OF  
ELECTRICAL SHOCK  
WITH COVER REMOVED  
LIVE TERMINALS

FCN  
PASS


PLUG IN  
1A FUSE

PLUG IN  
1A FUSE

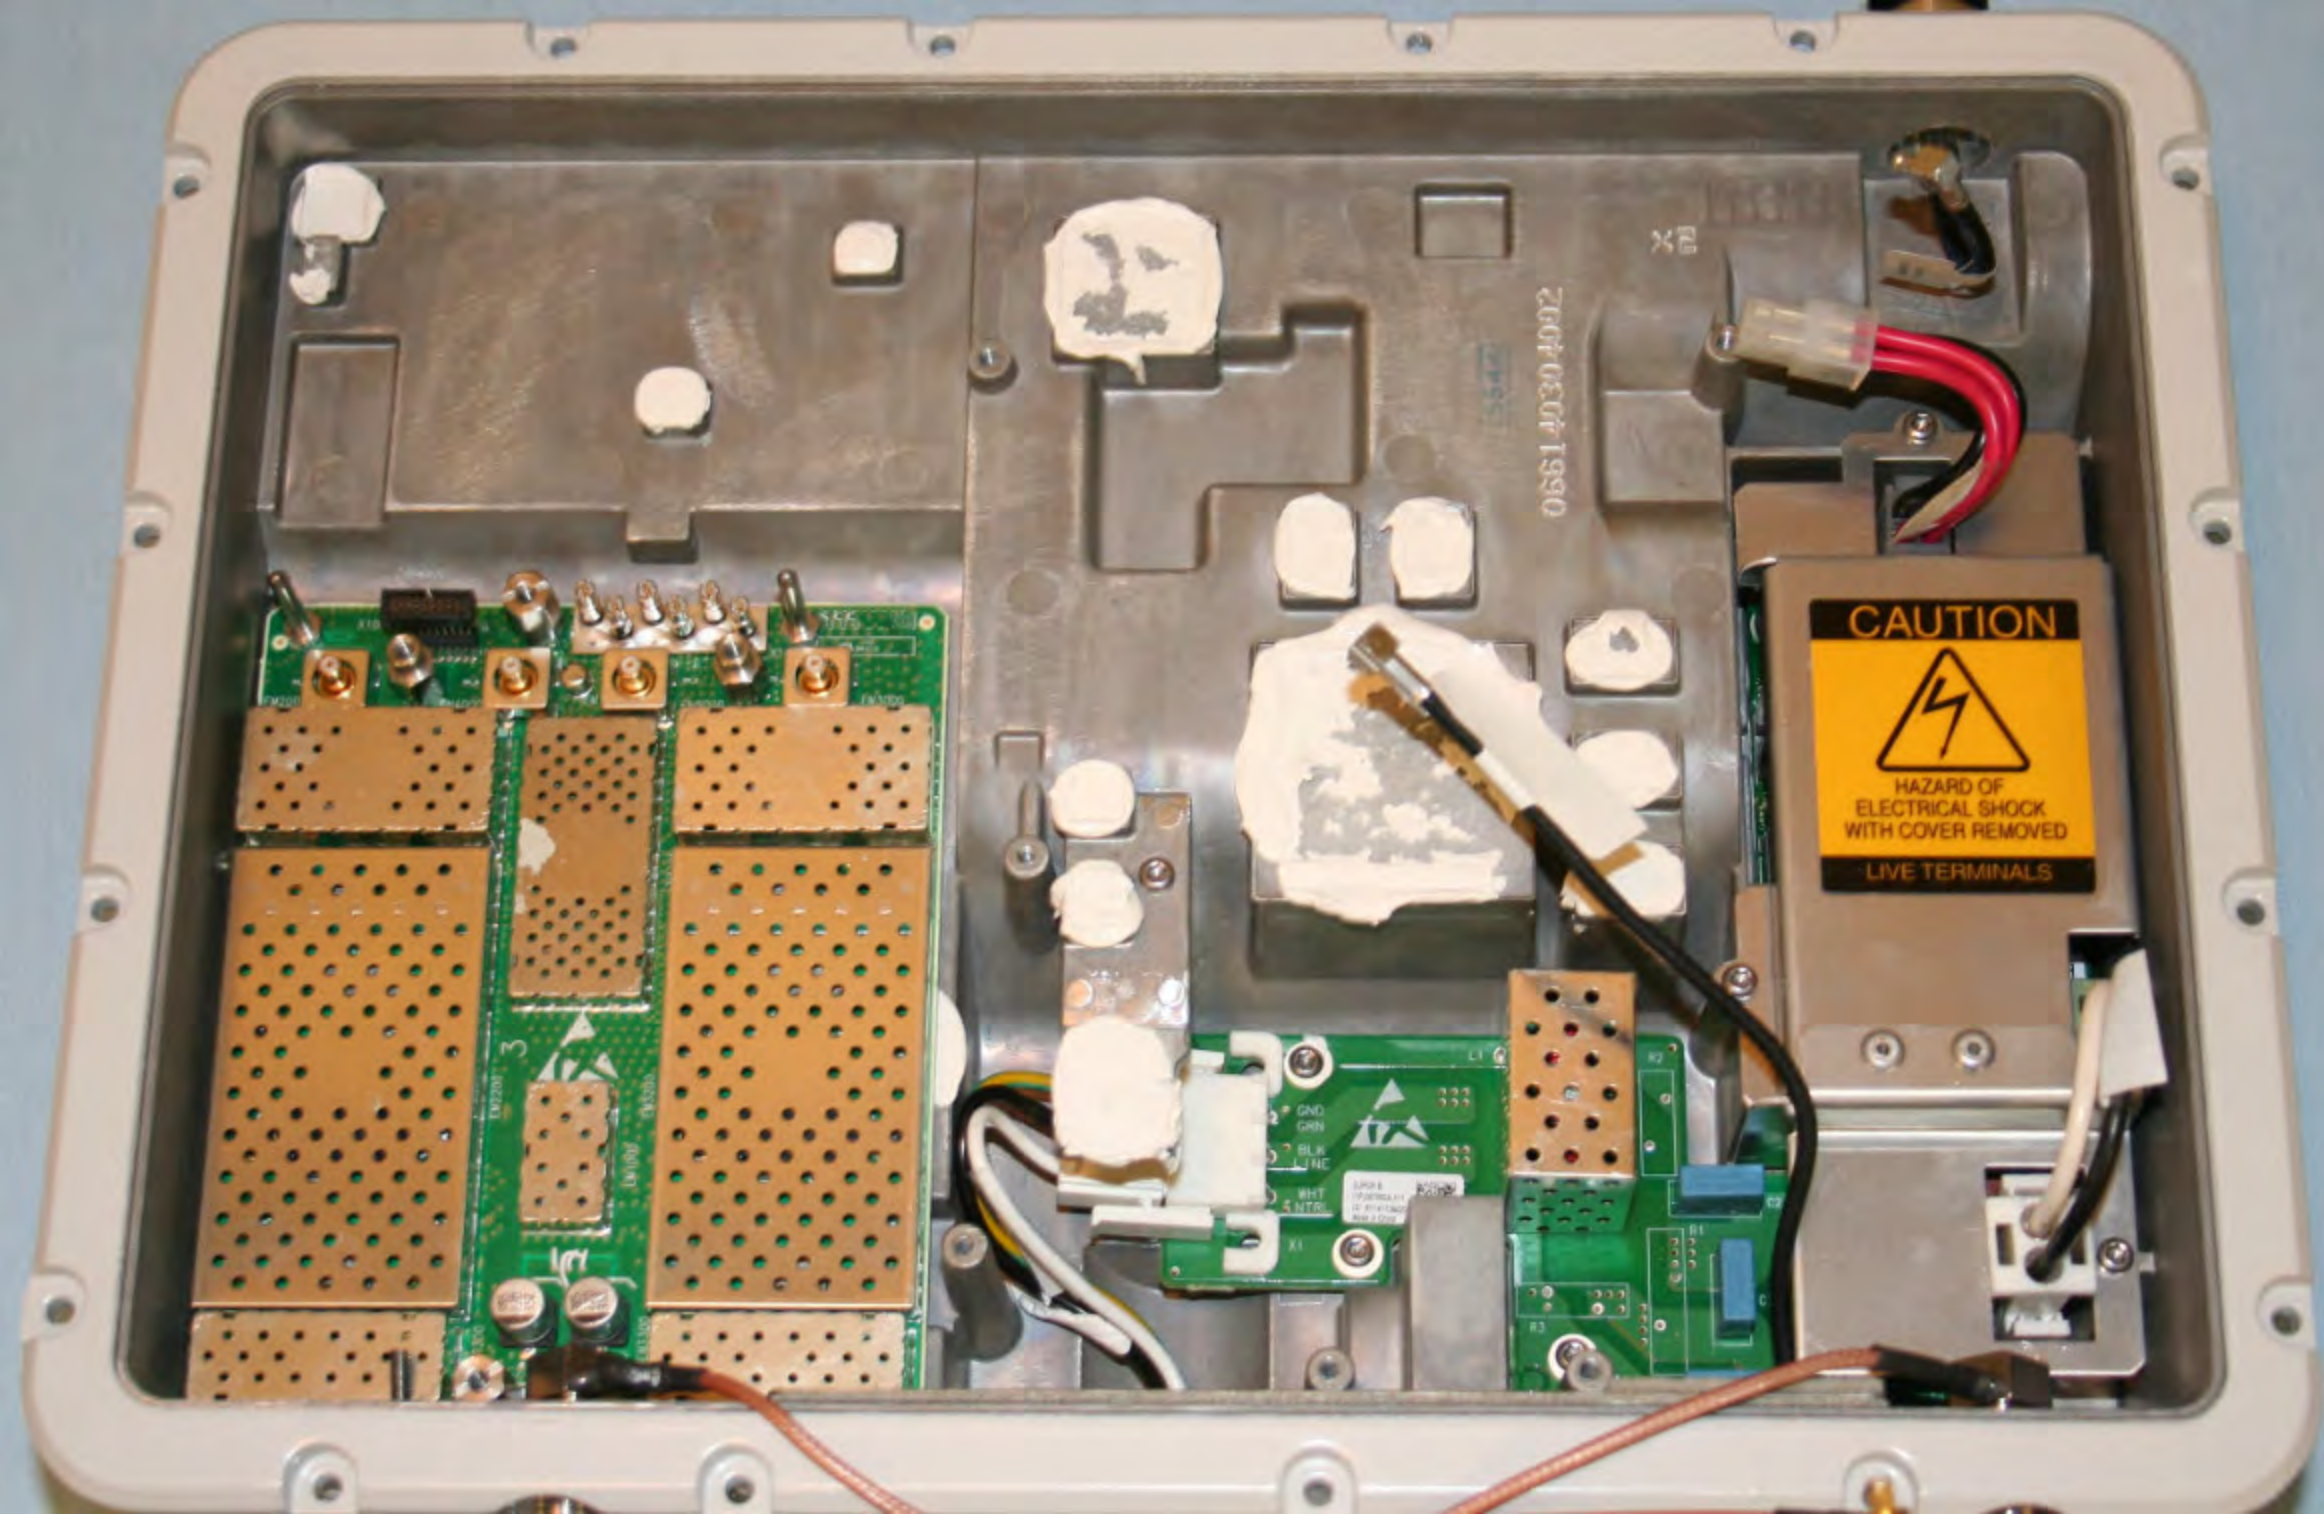



0661-4030-4092


**CAUTION**  
  
HAZARD OF  
ELECTRICAL SHOCK  
WITH COVER REMOVED  
**LIVE TERMINALS**

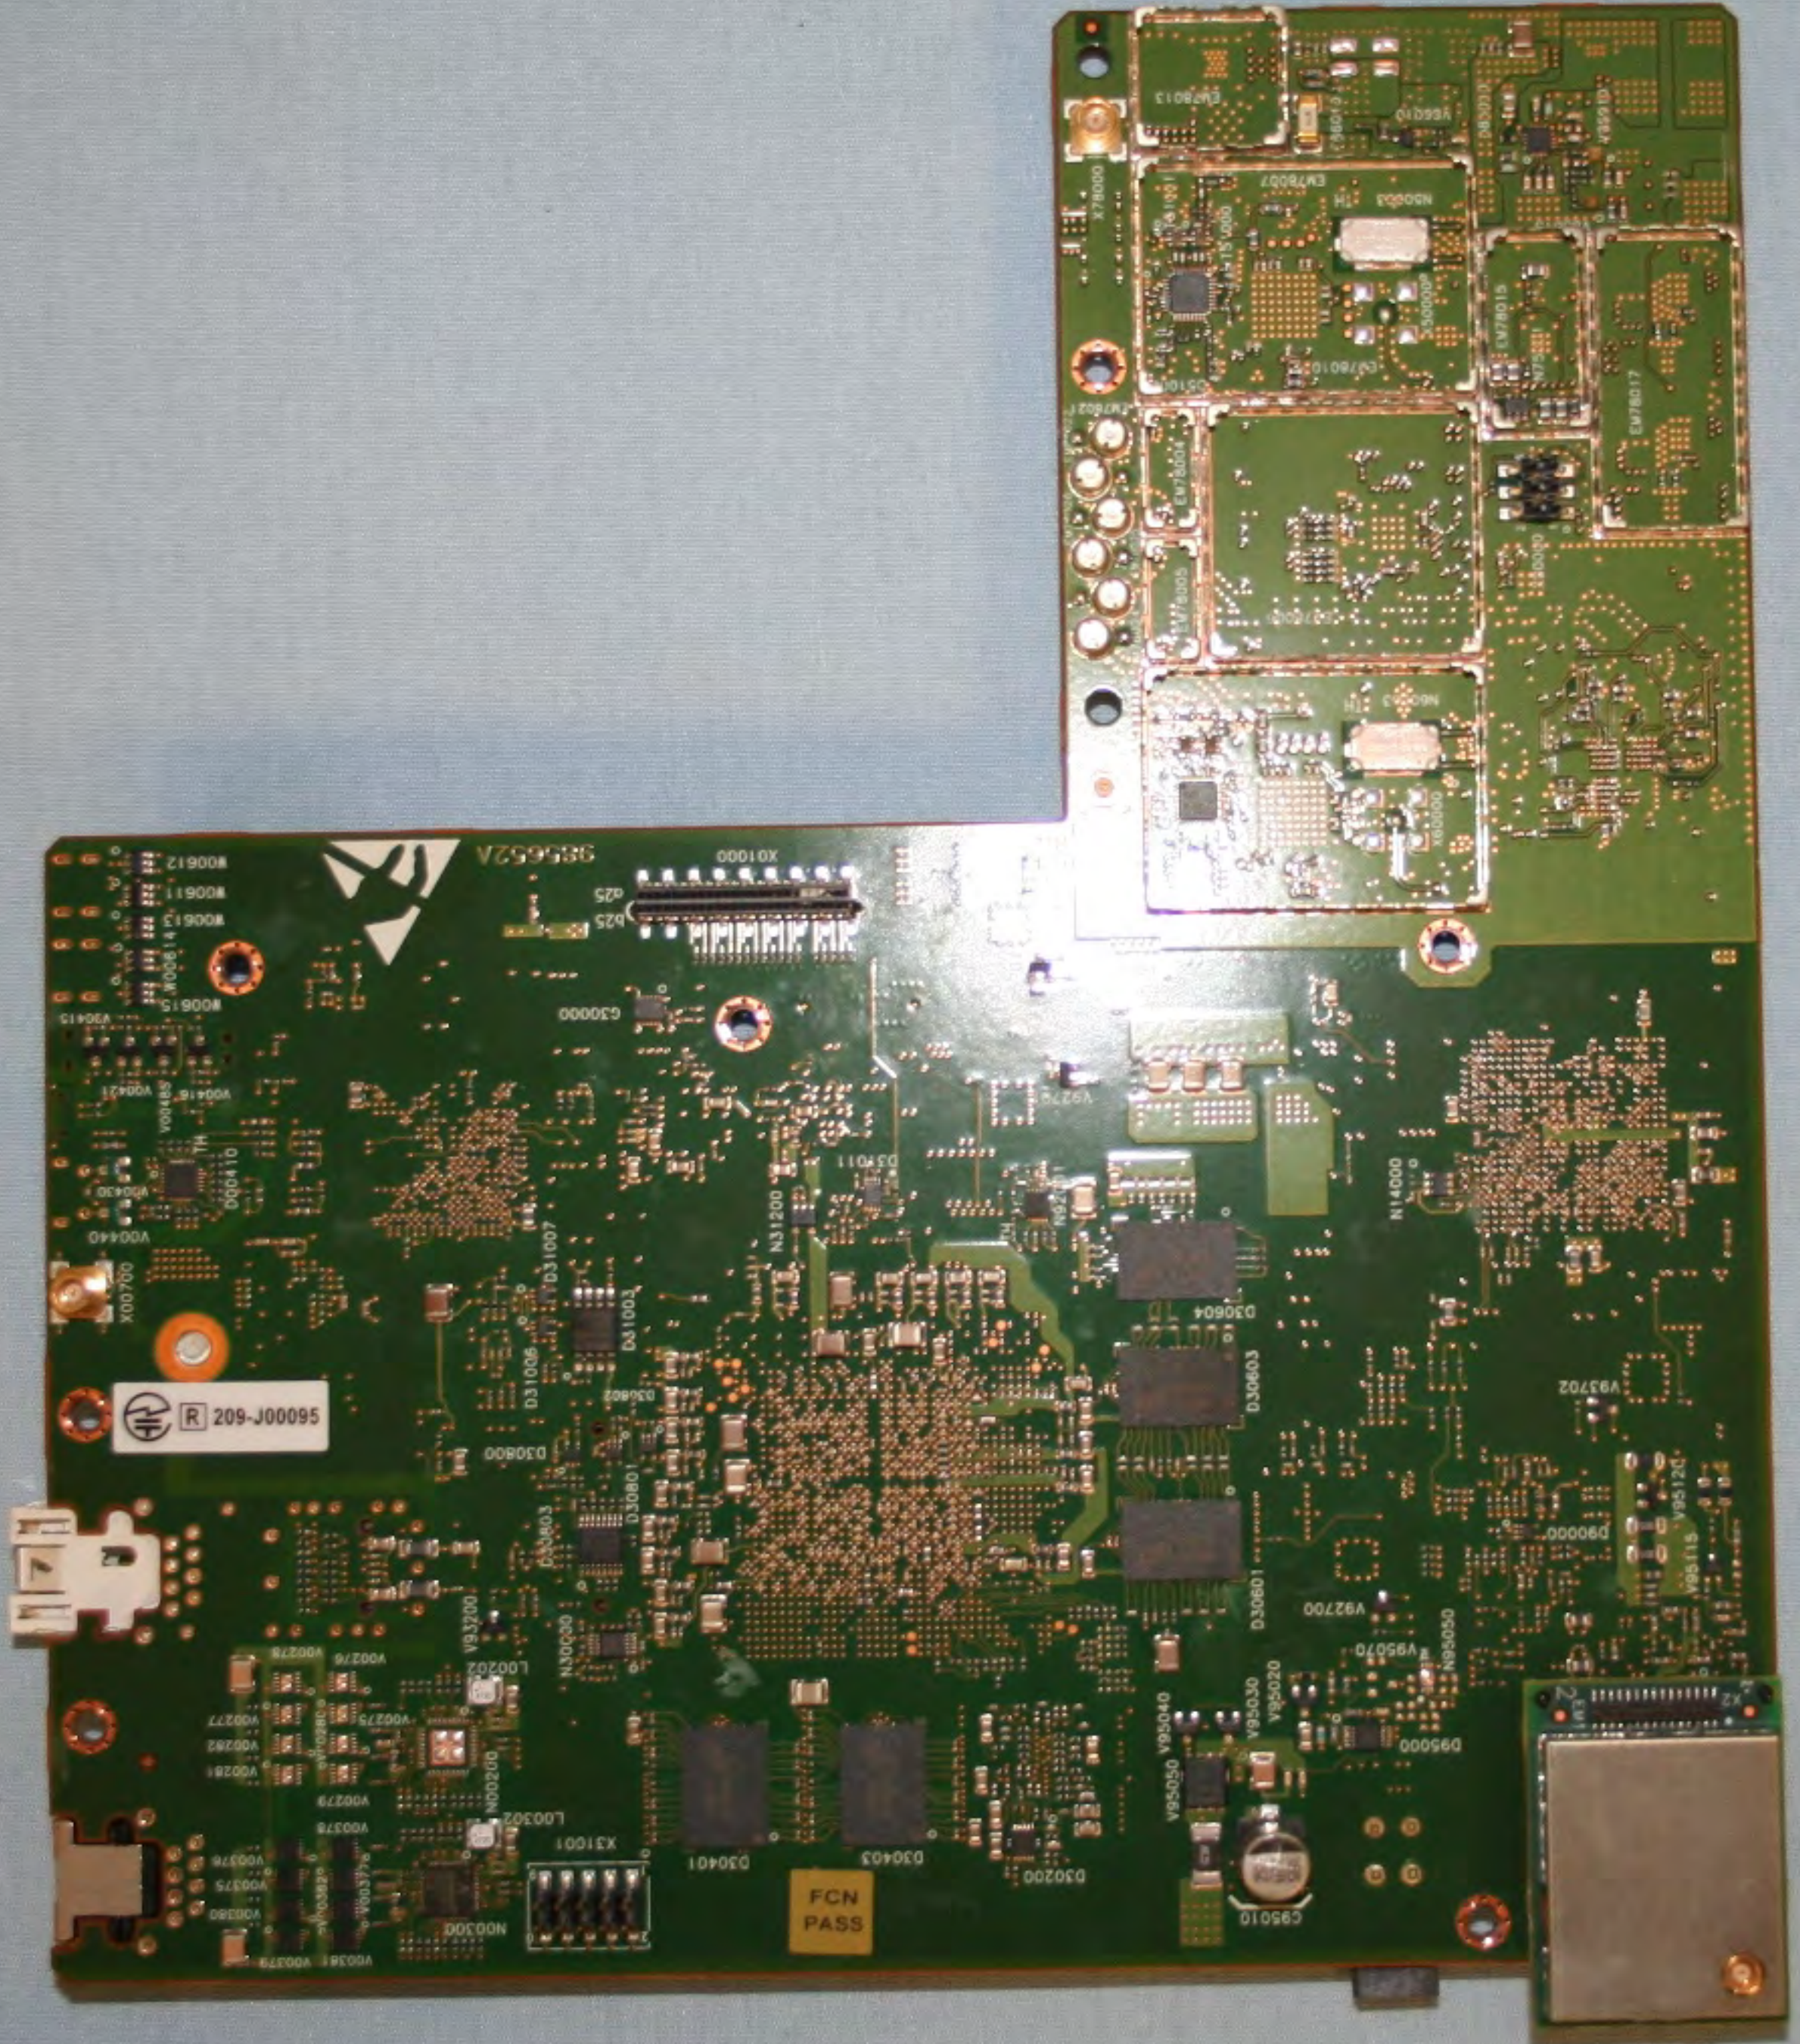



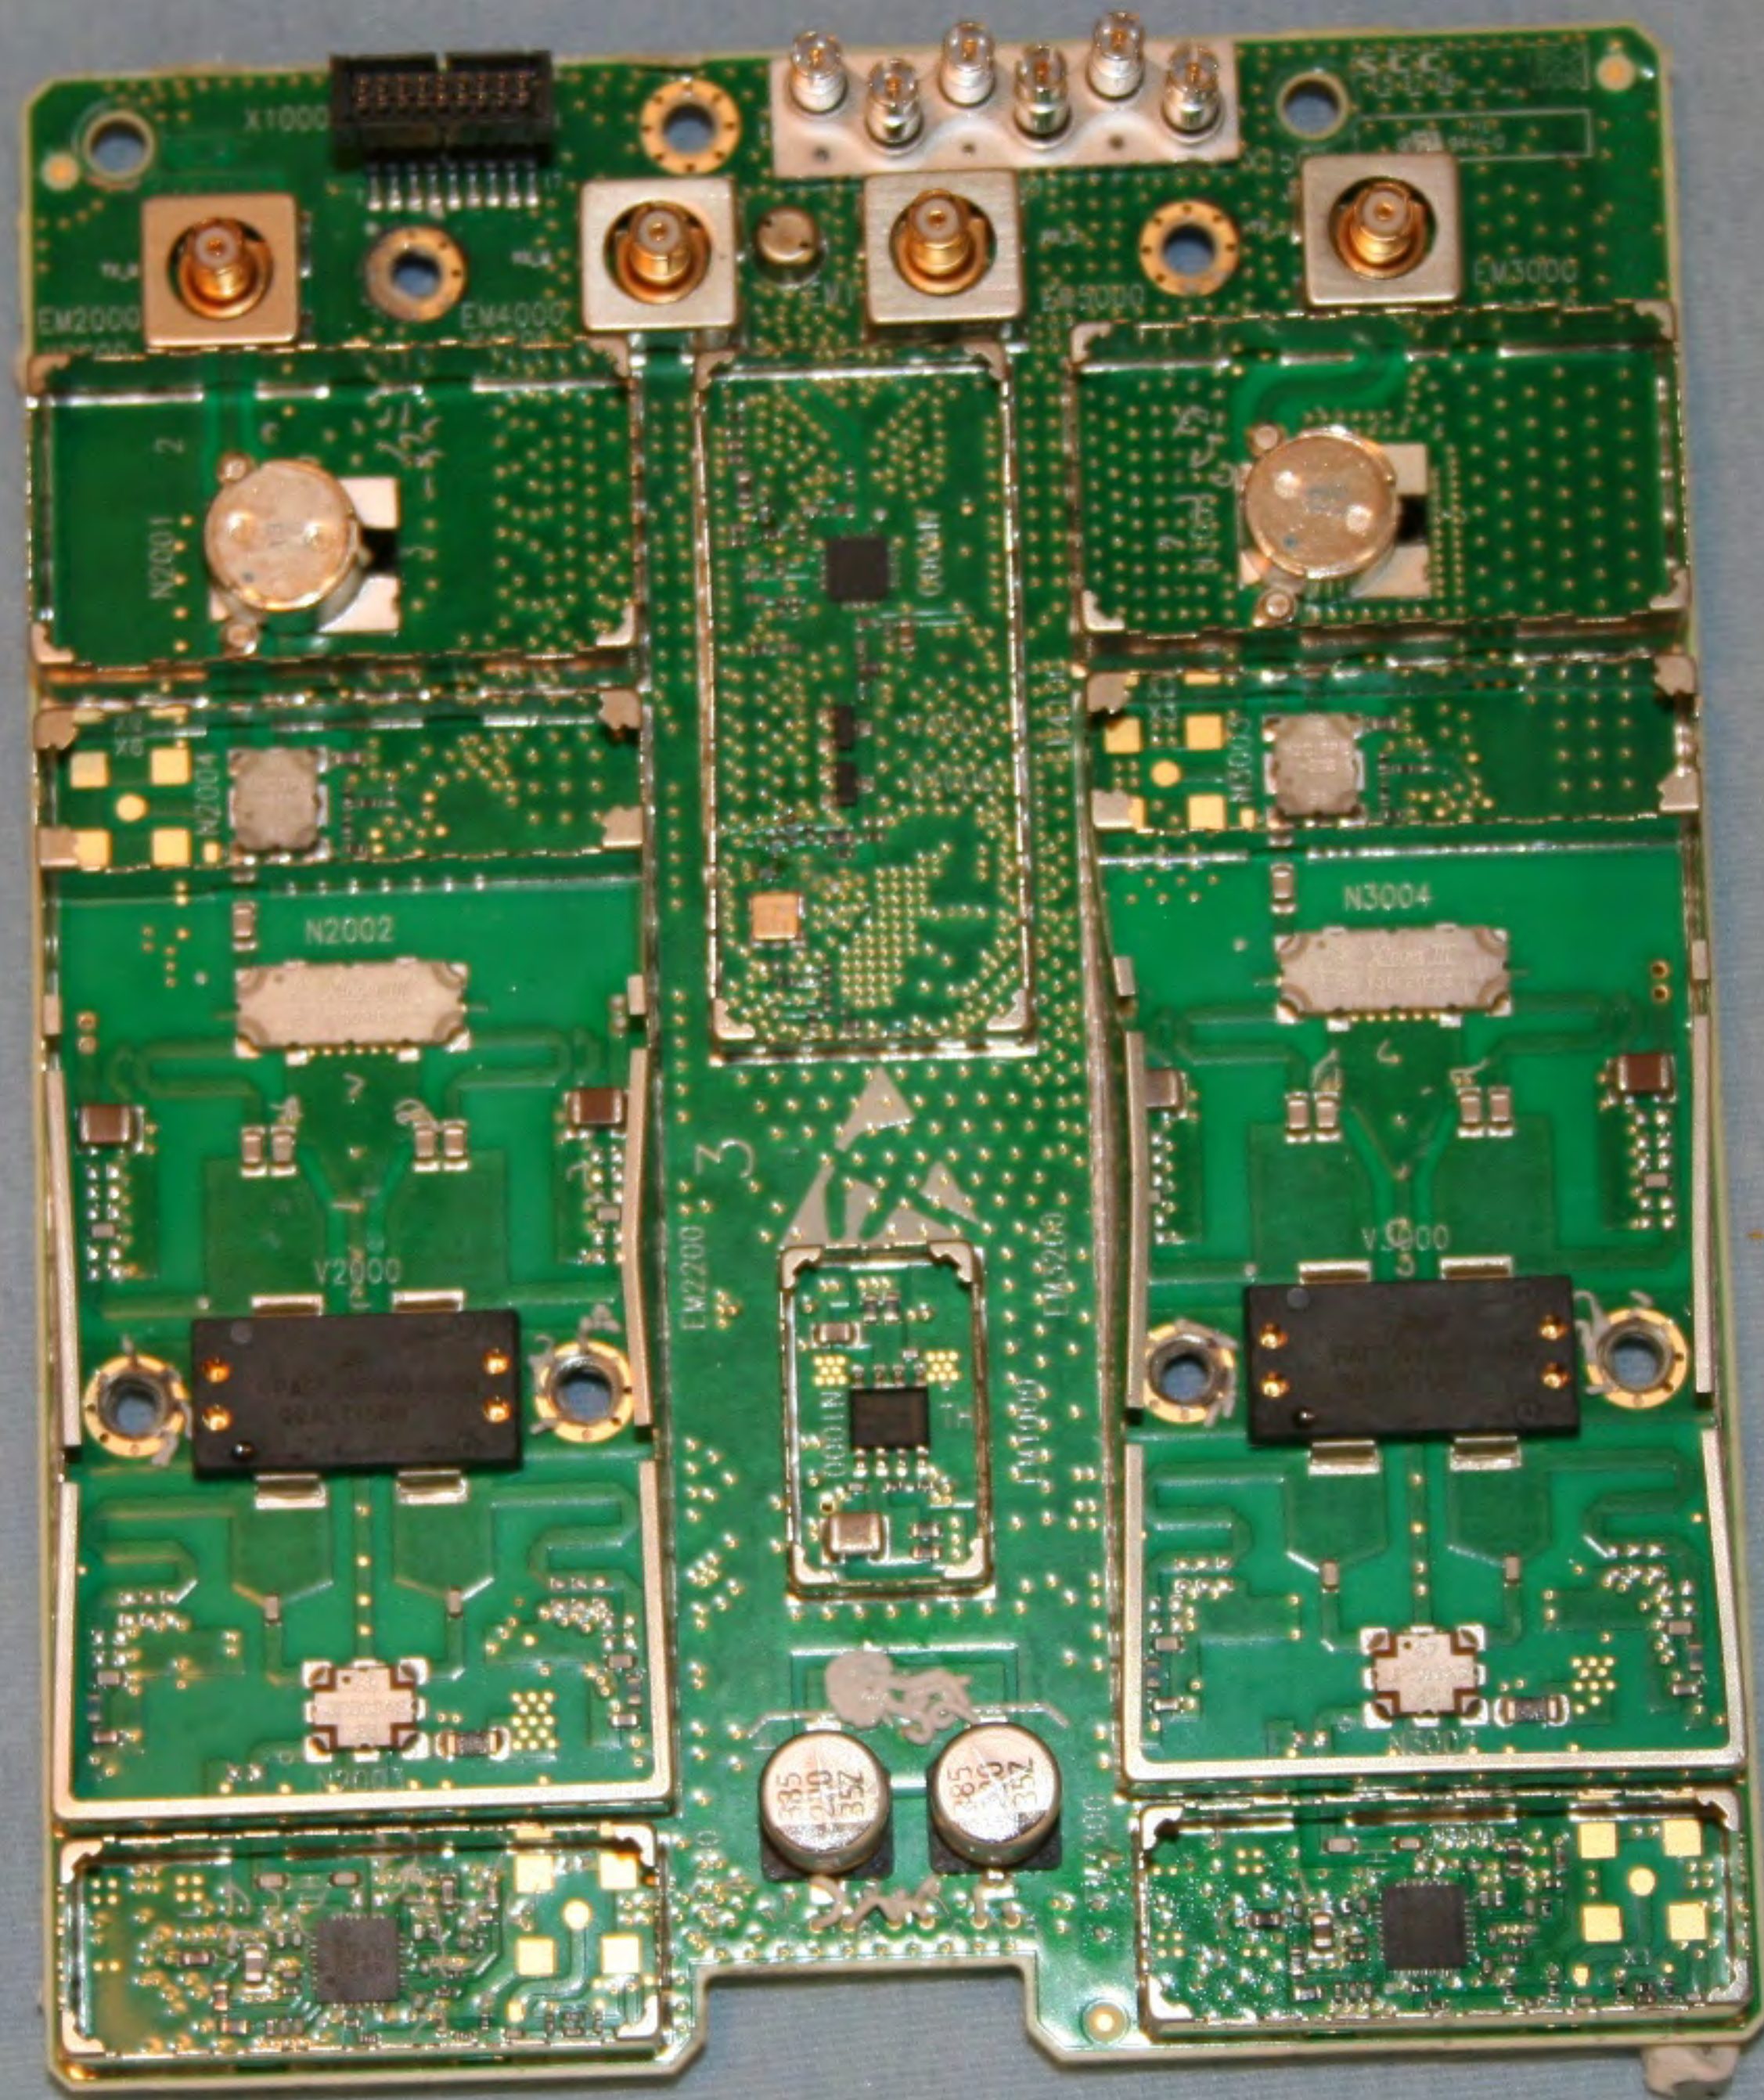

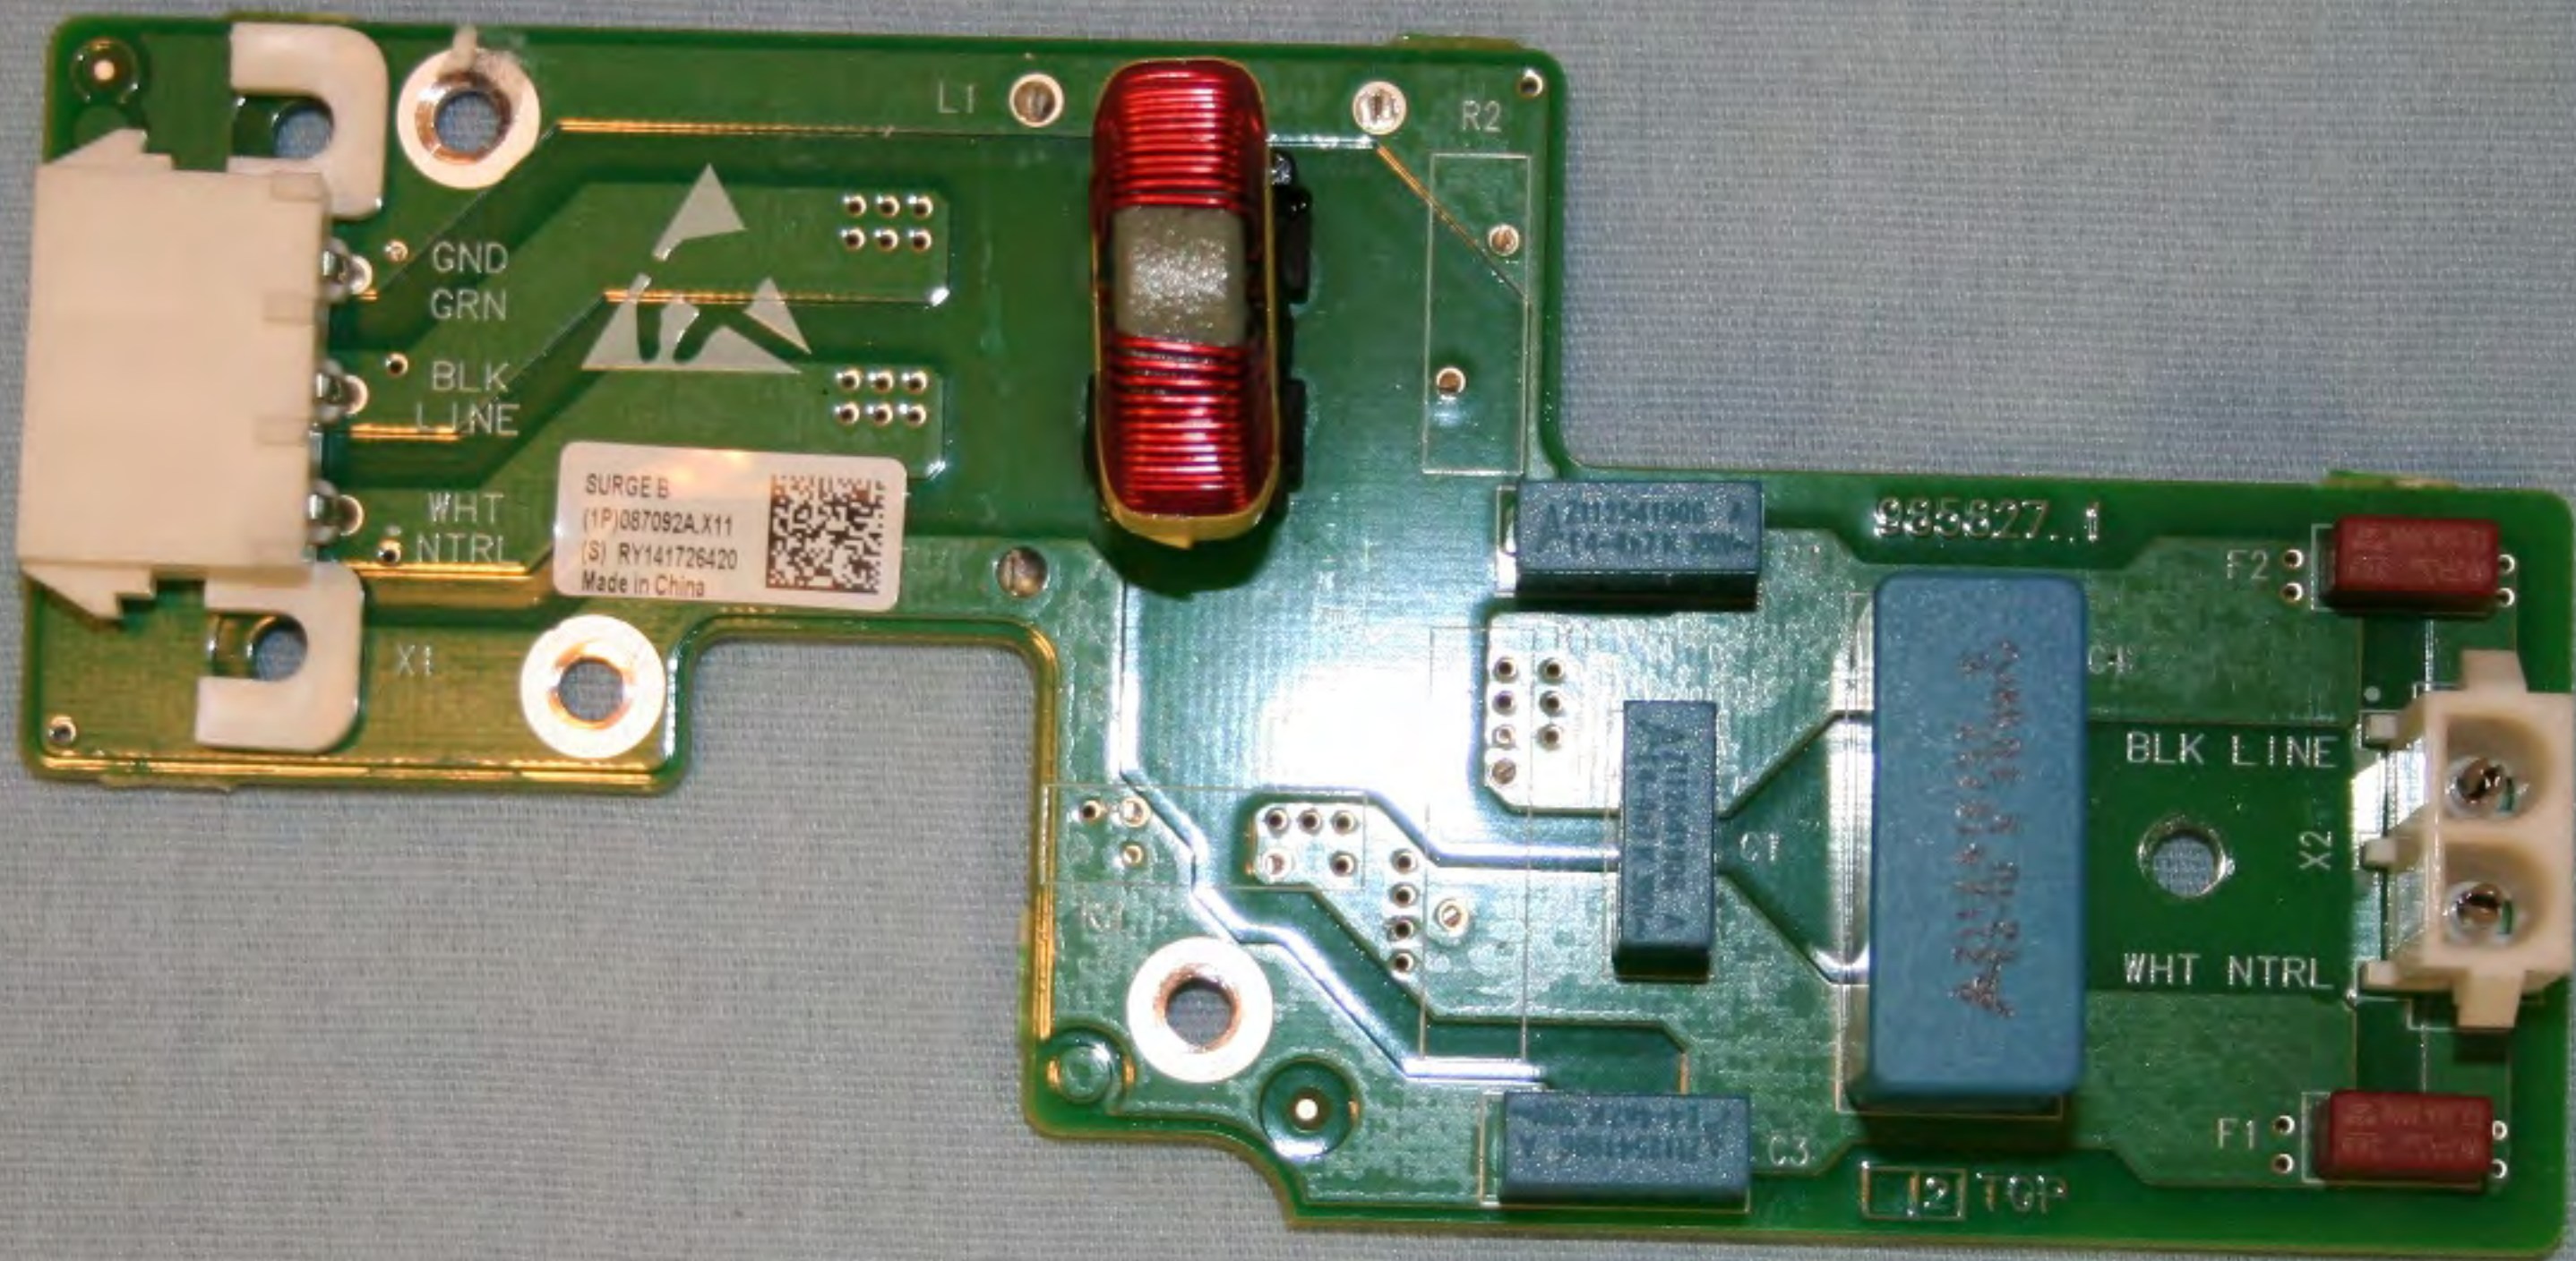

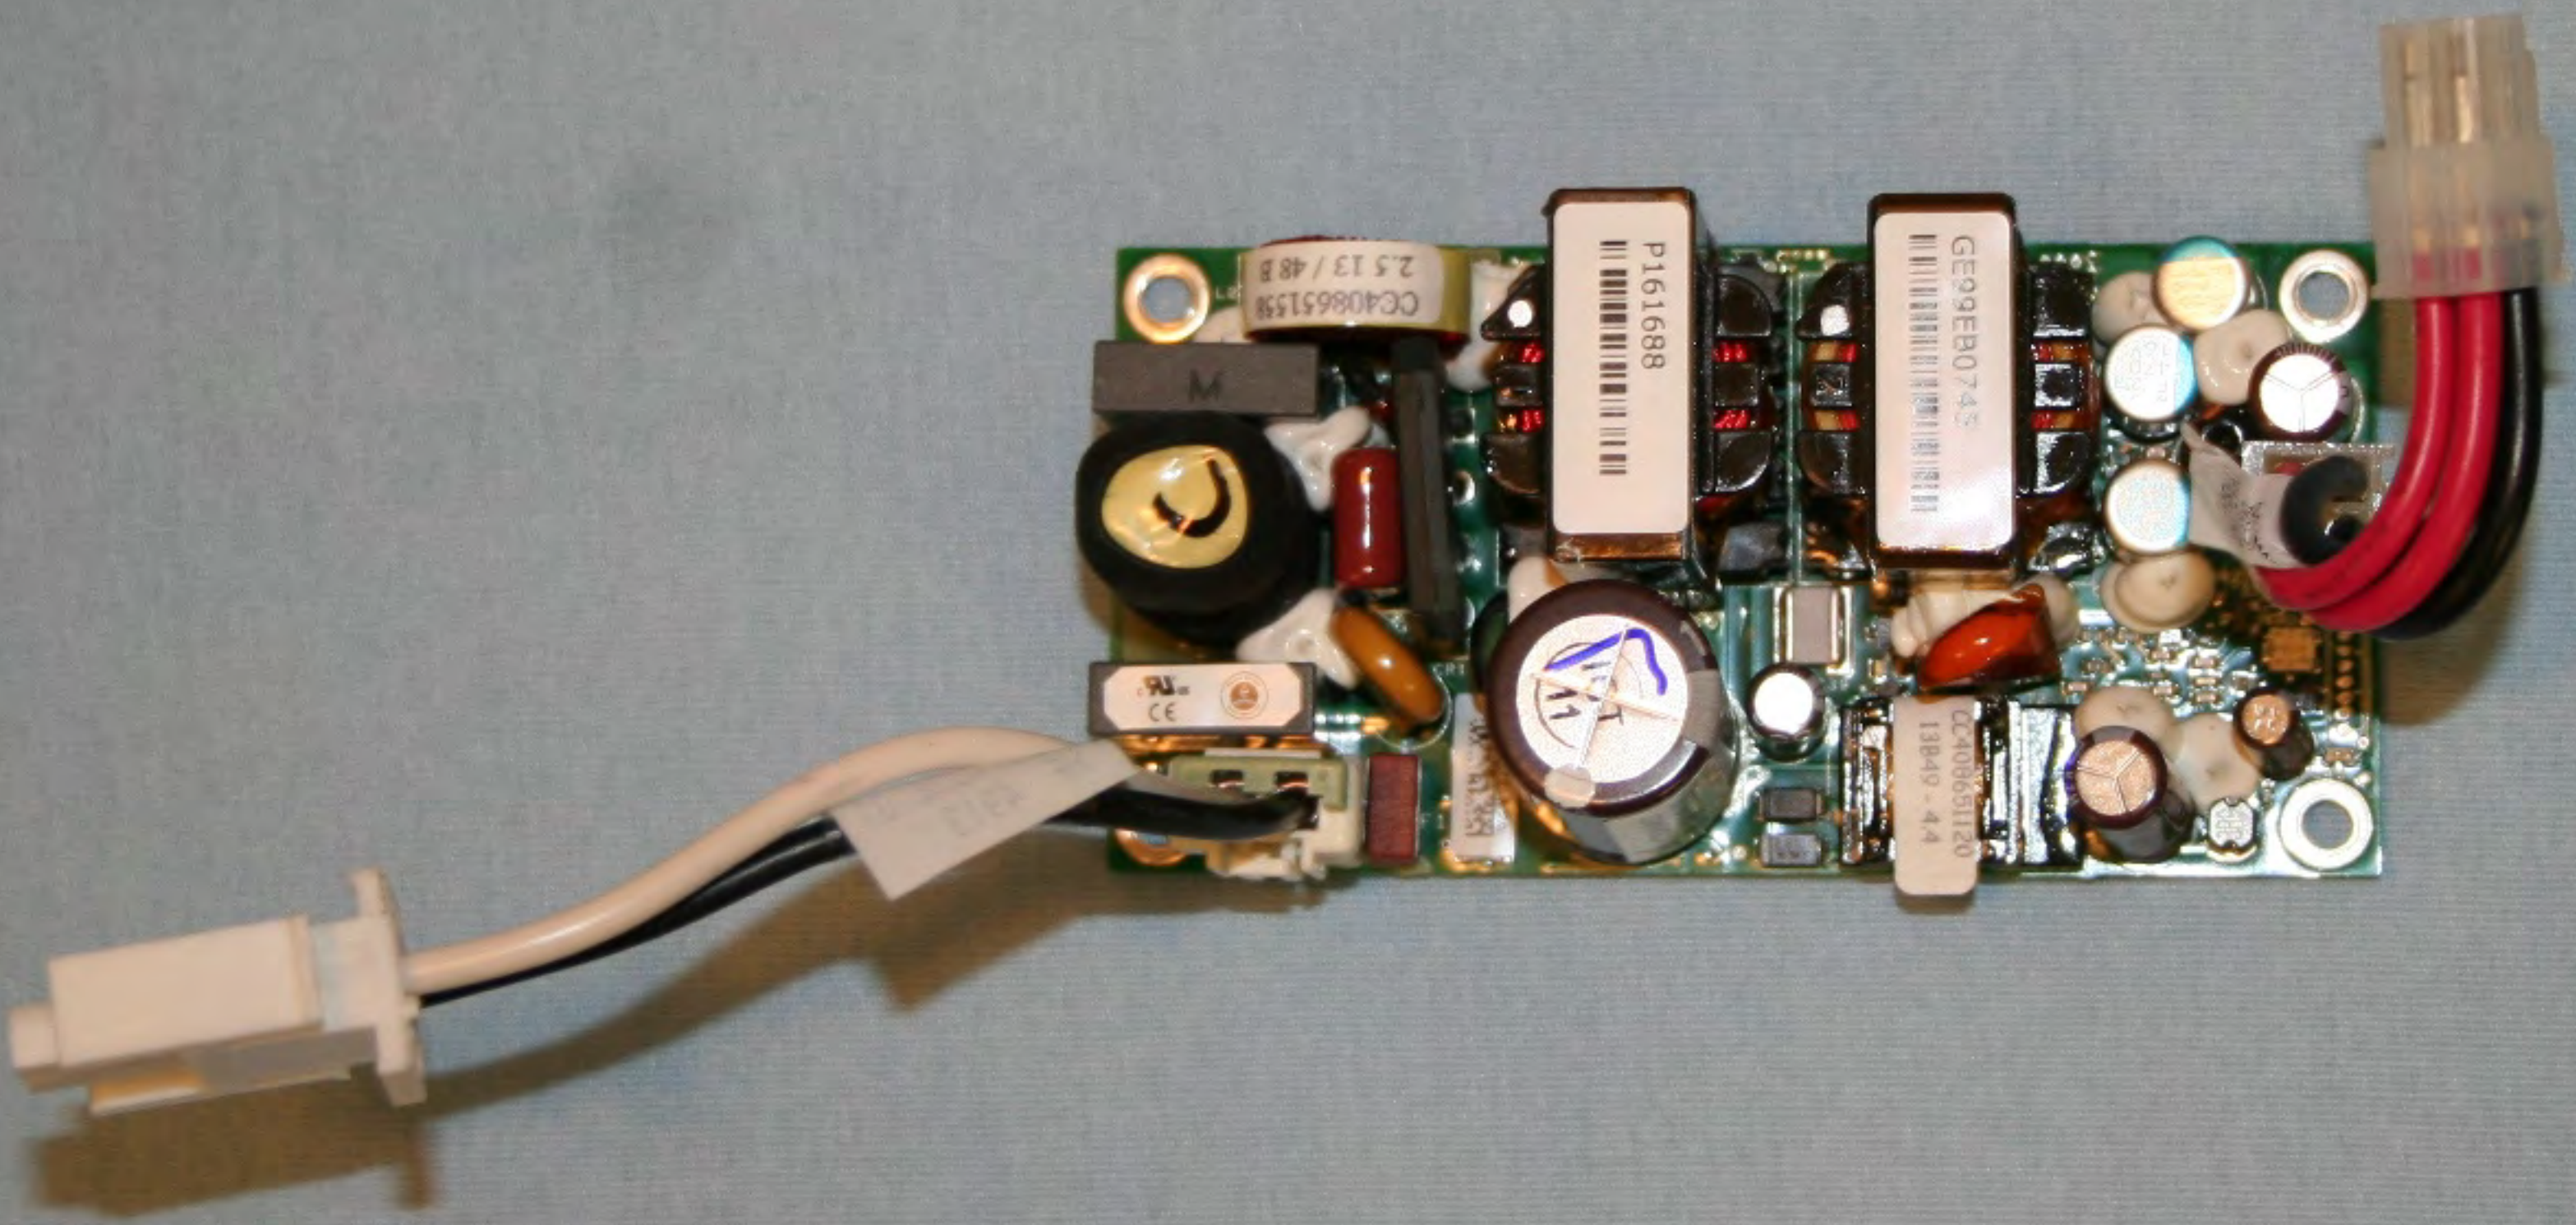

CC408651558  
2.5 13 / 48 B

P161688

GE99EB0745

CC408651120  
13849 - 44

PA  
CE

