

Cyrus AP is a BLE5.2 controllable high bay PIR motion and daylight sensor. This sensor operates on a 90–277VAC input voltage range adopts a PIR sensing technology for accurate motion detection. It comes with swappable lenses for high-bay and lowbay applications, giving you a maximum mounting height of 14m (46 ft) and a maximum detection range of 28m (92 ft) diameter.





Table Of Contents

| 1. | Features | 3 |
|----|----------------------|---|
| 2. | Specifications | 3 |
| 3. | Lens Details | 4 |
| 4. | Device Dimensions | 6 |
| 5. | Wire Description | 6 |
| 6. | Wiring Diagram | 7 |
| 7. | Accessories | 7 |
| 8. | Warning | 8 |
| 9. | Ordering Information | 8 |
| | | |



1. Features

- Motion and daylight sensor, with adjustable lenses for high-bay and low-bay applications
- BLE 5.2 based non flooding wireless communication
- 90-277VAC universal AC input voltage range
- PIR sensor for accurate motion detection
- Maximum mounting height of 14m
- Motion detection range up to 28m diameter

2. Specifications

| Electrical | Min. | Тур. | Max. | Unit | Remarks |
|-----------------|------|------|------|------|------------|
| Input Voltage | 90 | | 277 | VAC | |
| Input Frequency | 50 | | 60 | Hz | |
| humant Cumant | | | 9 | mА | 9mA@230VAC |
| Input Current | | | 15 | mА | 15mA@90VAC |

| Bluetooth | Min. | Тур. | Max. | Unit | Remarks |
|-----------------|------|------|------|------|-------------------------|
| Frequency Range | 2402 | | 2480 | MHz | |
| TX Power | | | 8.0 | dBm | With 150mm wire antenna |
| RX sensitivity | | -95 | | dBm | |

| Environmental | Min. | Тур. | Max. | Unit | Remarks |
|-----------------------|------|------|------|------|---------|
| Operating Temperature | 0 | | 80 | ٥С | |


| Mechanical | Тур. | Unit | Remarks |
|------------|--------------|------|-------------------|
| Dimensions | 59.8 x 63.1 | mm | Diameter x Height |
| Dimensions | 2.3 x 2.5 | inch | Diameter x Height |
| Weight | 8 <i>5.0</i> | 9 | In grams |
| | 3.0 | οz | In ounces |



- 3. Lens Details
- Low-bay lens image



Low-bay lens detection area

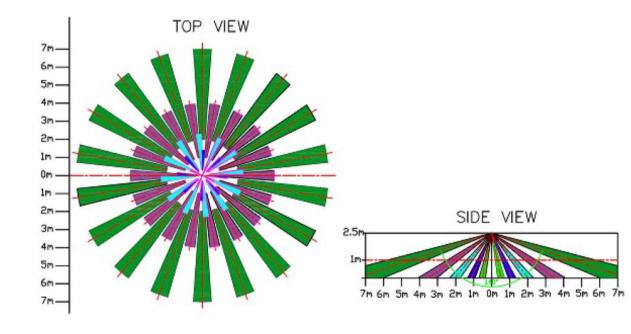

| Low Bay Sensor | Value | Unit | Remarks |
|-------------------------|-------|------|----------------------------------|
| | 8.2 | ft | |
| Maximum Mounting Height | 2.5 | т | |
| Maximum Detection Range | 45.9 | ft | Diameter @ 8.2ft mounting height |
| | 14 | т | Diameter @ 2.5m mounting height |





High-bay lens image



High-bay lens detection area

TOP VIEW

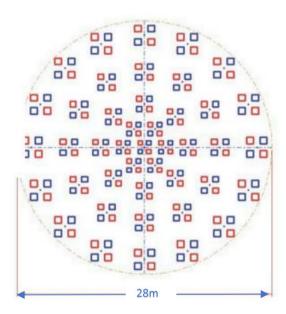

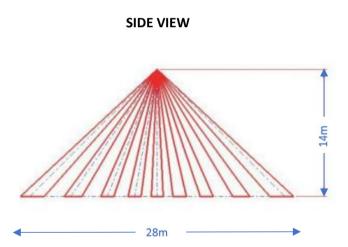


| High Bay Sensor | Μαχ. | Unit | Remarks |
|-------------------------|------|------|-----------------------------------|
| | 45.9 | ft | |
| Maximum Mounting Height | 14 | т | |
| Maximum Detection Range | 91.9 | ft | Diameter @ 45.9ft mounting height |
| | 28 | т | Diameter @ 14m mounting height |




4. Device Dimensions

Dimensions are in mm (excluding lens)

Case material: ABS, white color

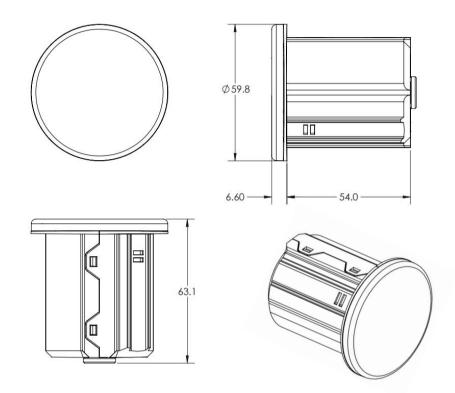

5. Wire Description

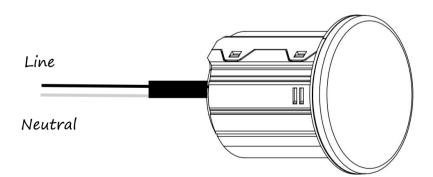


| NO. | WIRE NAME | DESCRIPTION | SPECIFICATIONS |
|-----|-----------|----------------------|--------------------------|
| 1 | Line | 90-277VAC input line | 20AWG, 600V, Black color |
| 2 | Neutral | AC input neutral | 20AWG, 600V, White color |



6. Wiring Diagram

Cyrus AP is powered via AC supply to communicate sensor data wirelessly with other WiSilica BLE mesh devices.

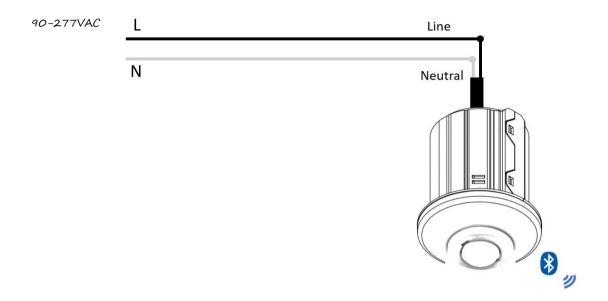

7. Accessories

Cyrus AP can be mounted to ceiling or at surface using the following mounting accessories.

a. Cyrus AP with ceiling mount accessory

Dimension: 89.8 x 68.2 mm (Top Diameter x Height, excludes lens) Case Material: ABS, White colour






b. Cyrus AP with surface mount accessory

Dimension: 110 x 71.2 mm (Bottom Diameter x Height, excludes lens) Case Material: ABS, White colour





8. Warning

- 1. Ensure that electricity supply is switched off completely before installation or servicing the product.
- 2. To prevent the device from any defect, please handle and store it with care.
- 3. Do not open or disassemble the product.
- 4. To prevent injury, this apparatus must be securely installed.
- 5. To reduce the risk of fire or electric shock, do not expose this apparatus to rain or moisture. The apparatus shall not be exposed to dripping or splashing and that objects filled with liquids, such as vases, shall not be placed on apparatus.

9. Ordering Information

| Product Code | Product Name | Product Description | Voltage Rating |
|--------------|--------------|---------------------------------------|----------------|
| WMAP | Cyrus AP | Wireless PIR Motion & Daylight Sensor | 90-277VAC |

| Accessory Code | Accessory Name | Accessory Description |
|----------------|----------------|-------------------------|
| WM-SMK | Cyrus-SMK | Surface Mount Accessory |
| WM-CMK | Cyrus-CMK | Ceiling Mount Accessory |
| WM-LBL | Cyrus-LBL | Low-bay lens accessory |
| WM-HBL | Cyrus-HBL | High-bay lens accessory |



FCC Statement

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Caution: Any changes or modifications to this device not explicitly approved by manufacturer could void your authority to operate this equipment.

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

RF Exposure Information

This equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 20cm between the radiator and your body.





23282 Mill creek Dr #340 Laguna Hills, CA 92653 USA

🖂 sales@wisilica.com

www.lumoscontrols.com

Version 1.0