




Appendix B. AC Conducted Emission Test Results

Test Engineer :	Louis Chung	Temperature :	23.4~24.6°C
		Relative Humidity :	48.3~55.7%

EUT Information

Report NO : 413013-01
 Test Mode : Mode 2
 Test Voltage : 120Vac/60Hz
 Phase : Line

Full Spectrum

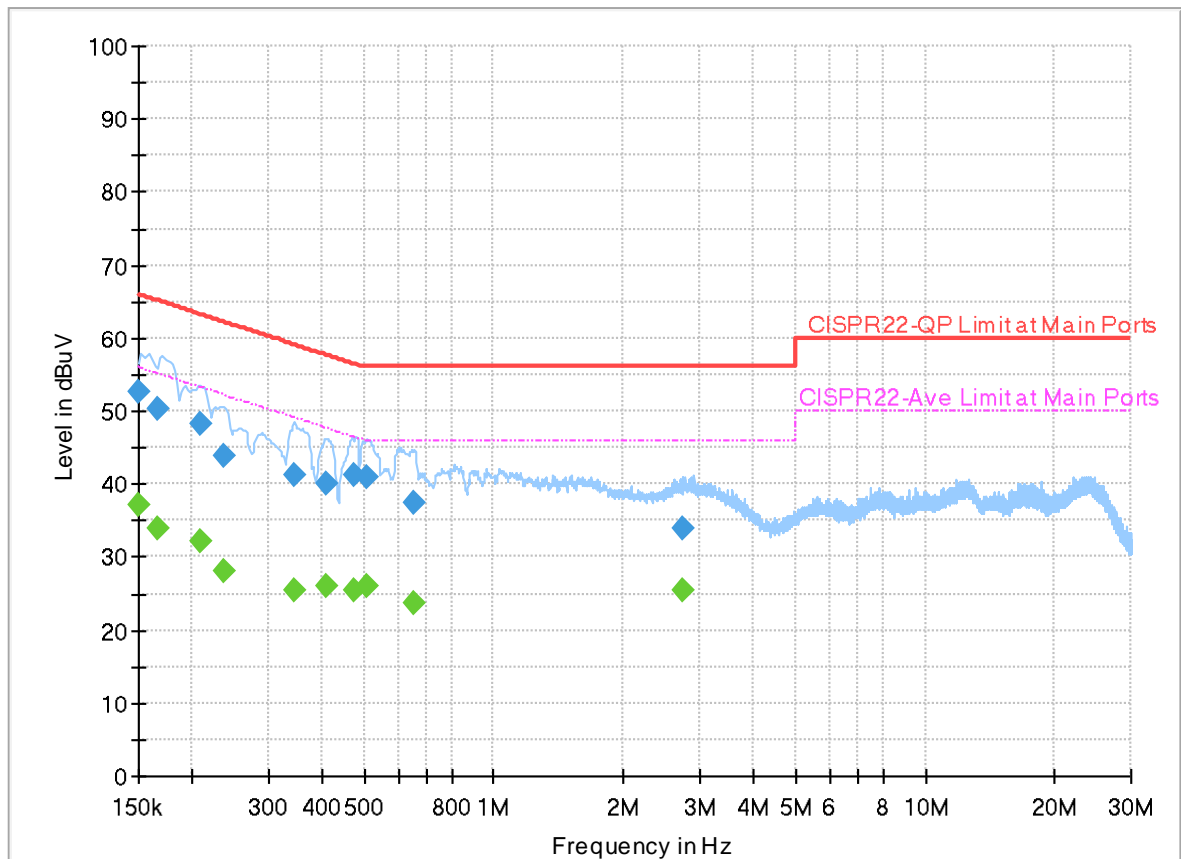

Final_Result


Frequency (MHz)	QuasiPeak (dBuV)	CAverage (dBuV)	Limit (dBuV)	Margin (dB)	Line	Filter	Corr. (dB)
0.150000	---	37.00	56.00	19.00	L1	OFF	19.9
0.150000	52.62	---	66.00	13.38	L1	OFF	19.9
0.166470	---	34.00	55.14	21.14	L1	OFF	19.9
0.166470	50.40	---	65.14	14.74	L1	OFF	19.9
0.209580	---	32.07	53.22	21.15	L1	OFF	19.9
0.209580	48.17	---	63.22	15.05	L1	OFF	19.9
0.236040	---	28.09	52.23	24.14	L1	OFF	19.9
0.236040	43.85	---	62.23	18.38	L1	OFF	19.9
0.345840	---	25.56	49.06	23.50	L1	OFF	19.9
0.345840	41.11	---	59.06	17.95	L1	OFF	19.9
0.408930	---	26.01	47.67	21.66	L1	OFF	19.9
0.408930	40.01	---	57.67	17.66	L1	OFF	19.9
0.474000	---	25.33	46.44	21.11	L1	OFF	19.9
0.474000	41.14	---	56.44	15.30	L1	OFF	19.9
0.508380	---	26.13	46.00	19.87	L1	OFF	19.9
0.508380	40.79	---	56.00	15.21	L1	OFF	19.9
0.649500	---	23.82	46.00	22.18	L1	OFF	19.9
0.649500	37.51	---	56.00	18.49	L1	OFF	19.9
2.749920	---	25.36	46.00	20.64	L1	OFF	20.0

2.749920	33.86	---	56.00	22.14	L1	OFF	20.0
----------	-------	-----	-------	-------	----	-----	------

EUT Information

Report NO : 413013-01
 Test Mode : Mode 2
 Test Voltage : 120Vac/60Hz
 Phase : Neutral

Full Spectrum

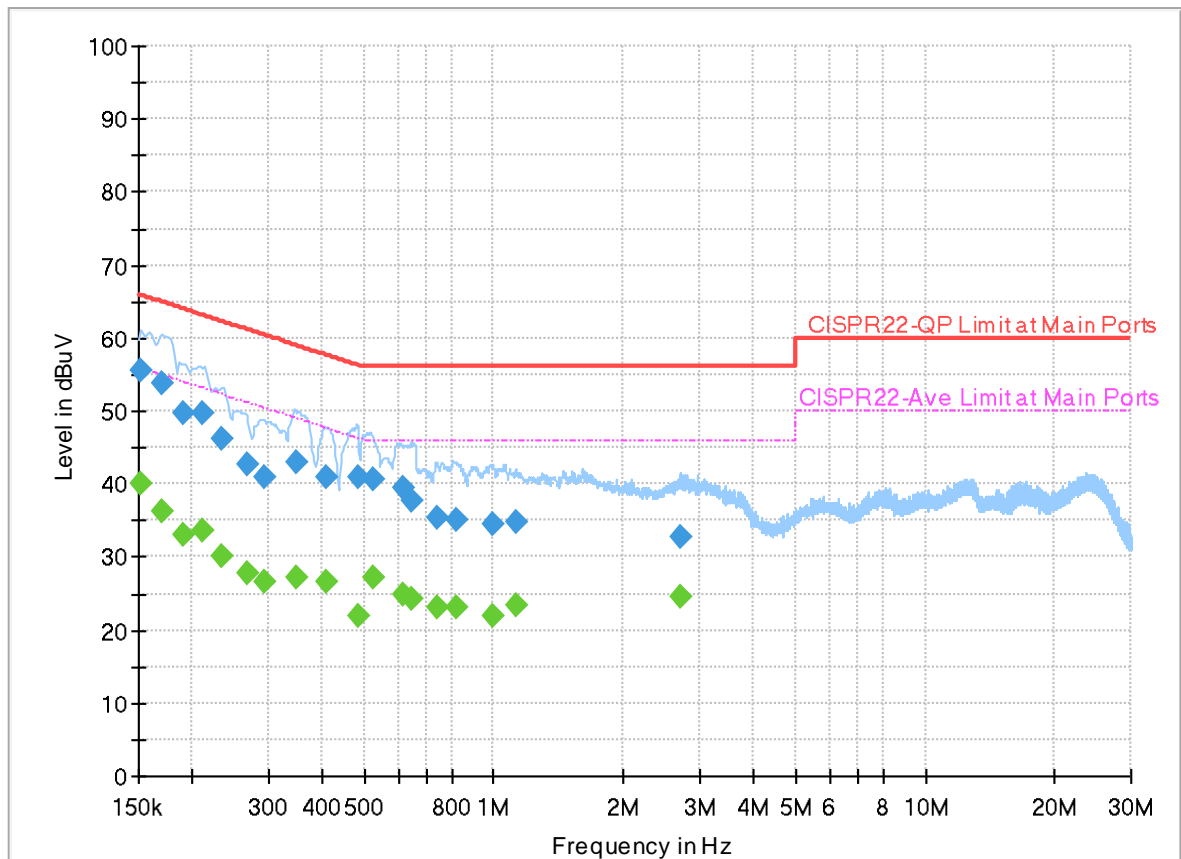

Final_Result

Frequency (MHz)	QuasiPeak (dBuV)	CAverage (dBuV)	Limit (dBuV)	Margin (dB)	Line	Filter	Corr. (dB)
0.151755	---	40.06	55.90	15.84	N	OFF	19.9
0.151755	55.56	---	65.90	10.34	N	OFF	19.9
0.169890	---	36.13	54.97	18.84	N	OFF	19.9
0.169890	53.86	---	64.97	11.11	N	OFF	19.9
0.190590	---	33.10	54.01	20.91	N	OFF	19.9
0.190590	49.80	---	64.01	14.21	N	OFF	19.9
0.210750	---	33.64	53.18	19.54	N	OFF	19.9
0.210750	49.85	---	63.18	13.33	N	OFF	19.9
0.233250	---	30.08	52.33	22.25	N	OFF	19.9
0.233250	46.24	---	62.33	16.09	N	OFF	19.9
0.267180	---	27.77	51.21	23.44	N	OFF	19.9
0.267180	42.66	---	61.21	18.55	N	OFF	19.9
0.294180	---	26.52	50.41	23.89	N	OFF	19.9
0.294180	41.02	---	60.41	19.39	N	OFF	19.9
0.350250	---	27.29	48.96	21.67	N	OFF	19.9
0.350250	43.05	---	58.96	15.91	N	OFF	19.9
0.411000	---	26.68	47.63	20.95	N	OFF	19.9
0.411000	41.05	---	57.63	16.58	N	OFF	19.9
0.482640	---	22.07	46.29	24.22	N	OFF	19.9

0.482640	40.94	---	56.29	15.35	N	OFF	19.9
0.523500	---	27.29	46.00	18.71	N	OFF	19.9
0.523500	40.51	---	56.00	15.49	N	OFF	19.9
0.613500	---	24.99	46.00	21.01	N	OFF	19.9
0.613500	39.46	---	56.00	16.54	N	OFF	19.9
0.645990	---	24.18	46.00	21.82	N	OFF	19.9
0.645990	37.80	---	56.00	18.20	N	OFF	19.9
0.741480	---	23.06	46.00	22.94	N	OFF	19.9
0.741480	35.38	---	56.00	20.62	N	OFF	19.9
0.815820	---	23.17	46.00	22.83	N	OFF	19.9
0.815820	35.23	---	56.00	20.77	N	OFF	19.9
0.996900	---	21.86	46.00	24.14	N	OFF	19.9
0.996900	34.53	---	56.00	21.47	N	OFF	19.9
1.125690	---	23.41	46.00	22.59	N	OFF	19.9
1.125690	34.93	---	56.00	21.07	N	OFF	19.9
2.712750	---	24.60	46.00	21.40	N	OFF	20.0
2.712750	32.72	---	56.00	23.28	N	OFF	20.0