

# HEALTHY & SMART APP

## 1 APP SETTING

📲 DOWNLOAD 🔒 LOGIN

## 2 USE & ADJUSTMENT

👤 CREATE PROFILE  
 🔗 CONNECT  
 🪑 LUMBAR PROTECTION SETTING

## 3 UBIQUITOUS HEALTHCARE

🏠 FUNCTION OF THE HOME PAGE  
 ❤️ HEALTHY SITTING POSTURE WARNING  
 ⌚ SEDENTARINESS WARNING  
 📊 SITTING POSTURE EVALUATION  
 📈 SITTING POSTURE STATISTICS

## 4 FACILITIES MAINTENANCE


⚙️ SETTINGS 🗨️ FAQ



THE WORLD FIRST CHAIR  
WITH SMART APP

1 APP SETTING

📲 DOWNLOAD

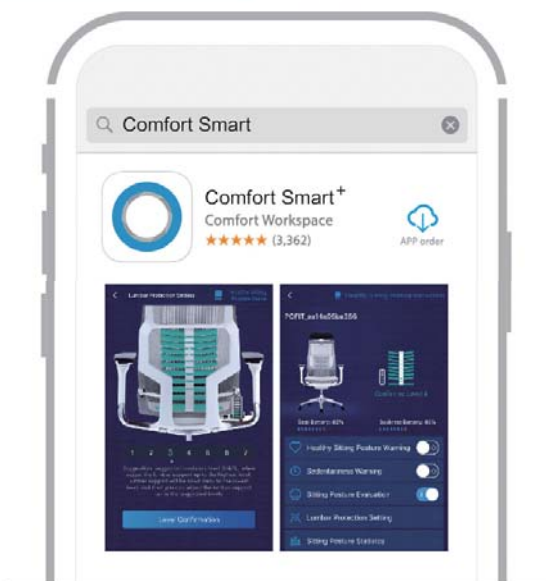

**DOWNLOAD**



## 2 USE & ADJUSTMENT

👤 CREATE PROFILE

AFTER LOGGING IN



## CREATE PROFILE

Enter your personal information

- 1 Name
- 2 Gender
- 3 Age
- 4 Weight
- 5 Height

Then press  
Confirm

## 2 USE & ADJUSTMENT

🔗 CONNECT

Remind to **turn on** bluetooth



## CONNECT

3 ways to connect your Pofit chair



or Connecting by entering ID code


or Connecting by Bluetooth  
**RECOMMENDED**

or Connecting by scanning QR code

\*For more than 2pcs Pofit with APP nearby, recommend to scan QR code for more exact connection

## 2 USE & ADJUSTMENT


🪑 LUMBAR PROTECTION SETTING

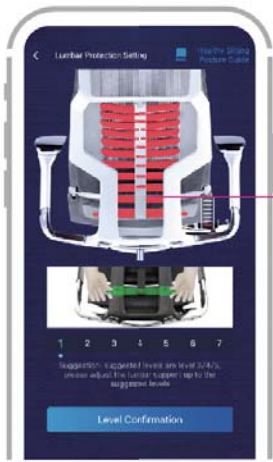

### Situation C Too Low Levels

Lumbar level is too high  
The bionic spine becomes red

APP will advise you to adjust lumbar level up to the suggested levels. Also you can try other levels to find the best comfortable level to save




### 3 UBIQUITOUS HEALTHCARE

### FUNCTION OF THE HOME PAGE



Comfort Smart<sup>+</sup>

When finished all settings, login app to access to functions home page directly

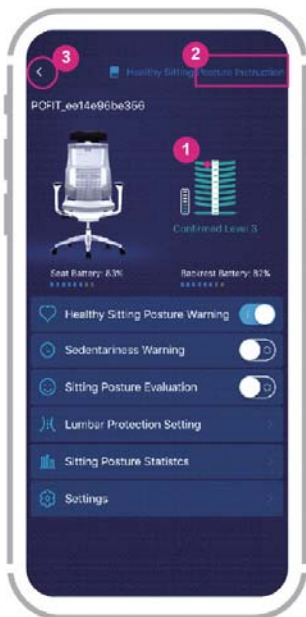

1 When APP detected lumbar levels has been changed, APP will send reminder: "YES" access to "Lumbar Protection Setting" "NO" Save it as the best lumbar level




### 3 UBIQUITOUS HEALTHCARE

### HEALTHY SITTING POSTURE WARNING



### HEALTHY SITTING POSTURE WARNING

If APP detects any one of incorrect sitting posture, it will send a warning message to your phone every 3 mins, 5 mins or 10 mins. You can set every 3 mins, 5 mins or 10 mins to make warning

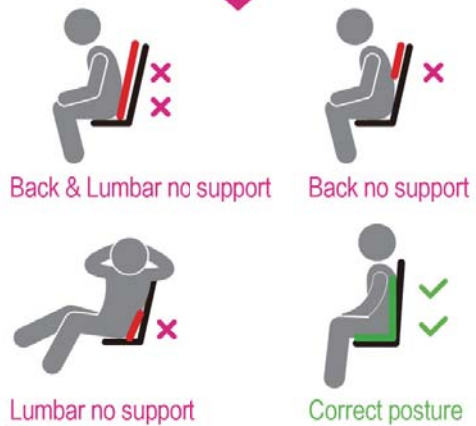


Healthy Sitting Posture Warning  
"Yes" – access to "Healthy Sitting Posture Guide"  
"No" – exit the warning window



### 3 UBIQUITOUS HEALTHCARE

### SEDENTARINESS WARNING




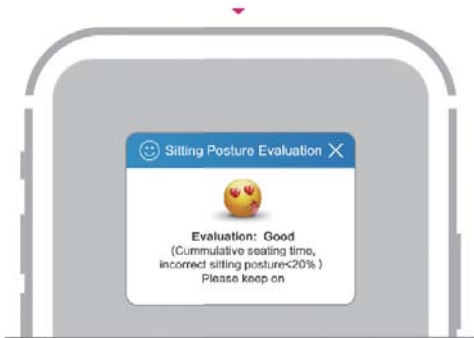

Perfect  
Sitting Posture



Improved  
Sitting Posture

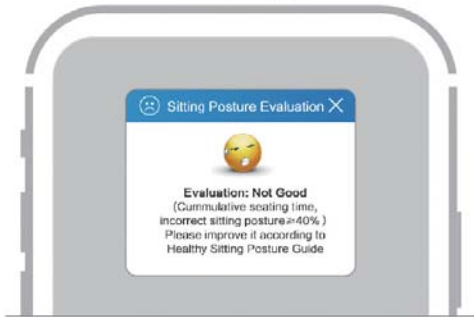

Not Good  
Sitting Posture

### 6. No connection during using the app ?

- Seat and backrest devices would enter hibernation without any use in 5 minutes, please Sit on the chair, and lean on the backrest to awake the devices
- Restart "Comfort Smart+"
- Remove the seat batteries to restart the device
- Your chair may be connected by others when your app is disconnected



3 incorrect operations may cause **bionic spine retroflexion**



A Improper pull to the bionic spine



B Improper push to the backrest.



C Extra pillow beside the backrest



Bionic spine retroflexion

### Solution:

When there is a bionic spine retroflexion, push the bionic spine lightly to get it back to the normal shape and structure. No functional failure



## 3 UBIQUITOUS HEALTHCARE



## SITTING POSTURE STATISTICS

### SITTING POSTURE STATISTICS

Review the sitting posture status in one week or one month via "Sitting Posture Statistics". It records the total sitting time, correct sitting posture time, and 3 types of incorrect sitting posture time: no lumbar support, no back support, and no back & lumbar support



Search  and **download APP**


**!** In order to achieve APP smart functions, please set authority management

**APPLE** Settings-Advice-COMFORT INTELLIGENCE-Allow notice

**ANDROID** Settings-Application Management-COMFORT INTELLIGENCE-Notice- Turn on lock screen display


**1 APP SETTING** **LOGIN**

**2 WAYS TO LOGIN**

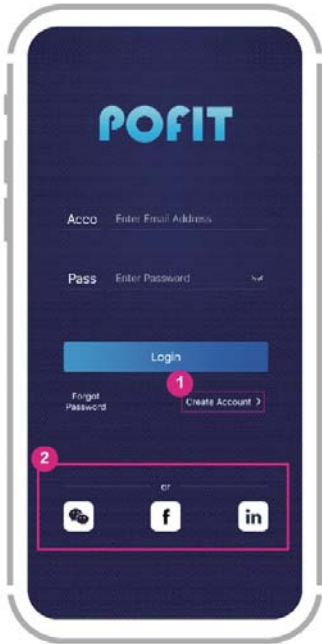

**LUMBAR PROTECTION SETTING**



App can guide users to adjust to best comfortable lumbar support position through large data analysis to maintain users' health

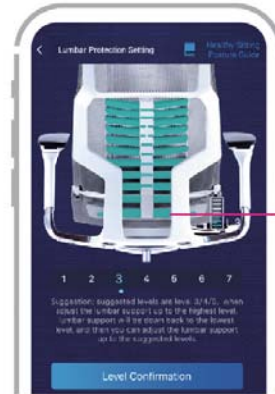

**Situation A**  
Suggested Levels

Lumbar levels are within comfortable ones  
The bionic spine becomes **green**

You can confirm this level if you feel the level is the best comfortable. Also you can experience other levels to find the best proper one and press "Level Confirmation" button to save

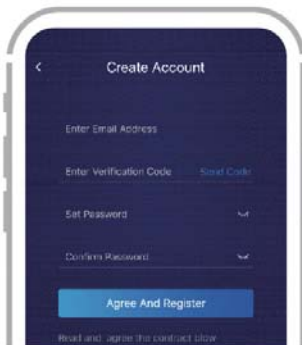

**1 CREATE ACCOUNT**


For 1st time to use app, please register account by mailbox to get verification code and set password



**Situation B**  
Too High Levels

Lumbar level is too high  
The bionic spine becomes **yellow**


APP will advise you to adjust lumbar level down to the suggested levels. Also you can try other levels to find the best comfortable level and confirm it. Once you got the most comfortable level, then confirm to save



**2** Log in via the third-party WeChat, Facebook or LinkedIn at the first time, get the personal information automatically, and then turn to "My Profile"



**2 HEALTHY SITTING POSTURE INSTRUCTION**

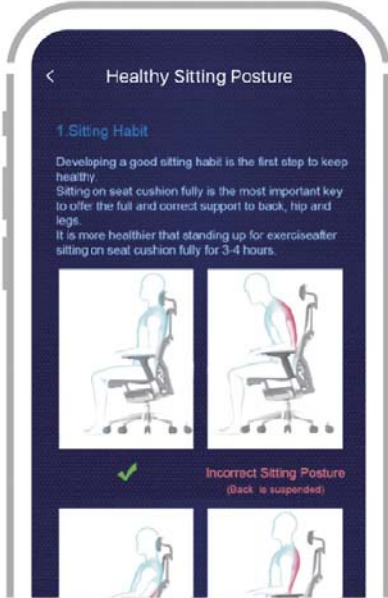

**SEDENTARINESS WARNING**

Turn on the Sedentariness warning, the APP will detect your activity status automatically. It will send a message to remind you to get up to move and relax when you sit still for too long, you can set warning cycle of 2,3,4 hours



**3 MY CHAIR**



When reach functions home page, click "back" to access to "MY CHAIR". This interface can add and switch connection with other Pofit chairs quickly. "MY CHAIR" will record and display all connected chairs

**UNBIND MY CHAIR**

Double-click my chair name to unbind. If confirm "unbind", the chair do not appear "MY CHAIR". It does not connect automatically the unbound chair when login again. We need to reconnect the chair to rebind it

Click to revise the name of "my seating". The name of "my seating" become green, then connect successfully

please input nick name

Cancel Confirm

**3 UBIQUITOUS HEALTHCARE**


**SITTING POSTURE EVALUATION**



**SITTING POSTURE EVALUATION**

Turn on the function of sitting posture evaluation. APP will calculate how much time you sit correctly and how much time you sit wrongly every 3-8 hours and will send a evaluation message to your phone. This function can help users to develop a good & healthy sitting habit





## 4 FACILITIES MAINTENANCE

### SETTINGS



#### SETTINGS

- Review & revise personal information
- Review the user manuals to resolve operational problems
- Language: Chinese, English, Japanese
- Turn on the Ringer and Vibration to get the sitting posture status in time, never miss any health re-

You can switch account after logging out.

#### FCC WARNING

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

NOTE: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation.

If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

The device has been evaluated to meet general RF exposure requirement. The device can be used in portable exposure condition without restriction

FCC ID: 2ARRF-POFIT

## 4 FACILITIES MAINTENANCE

### FAQ

#### 1. No device be found, or cannot connect the device

- Sit on the chair, and lean on the backrest to awake both seat and backrest device
- Make sure the Bluetooth is turned on, close the handset to the chair, unobstructed internet with no interference
- Remove the seat batteries to restart the device
- Restart "Comfort Smart+"
- Restart your handset
- Your chair could be connected by others, if you still cannot connect the device

#### 2. Cannot connect the historical chair in "My-Chair"

- Long press the icon to unbind the historical chair, and then connect the chair again

#### 3. After connecting successfully, the display of current level(in "lumbar protection setting" ) doesn't change when user adjusts the lumbar support ?

- Based on the stability of Bluetooth technology, data transmission may be delayed after the first successful connection. Everything will be back to normal within 20s
- Backrest may not be awakened, please lean on the backrest to awake the backrest device

#### 4. Battery level goes to "0" suddenly

- Seat and backrest devices would enter hibernation without any use in 5 minutes, please Sit on the chair, and lean on the backrest to awake the devices

#### 5. No automatic connecting to the historical chair ?

- Make sure "Comfort Smart+" is running in the background
- App will connect the chair used in the last automatically