



11AC40SISO_Ant1_5190




11AC40SISO_Ant1_5230

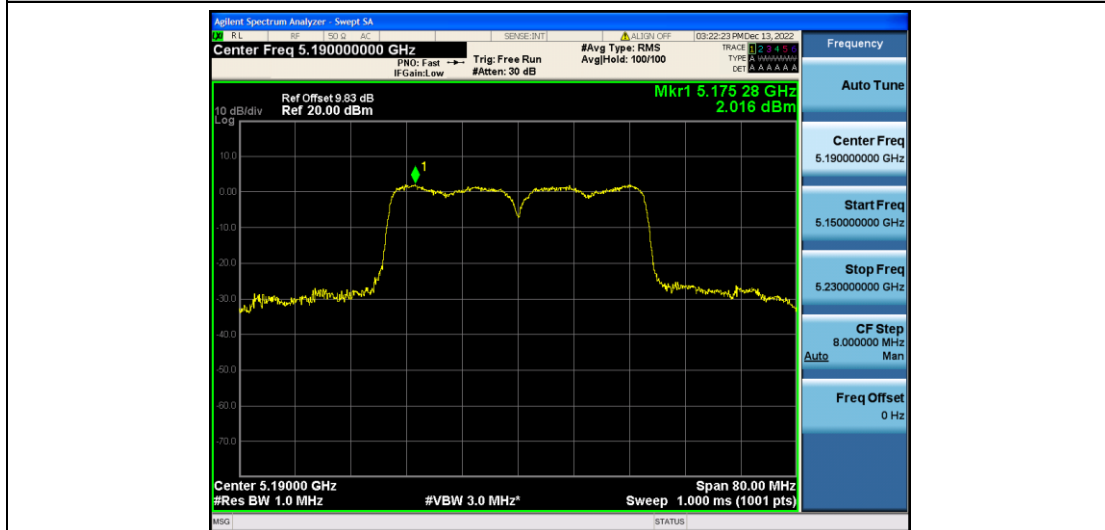

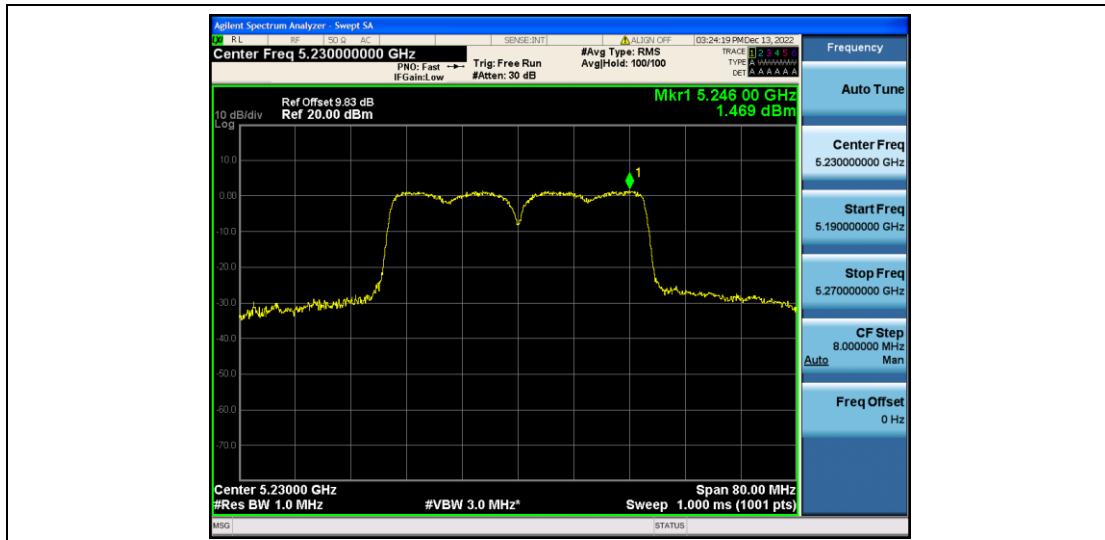


11AC40SISO_Ant1_5270

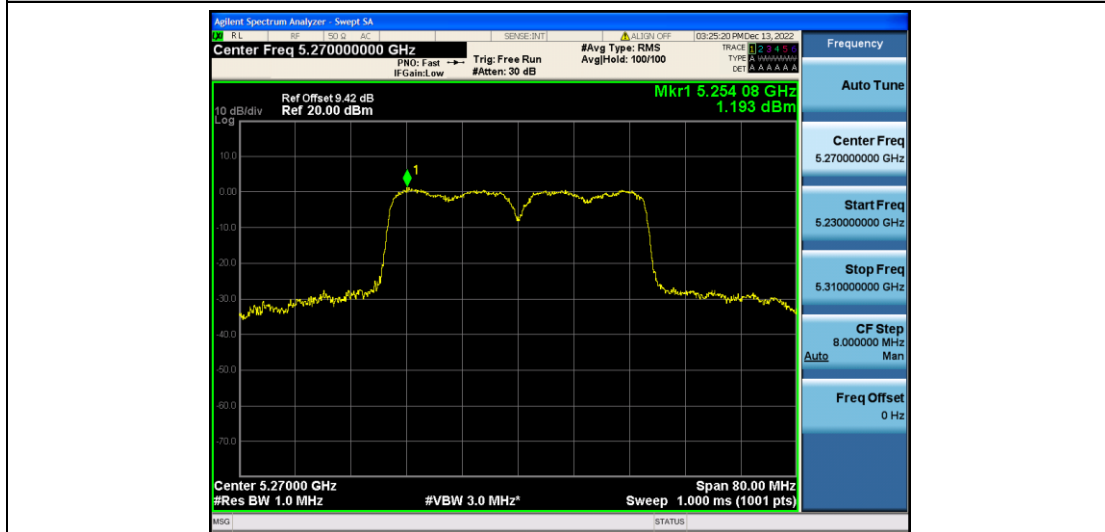


11AC40SISO_Ant1_5310



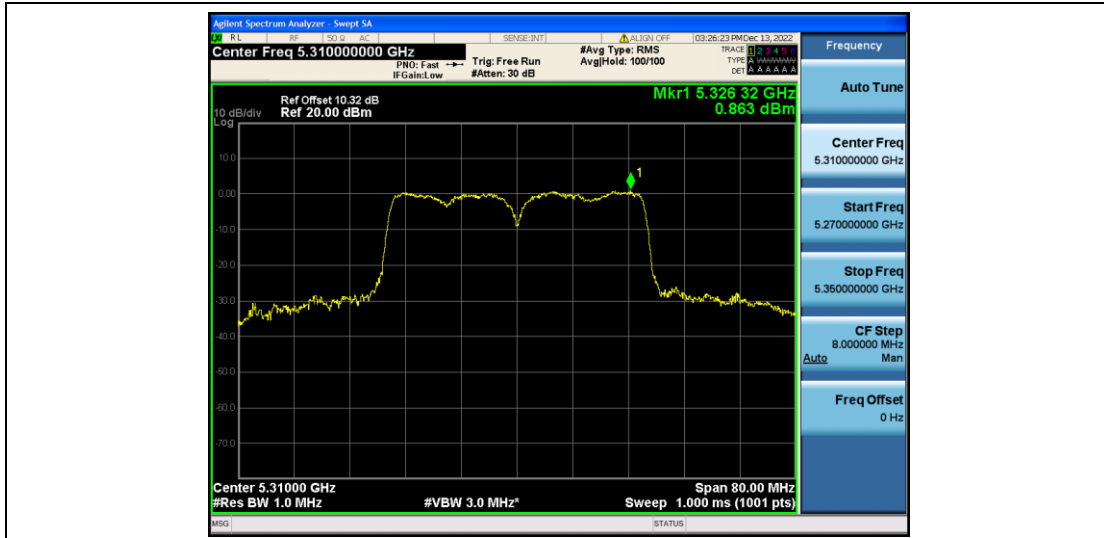

11AC40SISO_Ant1_5510

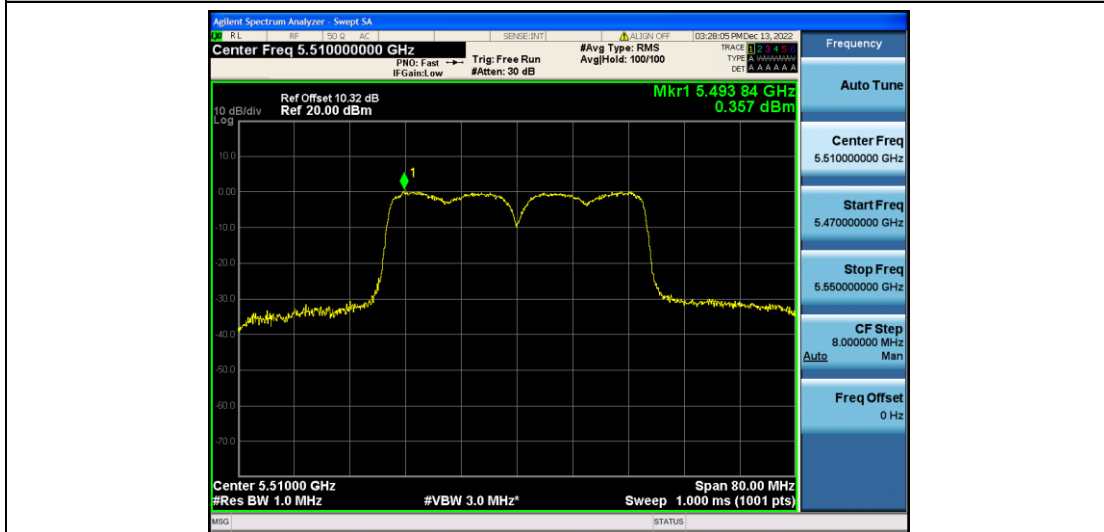

11AC40SISO_Ant1_5550




SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab


Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: GN.Doncheck@sgs.com

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612 t (86-21) 61915666 f (86-21) 61915678 www.sgs.com.cn
中国·上海·松江区金都西路588号 邮编: 201612 t (86-21) 61915666 f (86-21) 61915678 sgs.china@sgs.com

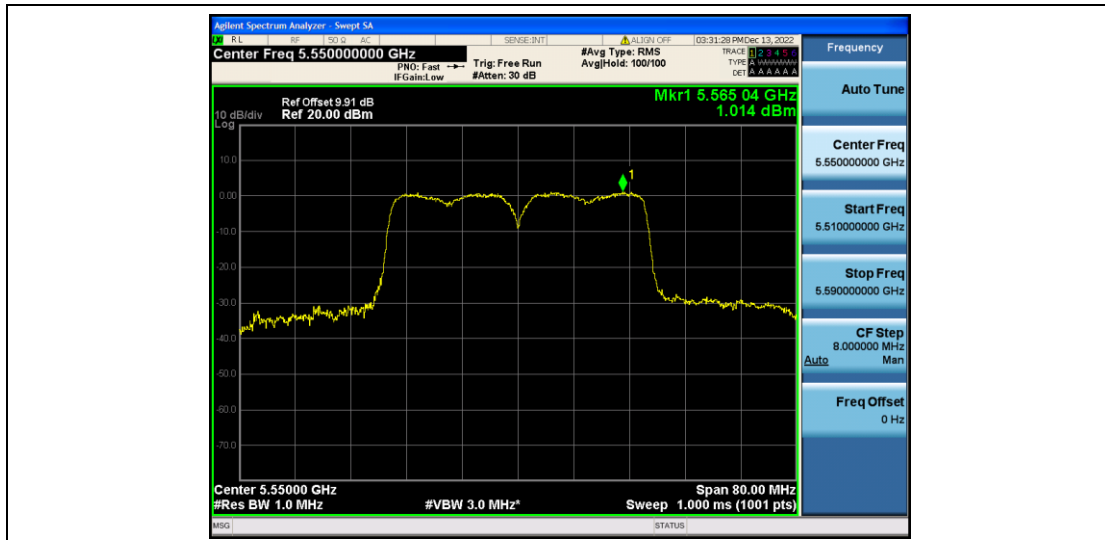

11AC40SISO_Ant1_5670

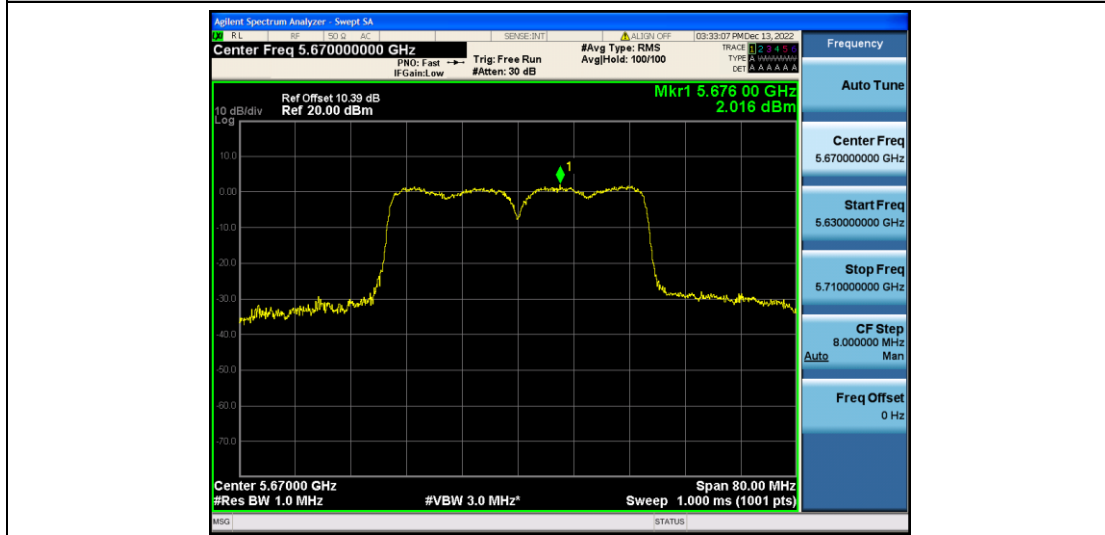


11AC40SISO_Ant1_5755




Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: GN.Doncheck@sgs.com

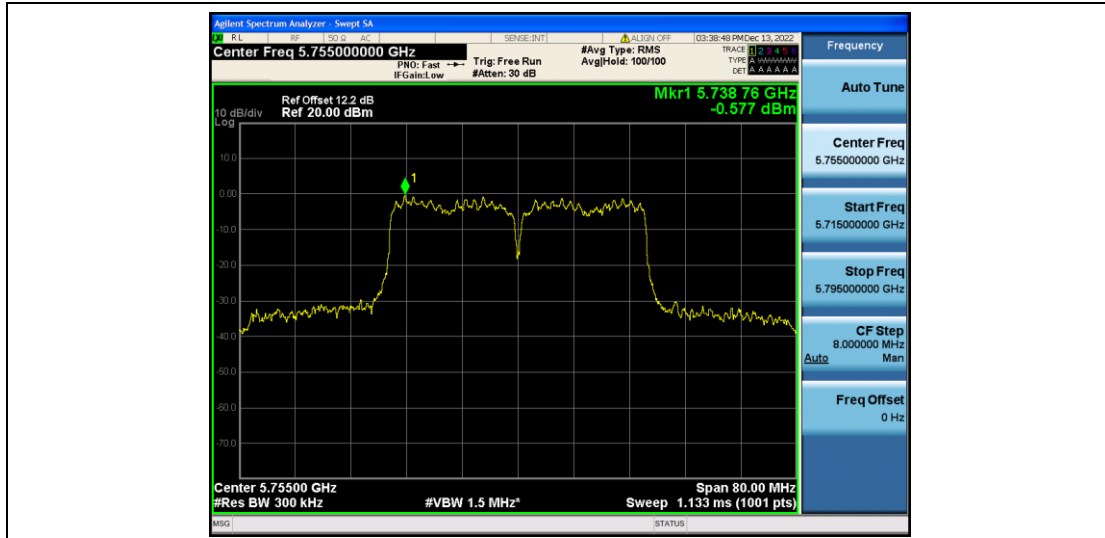

11AC40SISO_Ant1_5795

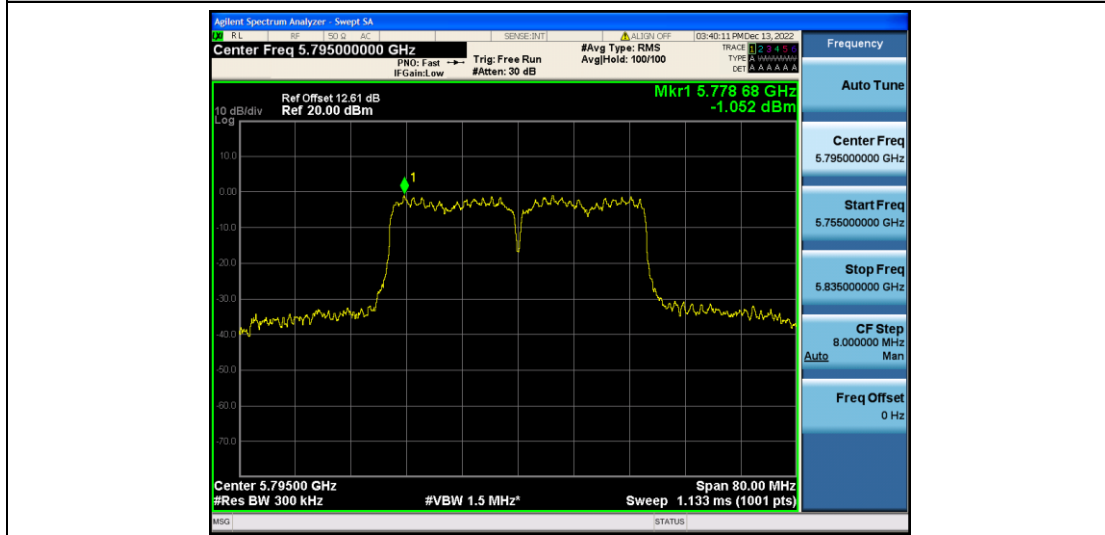


11AC80SISO_Ant1_5210




Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: GN.Doncheck@sgs.com

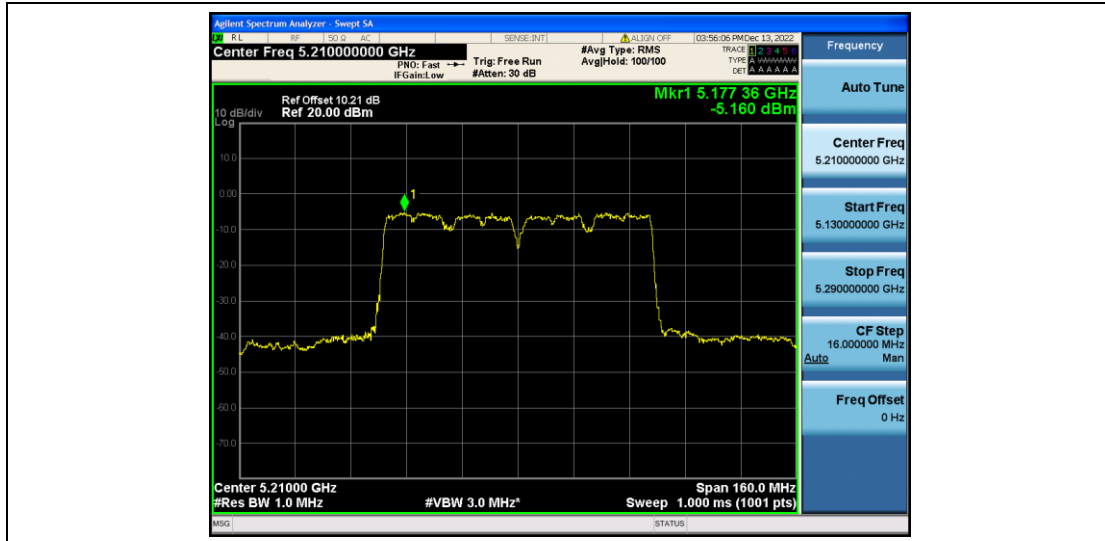

11AC80SISO_Ant1_5290

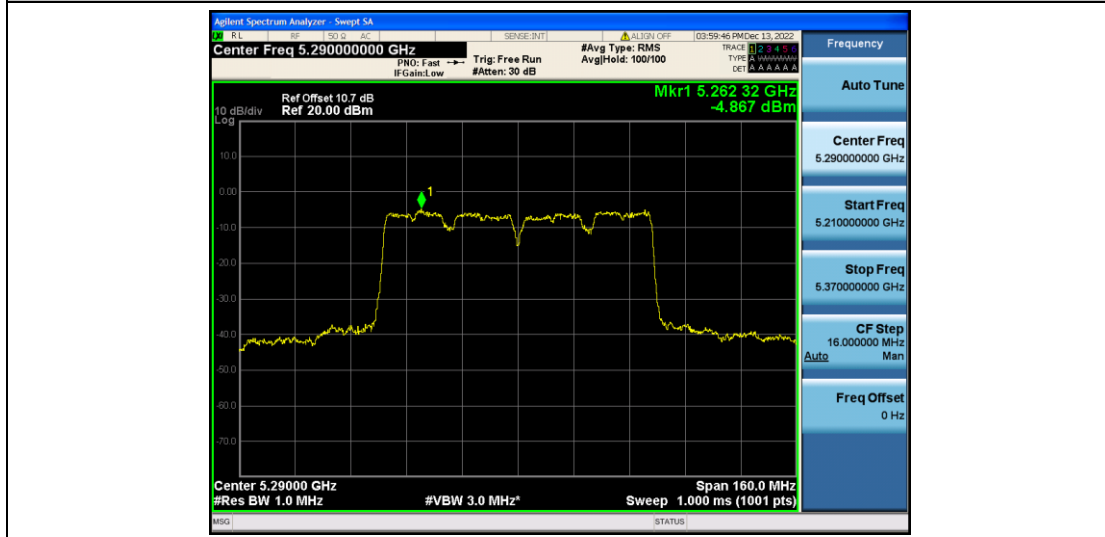

11AC80SISO_Ant1_5530




Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.


Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Docscheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612 t (86-21) 61915666 f (86-21) 61915678 www.sgs.com.cn
中国·上海·松江区金都西路588号 邮编: 201612 t (86-21) 61915666 f (86-21) 61915678 sgs.china@sgs.com

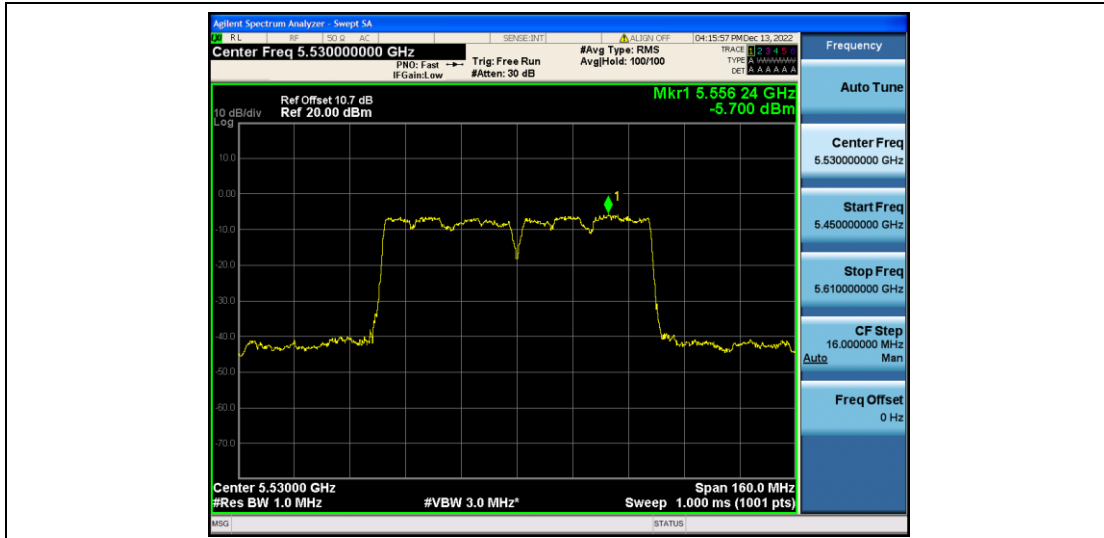


11AC80SISO_Ant1_5610

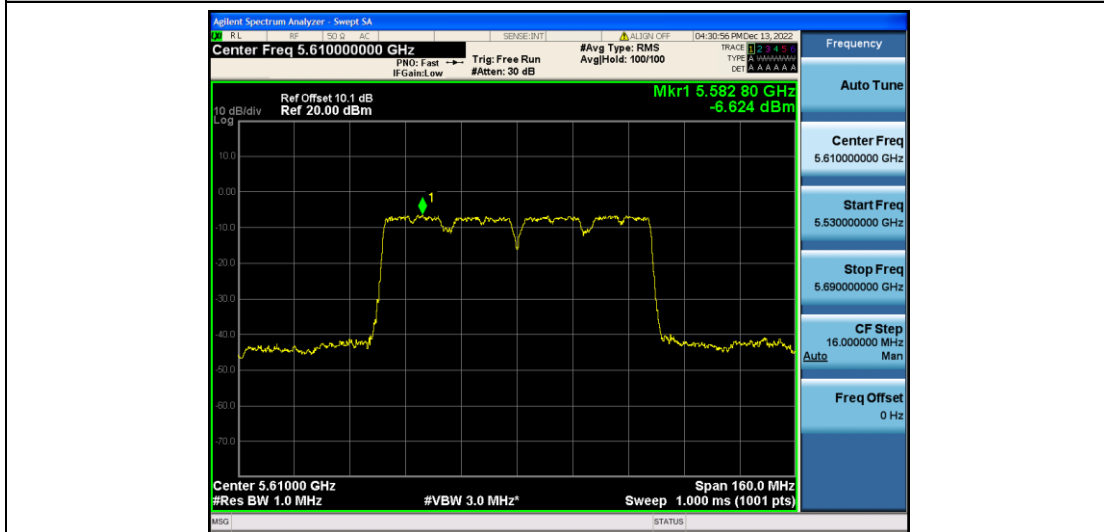

11AC80SISO_Ant1_5775



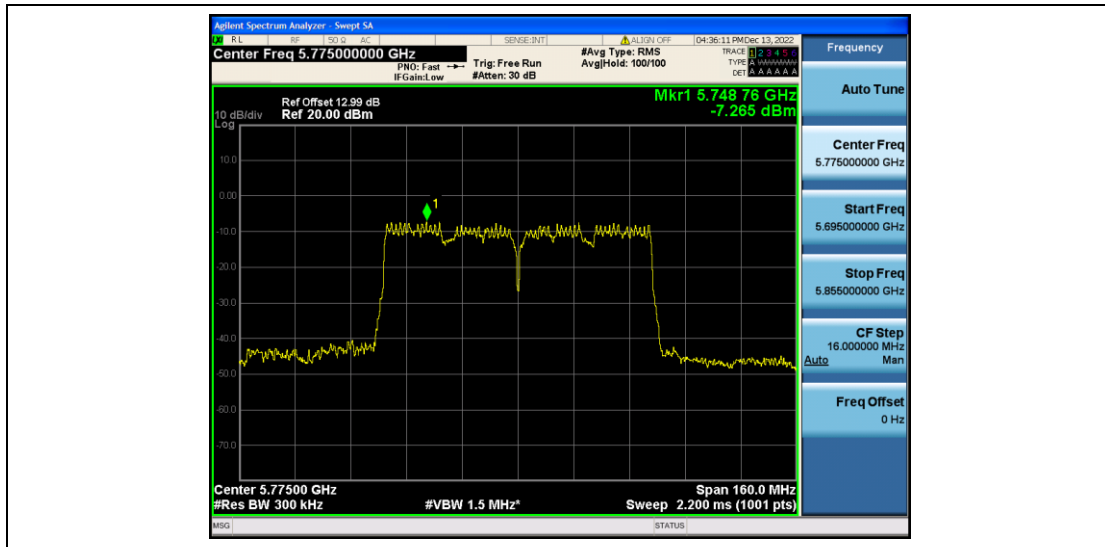

Appendix G: Frequency Stability

Test Result

TestMod e	Antenn a	Channe l	Voltage					Limit (ppm)	Verdict
			Voltage [Vdc]	Temper ature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)		
11A	Ant1	5180	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5220	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5240	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	-20000.00	-3.816794	±20	PASS	
		5260	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5300	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5320	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	-20000.00	-3.759398	±20	PASS	
			HV	NT	-20000.00	-3.759398	±20	PASS	
		5500	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5580	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	-20000.00	-3.584229	±20	PASS	
			HV	NT	-20000.00	-3.584229	±20	PASS	
		5700	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5745	NV	NT	-20000.00	-3.481288	±20	PASS	
			LV	NT	-20000.00	-3.481288	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	
		5785	NV	NT	0.00	0.000000	±20	PASS	
			LV	NT	0.00	0.000000	±20	PASS	
			HV	NT	0.00	0.000000	±20	PASS	



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co. Ltd.
EEC EMC Lab

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612
中国·上海·松江区金都西路588号 邮编: 201612

t (86-21) 61915666 f (86-21) 61915678 www.sgs.com.cn
t (86-21) 61915666 f (86-21) 61915678 sgs.china@sgs.com

		5825	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
11N20SI SO	Ant1	5180	NV	NT	-20000.00	-3.861004	±20	PASS
			LV	NT	20000.00	3.861004	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5220	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5240	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5260	NV	NT	-20000.00	-3.802281	±20	PASS
			LV	NT	-20000.00	-3.802281	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5300	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5320	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5500	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5580	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5700	NV	NT	-20000.00	-3.508772	±20	PASS
			LV	NT	-20000.00	-3.508772	±20	PASS
			HV	NT	-20000.00	-3.508772	±20	PASS
		5745	NV	NT	-20000.00	-3.481288	±20	PASS
			LV	NT	-20000.00	-3.481288	±20	PASS
			HV	NT	-20000.00	-3.481288	±20	PASS
		5785	NV	NT	-20000.00	-3.457217	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	-20000.00	-3.457217	±20	PASS
		5825	NV	NT	-20000.00	-3.433476	±20	PASS
			LV	NT	-20000.00	-3.433476	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

11N40SI SO	Ant1	5190	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5230	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5270	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5310	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5510	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5550	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5670	NV	NT	-40000.00	-7.054674	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5755	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
5795	NV	NT	0.00	0.000000	±20	PASS		
	LV	NT	0.00	0.000000	±20	PASS		
	HV	NT	0.00	0.000000	±20	PASS		
11AC20S ISO	Ant1	5180	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	-40000.00	-7.722008	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5220	NV	NT	-20000.00	-3.831418	±20	PASS
			LV	NT	-20000.00	-3.831418	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5240	NV	NT	-20000.00	-3.816794	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5260	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	-20000.00	-3.802281	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612
中国·上海·松江区金都西路588号 邮编: 201612

t (86-21) 61915666
t (86-21) 61915666

f (86-21) 61915678
f (86-21) 61915678

www.sgs.com.cn
sgs.china@sgs.com

		5300	NV	NT	-20000.00	-3.773585	±20	PASS		
			LV	NT	0.00	0.000000	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		5320	NV	NT	0.00	0.000000	±20	PASS		
			LV	NT	0.00	0.000000	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		5500	NV	NT	-20000.00	-3.636364	±20	PASS		
			LV	NT	0.00	0.000000	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		5580	NV	NT	-20000.00	-3.584229	±20	PASS		
			LV	NT	-20000.00	-3.584229	±20	PASS		
			HV	NT	-20000.00	-3.584229	±20	PASS		
		5700	NV	NT	0.00	0.000000	±20	PASS		
			LV	NT	0.00	0.000000	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		5745	NV	NT	-40000.00	-6.962576	±20	PASS		
			LV	NT	-20000.00	-3.481288	±20	PASS		
			HV	NT	-20000.00	-3.481288	±20	PASS		
		5785	NV	NT	0.00	0.000000	±20	PASS		
			LV	NT	0.00	0.000000	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		5825	NV	NT	0.00	0.000000	±20	PASS		
			LV	NT	-20000.00	-3.433476	±20	PASS		
			HV	NT	0.00	0.000000	±20	PASS		
		11AC40S ISO	Ant1	5190	NV	NT	0.00	0.000000	±20	PASS
					LV	NT	-40000.00	-7.707129	±20	PASS
					HV	NT	0.00	0.000000	±20	PASS
				5230	NV	NT	0.00	0.000000	±20	PASS
					LV	NT	0.00	0.000000	±20	PASS
					HV	NT	0.00	0.000000	±20	PASS
5270	NV			NT	0.00	0.000000	±20	PASS		
	LV			NT	0.00	0.000000	±20	PASS		
	HV			NT	0.00	0.000000	±20	PASS		
5310	NV			NT	0.00	0.000000	±20	PASS		
	LV			NT	0.00	0.000000	±20	PASS		
	HV			NT	0.00	0.000000	±20	PASS		
5510	NV			NT	0.00	0.000000	±20	PASS		
	LV			NT	0.00	0.000000	±20	PASS		
	HV			NT	-40000.00	-7.259528	±20	PASS		



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612
中国·上海·松江区金都西路588号 邮编: 201612

t (86-21) 61915666
t (86-21) 61915666

f (86-21) 61915678
f (86-21) 61915678

www.sgs.com.cn
sgs.china@sgs.com

		5550	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5670	NV	NT	-40000.00	-7.054674	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	-40000.00	-7.054674	±20	PASS
		5755	NV	NT	-40000.00	-6.950478	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5795	NV	NT	-40000.00	-6.902502	±20	PASS
			LV	NT	-40000.00	-6.902502	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
11AC80S ISO	Ant1	5210	NV	NT	-80000.00	-15.355086	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5290	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	-80000.00	-15.122873	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5530	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
		5610	NV	NT	0.00	0.000000	±20	PASS
			LV	NT	0.00	0.000000	±20	PASS
			HV	NT	0.00	0.000000	±20	PASS
5775	NV	NT	0.00	0.000000	±20	PASS		
	LV	NT	0.00	0.000000	±20	PASS		
	HV	NT	0.00	0.000000	±20	PASS		

Temperature								
TestMode	Antenna	Channel	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant1	5180	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

		5220	NV	50	-20000.00	-3.861004	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	-20000.00	-3.831418	±20	PASS
		5240	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5260	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	-20000.00	-3.802281	±20	PASS
			NV	10	-20000.00	-3.802281	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5300	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	-20000.00	-3.773585	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5320	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5500	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
		5580	NV	50	-20000.00	-3.636364	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
		5700	NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
			NV	-30	20000.00	3.508772	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	-20000.00	-3.508772	±20	PASS
		5745	NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Docscheck@sgs.com

			NV	20	-20000.00	-3.481288	±20	PASS		
			NV	30	0.00	0.000000	±20	PASS		
			NV	40	0.00	0.000000	±20	PASS		
			NV	50	0.00	0.000000	±20	PASS		
		5785	NV	-30	0.00	0.000000	±20	PASS		
			NV	-20	0.00	0.000000	±20	PASS		
			NV	-10	0.00	0.000000	±20	PASS		
			NV	0	0.00	0.000000	±20	PASS		
			NV	10	0.00	0.000000	±20	PASS		
			NV	20	0.00	0.000000	±20	PASS		
			NV	30	0.00	0.000000	±20	PASS		
			NV	40	0.00	0.000000	±20	PASS		
			NV	50	0.00	0.000000	±20	PASS		
			5825	NV	-30	0.00	0.000000	±20	PASS	
				NV	-20	0.00	0.000000	±20	PASS	
				NV	-10	0.00	0.000000	±20	PASS	
		NV		0	-20000.00	-3.433476	±20	PASS		
		NV		10	-20000.00	-3.433476	±20	PASS		
		NV		20	-20000.00	-3.433476	±20	PASS		
		NV		30	0.00	0.000000	±20	PASS		
		NV		40	0.00	0.000000	±20	PASS		
		NV		50	0.00	0.000000	±20	PASS		
		11N20SI SO		Ant1	5180	NV	-30	0.00	0.000000	±20
			NV			-20	-20000.00	-3.861004	±20	PASS
			NV			-10	0.00	0.000000	±20	PASS
			NV			0	0.00	0.000000	±20	PASS
			NV			10	0.00	0.000000	±20	PASS
			NV			20	-20000.00	-3.861004	±20	PASS
			NV			30	0.00	0.000000	±20	PASS
			NV			40	-20000.00	-3.861004	±20	PASS
			NV			50	-20000.00	-3.861004	±20	PASS
			5220		NV	-30	20000.00	3.831418	±20	PASS
					NV	-20	-20000.00	-3.831418	±20	PASS
					NV	-10	-20000.00	-3.831418	±20	PASS
					NV	0	-20000.00	-3.831418	±20	PASS
					NV	10	0.00	0.000000	±20	PASS
NV	20				-20000.00	-3.831418	±20	PASS		
NV	30				-20000.00	-3.831418	±20	PASS		
NV	40				0.00	0.000000	±20	PASS		



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

		5240	NV	50	0.00	0.000000	±20	PASS
			NV	-30	-20000.00	-3.816794	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	-20000.00	-3.816794	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	-20000.00	-3.816794	±20	PASS
		5260	NV	-30	-20000.00	-3.802281	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	-20000.00	-3.802281	±20	PASS
			NV	10	-20000.00	-3.802281	±20	PASS
			NV	20	-20000.00	-3.802281	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	-20000.00	-3.802281	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5300	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
		5320	NV	50	-20000.00	-3.773585	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	20000.00	3.759398	±20	PASS
			NV	-10	-20000.00	-3.759398	±20	PASS
			NV	0	-20000.00	-3.759398	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	-20000.00	-3.759398	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
		5500	NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	-20000.00	-3.636364	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5580	NV	-30	-20000.00	-3.584229	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	-20000.00	-3.584229	±20	PASS
			NV	0	-20000.00	-3.584229	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	-20000.00	-3.584229	±20	PASS
			NV	30	-20000.00	-3.584229	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5700	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	-20000.00	-3.508772	±20	PASS
			NV	-10	-20000.00	-3.508772	±20	PASS
			NV	0	-20000.00	-3.508772	±20	PASS
			NV	10	-20000.00	-3.508772	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	-20000.00	-3.508772	±20	PASS
			NV	50	-40000.00	-7.017544	±20	PASS
		5745	NV	-30	-20000.00	-3.481288	±20	PASS
			NV	-20	-20000.00	-3.481288	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	-20000.00	-3.481288	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	-40000.00	-6.962576	±20	PASS
			NV	50	-20000.00	-3.481288	±20	PASS
		5785	NV	-30	-20000.00	-3.457217	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	-20000.00	-3.457217	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	20	-20000.00	-3.457217	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	-20000.00	-3.457217	±20	PASS
		5825	NV	-30	-20000.00	-3.433476	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	-20000.00	-3.433476	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	-20000.00	-3.433476	±20	PASS
			NV	20	-20000.00	-3.433476	±20	PASS
			NV	30	-20000.00	-3.433476	±20	PASS
			NV	40	-20000.00	-3.433476	±20	PASS
			NV	50	-20000.00	-3.433476	±20	PASS
			11N40SI SO	Ant1	5190	NV	-30	-40000.00
NV	-20	0.00				0.000000	±20	PASS
NV	-10	0.00				0.000000	±20	PASS
NV	0	0.00				0.000000	±20	PASS
NV	10	-40000.00				-7.707129	±20	PASS
NV	20	0.00				0.000000	±20	PASS
NV	30	-40000.00				-7.707129	±20	PASS
NV	40	0.00				0.000000	±20	PASS
5230	NV	50			0.00	0.000000	±20	PASS
	NV	-30			0.00	0.000000	±20	PASS
	NV	-20			0.00	0.000000	±20	PASS
	NV	-10			0.00	0.000000	±20	PASS
	NV	0			0.00	0.000000	±20	PASS
	NV	10			0.00	0.000000	±20	PASS
	NV	20			-40000.00	-7.648184	±20	PASS
	NV	30			-40000.00	-7.648184	±20	PASS
5270	NV	40			0.00	0.000000	±20	PASS
	NV	50			0.00	0.000000	±20	PASS
	NV	-30			0.00	0.000000	±20	PASS
	NV	-20			0.00	0.000000	±20	PASS
	NV	-10			0.00	0.000000	±20	PASS
	NV	0			0.00	0.000000	±20	PASS
	NV	10			0.00	0.000000	±20	PASS
	NV	20			0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab

NO.588 West Jindu Road, Songjiang District, Shanghai China 201612
中国·上海·松江区金都西路588号 邮编: 201612

t (86-21) 61915666
t (86-21) 61915666

f (86-21) 61915678
f (86-21) 61915678

www.sgs.com
sgs.china@sgs.com

		5310	NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5510	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	-40000.00	-7.259528	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
		5550	NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
		5670	NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
		5755	NV	30	-40000.00	-7.054674	±20	PASS
			NV	40	-40000.00	-7.054674	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	-10	0.00	0.000000	±20	PASS			
			NV	0	0.00	0.000000	±20	PASS			
			NV	10	0.00	0.000000	±20	PASS			
			NV	20	0.00	0.000000	±20	PASS			
			NV	30	-40000.00	-6.950478	±20	PASS			
			NV	40	0.00	0.000000	±20	PASS			
			NV	50	0.00	0.000000	±20	PASS			
		5795	NV	-30	0.00	0.000000	±20	PASS			
			NV	-20	0.00	0.000000	±20	PASS			
			NV	-10	0.00	0.000000	±20	PASS			
			NV	0	0.00	0.000000	±20	PASS			
			NV	10	0.00	0.000000	±20	PASS			
			NV	20	0.00	0.000000	±20	PASS			
			NV	30	0.00	0.000000	±20	PASS			
			NV	40	0.00	0.000000	±20	PASS			
			NV	50	0.00	0.000000	±20	PASS			
			11AC20S ISO	Ant1	5180	NV	-30	0.00	0.000000	±20	PASS
						NV	-20	-20000.00	-3.861004	±20	PASS
NV	-10	0.00				0.000000	±20	PASS			
NV	0	-20000.00				-3.861004	±20	PASS			
NV	10	-20000.00				-3.861004	±20	PASS			
NV	20	0.00				0.000000	±20	PASS			
NV	30	0.00				0.000000	±20	PASS			
NV	40	-20000.00				-3.861004	±20	PASS			
NV	50	0.00				0.000000	±20	PASS			
5220	NV	-30			0.00	0.000000	±20	PASS			
	NV	-20			-40000.00	-7.662835	±20	PASS			
	NV	-10			0.00	0.000000	±20	PASS			
	NV	0			-40000.00	-7.662835	±20	PASS			
	NV	10			0.00	0.000000	±20	PASS			
	NV	20			0.00	0.000000	±20	PASS			
	NV	30			-40000.00	-7.662835	±20	PASS			
	NV	40			-20000.00	-3.831418	±20	PASS			
	NV	50			0.00	0.000000	±20	PASS			
5240	NV	-30			-20000.00	-3.816794	±20	PASS			
	NV	-20			0.00	0.000000	±20	PASS			
	NV	-10			0.00	0.000000	±20	PASS			
	NV	0			-20000.00	-3.816794	±20	PASS			
	NV	10			-20000.00	-3.816794	±20	PASS			
	NV	20			0.00	0.000000	±20	PASS			



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Docscheck@sgs.com

			NV	20	-20000.00	-3.816794	±20	PASS			
			NV	30	0.00	0.000000	±20	PASS			
			NV	40	-20000.00	-3.816794	±20	PASS			
			NV	50	0.00	0.000000	±20	PASS			
5260			NV	-30	-40000.00	-7.604563	±20	PASS			
			NV	-20	0.00	0.000000	±20	PASS			
			NV	-10	0.00	0.000000	±20	PASS			
			NV	0	-20000.00	-3.802281	±20	PASS			
			NV	10	0.00	0.000000	±20	PASS			
			NV	20	0.00	0.000000	±20	PASS			
			NV	30	0.00	0.000000	±20	PASS			
			NV	40	-20000.00	-3.802281	±20	PASS			
			NV	50	0.00	0.000000	±20	PASS			
			5300			NV	-30	-20000.00	-3.773585	±20	PASS
						NV	-20	-20000.00	-3.773585	±20	PASS
						NV	-10	-20000.00	-3.773585	±20	PASS
NV	0	0.00				0.000000	±20	PASS			
NV	10	-20000.00				-3.773585	±20	PASS			
NV	20	-20000.00				-3.773585	±20	PASS			
NV	30	0.00				0.000000	±20	PASS			
NV	40	0.00				0.000000	±20	PASS			
NV	50	0.00				0.000000	±20	PASS			
5320						NV	-30	-20000.00	-3.759398	±20	PASS
			NV	-20	-20000.00	-3.759398	±20	PASS			
			NV	-10	-20000.00	-3.759398	±20	PASS			
			NV	0	0.00	0.000000	±20	PASS			
			NV	10	0.00	0.000000	±20	PASS			
			NV	20	20000.00	3.759398	±20	PASS			
			NV	30	0.00	0.000000	±20	PASS			
			NV	40	0.00	0.000000	±20	PASS			
			NV	50	0.00	0.000000	±20	PASS			
			5500			NV	-30	-20000.00	-3.636364	±20	PASS
NV	-20	0.00				0.000000	±20	PASS			
NV	-10	-20000.00				-3.636364	±20	PASS			
NV	0	-20000.00				-3.636364	±20	PASS			
NV	10	0.00				0.000000	±20	PASS			
NV	20	0.00				0.000000	±20	PASS			
NV	30	-20000.00				-3.636364	±20	PASS			
NV	40	0.00				0.000000	±20	PASS			



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

5580	NV	50	-20000.00	-3.636364	±20	PASS
	NV	-30	0.00	0.000000	±20	PASS
	NV	-20	0.00	0.000000	±20	PASS
	NV	-10	-20000.00	-3.584229	±20	PASS
	NV	0	0.00	0.000000	±20	PASS
	NV	10	-40000.00	-7.168459	±20	PASS
	NV	20	0.00	0.000000	±20	PASS
	NV	30	0.00	0.000000	±20	PASS
	NV	40	0.00	0.000000	±20	PASS
	NV	50	0.00	0.000000	±20	PASS
5700	NV	-30	0.00	0.000000	±20	PASS
	NV	-20	-20000.00	-3.508772	±20	PASS
	NV	-10	-20000.00	-3.508772	±20	PASS
	NV	0	-20000.00	-3.508772	±20	PASS
	NV	10	-20000.00	-3.508772	±20	PASS
	NV	20	-20000.00	-3.508772	±20	PASS
	NV	30	-20000.00	-3.508772	±20	PASS
	NV	40	0.00	0.000000	±20	PASS
	NV	50	-20000.00	-3.508772	±20	PASS
5745	NV	-30	-20000.00	-3.481288	±20	PASS
	NV	-20	-20000.00	-3.481288	±20	PASS
	NV	-10	-20000.00	-3.481288	±20	PASS
	NV	0	-40000.00	-6.962576	±20	PASS
	NV	10	-20000.00	-3.481288	±20	PASS
	NV	20	-40000.00	-6.962576	±20	PASS
	NV	30	0.00	0.000000	±20	PASS
	NV	40	-20000.00	-3.481288	±20	PASS
	NV	50	0.00	0.000000	±20	PASS
5785	NV	-30	0.00	0.000000	±20	PASS
	NV	-20	-40000.00	-6.914434	±20	PASS
	NV	-10	0.00	0.000000	±20	PASS
	NV	0	-20000.00	-3.457217	±20	PASS
	NV	10	0.00	0.000000	±20	PASS
	NV	20	-20000.00	-3.457217	±20	PASS
	NV	30	0.00	0.000000	±20	PASS
	NV	40	0.00	0.000000	±20	PASS
	NV	50	-20000.00	-3.457217	±20	PASS
5825	NV	-30	0.00	0.000000	±20	PASS
	NV	-20	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	-10	-20000.00	-3.433476	±20	PASS
			NV	0	-20000.00	-3.433476	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	-20000.00	-3.433476	±20	PASS
			NV	30	-20000.00	-3.433476	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
11AC40S ISO	Ant1	5190	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	-40000.00	-7.707129	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	-40000.00	-7.707129	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5230	NV	-30	-40000.00	-7.648184	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	-40000.00	-7.648184	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5270	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	-40000.00	-7.590133	±20	PASS
			NV	40	-40000.00	-7.590133	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5310	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	-40000.00	-7.532957	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Docscheck@sgs.com

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.
EEC EMC Lab

NO. 588 West Jindu Road, Songjiang District, Shanghai China 201612
中国·上海·松江区金都西路588号 邮编: 201612

t (86-21) 61915666 f (86-21) 61915678 www.sgs.com.cn
t (86-21) 61915666 f (86-21) 61915678 sgs.china@sgs.com

		NV	20	-40000.00	-7.532957	±20	PASS	
		NV	30	0.00	0.000000	±20	PASS	
		NV	40	-40000.00	-7.532957	±20	PASS	
		NV	50	0.00	0.000000	±20	PASS	
	5510	NV	-30	-40000.00	-7.259528	±20	PASS	
		NV	-20	0.00	0.000000	±20	PASS	
		NV	-10	0.00	0.000000	±20	PASS	
		NV	0	0.00	0.000000	±20	PASS	
		NV	10	-40000.00	-7.259528	±20	PASS	
		NV	20	0.00	0.000000	±20	PASS	
		NV	30	0.00	0.000000	±20	PASS	
		NV	40	0.00	0.000000	±20	PASS	
		NV	50	0.00	0.000000	±20	PASS	
		5550	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
	NV		0	-40000.00	-7.207207	±20	PASS	
	NV		10	-40000.00	-7.207207	±20	PASS	
	NV		20	0.00	0.000000	±20	PASS	
	NV		30	-40000.00	-7.207207	±20	PASS	
	NV		40	0.00	0.000000	±20	PASS	
	NV		50	0.00	0.000000	±20	PASS	
	5670		NV	-30	0.00	0.000000	±20	PASS
		NV	-20	0.00	0.000000	±20	PASS	
		NV	-10	0.00	0.000000	±20	PASS	
		NV	0	0.00	0.000000	±20	PASS	
		NV	10	-40000.00	-7.054674	±20	PASS	
		NV	20	0.00	0.000000	±20	PASS	
		NV	30	0.00	0.000000	±20	PASS	
		NV	40	0.00	0.000000	±20	PASS	
		NV	50	0.00	0.000000	±20	PASS	
		5755	NV	-30	-40000.00	-6.950478	±20	PASS
	NV		-20	0.00	0.000000	±20	PASS	
	NV		-10	0.00	0.000000	±20	PASS	
	NV		0	0.00	0.000000	±20	PASS	
	NV		10	-40000.00	-6.950478	±20	PASS	
	NV		20	0.00	0.000000	±20	PASS	
	NV		30	0.00	0.000000	±20	PASS	
	NV		40	-40000.00	-6.950478	±20	PASS	



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

		5795	NV	50	-40000.00	-6.950478	±20	PASS
			NV	-30	0.00	0.000000	±20	PASS
			NV	-20	-40000.00	-6.902502	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	-40000.00	-6.902502	±20	PASS
11AC80S ISO	Ant1	5210	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5290	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5530	NV	-30	0.00	0.000000	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS
			NV	-10	80000.00	14.466546	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
		5610	NV	-30	-80000.00	-14.260250	±20	PASS
			NV	-20	0.00	0.000000	±20	PASS



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

			NV	-10	0.00	0.000000	±20	PASS
			NV	0	0.00	0.000000	±20	PASS
			NV	10	0.00	0.000000	±20	PASS
			NV	20	0.00	0.000000	±20	PASS
			NV	30	0.00	0.000000	±20	PASS
			NV	40	0.00	0.000000	±20	PASS
			NV	50	0.00	0.000000	±20	PASS
			5775	NV	-30	0.00	0.000000	±20
		NV		-20	0.00	0.000000	±20	PASS
		NV		-10	0.00	0.000000	±20	PASS
		NV		0	0.00	0.000000	±20	PASS
		NV		10	0.00	0.000000	±20	PASS
		NV		20	-80000.00	-13.852814	±20	PASS
		NV		30	0.00	0.000000	±20	PASS
		NV		40	-80000.00	-13.852814	±20	PASS
		NV	50	0.00	0.000000	±20	PASS	



Appendix H: Duty Cycle

Test Result


TestMode	Antenna	Channel	Transmission Duration [ms]	Transmission Period [ms]	Duty Cycle [%]	Limit	Verdict
11A	Ant1	5180	0.17	0.19	89.47	---	---
		5220	0.17	0.19	89.47	---	---
		5240	0.17	0.19	89.47	---	---
		5260	0.18	0.20	90.00	---	---
		5300	0.18	0.20	90.00	---	---
		5320	0.17	0.19	89.47	---	---
		5500	0.17	0.19	89.47	---	---
		5580	0.18	0.19	94.74	---	---
		5700	0.18	0.19	94.74	---	---
		5745	0.18	0.19	94.74	---	---
		5785	0.18	0.20	90.00	---	---
		5825	0.18	0.21	85.71	---	---
11N20SISO	Ant1	5180	0.16	0.18	88.89	---	---
		5220	0.16	0.18	88.89	---	---
		5240	0.16	0.18	88.89	---	---
		5260	0.17	0.18	94.44	---	---
		5300	0.16	0.18	88.89	---	---
		5320	0.16	0.18	88.89	---	---
		5500	0.17	0.18	94.44	---	---
		5580	0.16	0.18	88.89	---	---
		5700	0.17	0.18	94.44	---	---
		5745	0.17	0.18	94.44	---	---
		5785	0.16	0.18	88.89	---	---
		5825	0.17	0.18	94.44	---	---
11N40SISO	Ant1	5190	0.09	0.11	81.82	---	---
		5230	0.09	0.11	81.82	---	---
		5270	0.10	0.11	90.91	---	---
		5310	0.09	0.11	81.82	---	---
		5510	0.10	0.12	83.33	---	---
		5550	0.10	0.11	90.91	---	---
		5670	0.10	0.12	83.33	---	---
		5755	0.10	0.12	83.33	---	---
		5795	0.10	0.12	83.33	---	---



11AC20SISO	Ant1	5180	0.15	0.17	88.24	---	---
		5220	0.15	0.16	93.75	---	---
		5240	0.15	0.16	93.75	---	---
		5260	0.14	0.16	87.50	---	---
		5300	0.14	0.16	87.50	---	---
		5320	0.15	0.17	88.24	---	---
		5500	0.14	0.16	87.50	---	---
		5580	0.15	0.16	93.75	---	---
		5700	0.14	0.16	87.50	---	---
		5745	0.15	0.17	88.24	---	---
		5785	0.15	0.17	88.24	---	---
		5825	0.15	0.16	93.75	---	---
11AC40SISO	Ant1	5190	0.09	0.11	81.82	---	---
		5230	0.09	0.11	81.82	---	---
		5270	0.09	0.10	90.00	---	---
		5310	0.09	0.11	81.82	---	---
		5510	0.09	0.11	81.82	---	---
		5550	0.09	0.10	90.00	---	---
		5670	0.09	0.11	81.82	---	---
		5755	0.09	0.10	90.00	---	---
		5795	0.09	0.11	81.82	---	---
11AC80SISO	Ant1	5210	0.06	0.08	75.00	---	---
		5290	0.06	0.08	75.00	---	---
		5530	0.06	0.08	75.00	---	---
		5610	0.07	0.08	87.50	---	---
		5775	0.06	0.08	75.00	---	---




Test Graphs

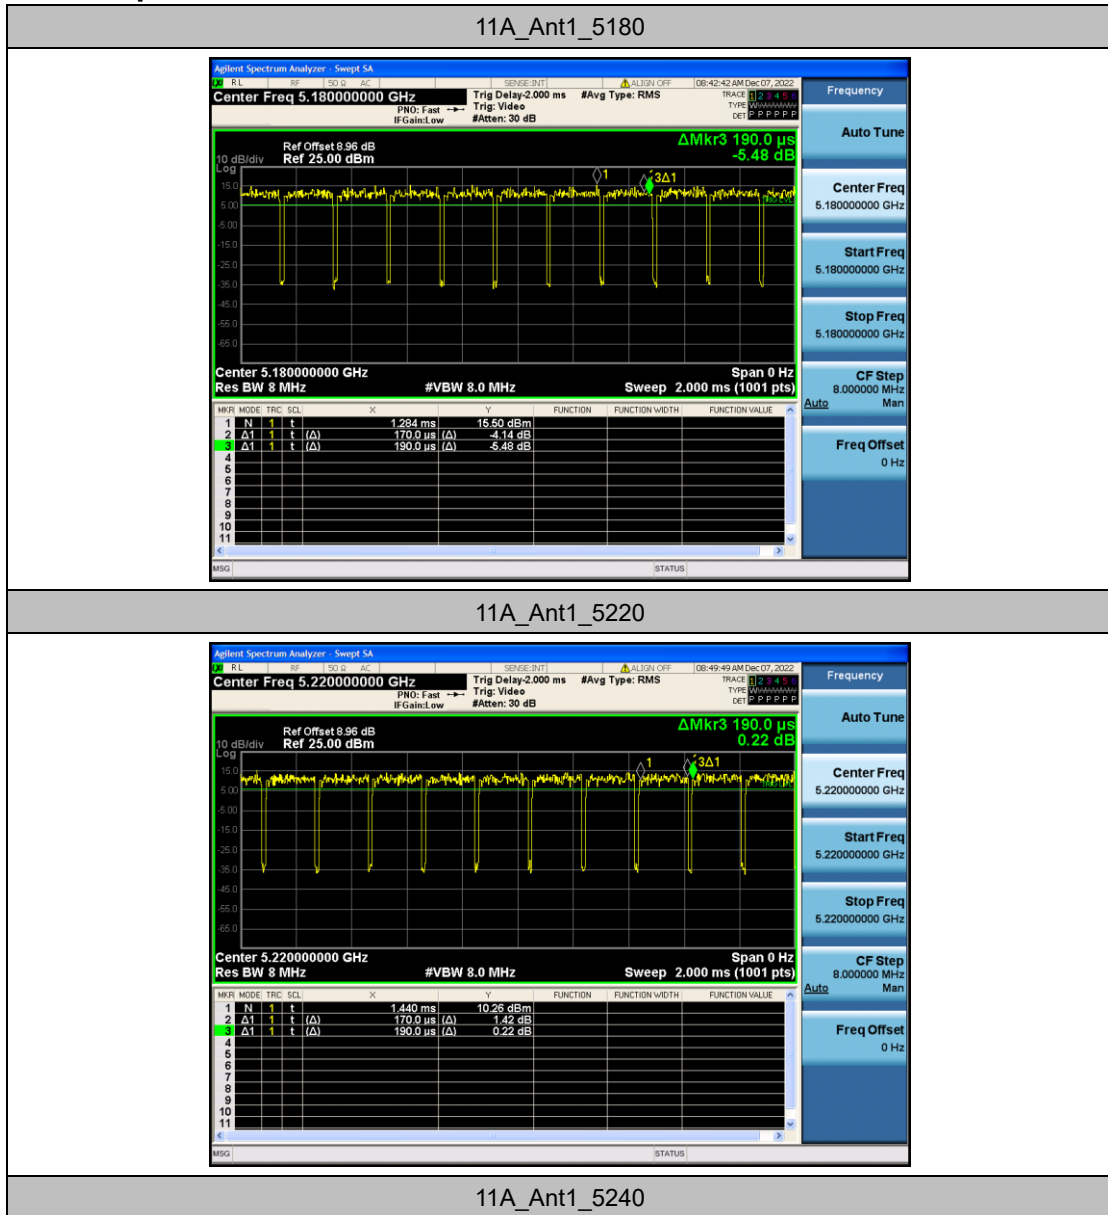


Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: GN.Doncheck@sgs.com

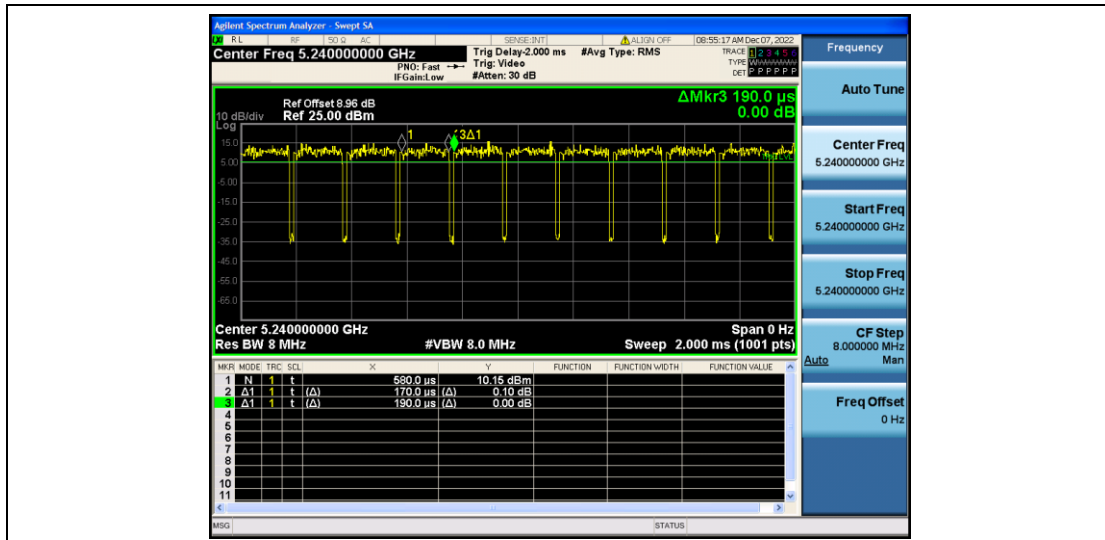


11A_Ant1_5260

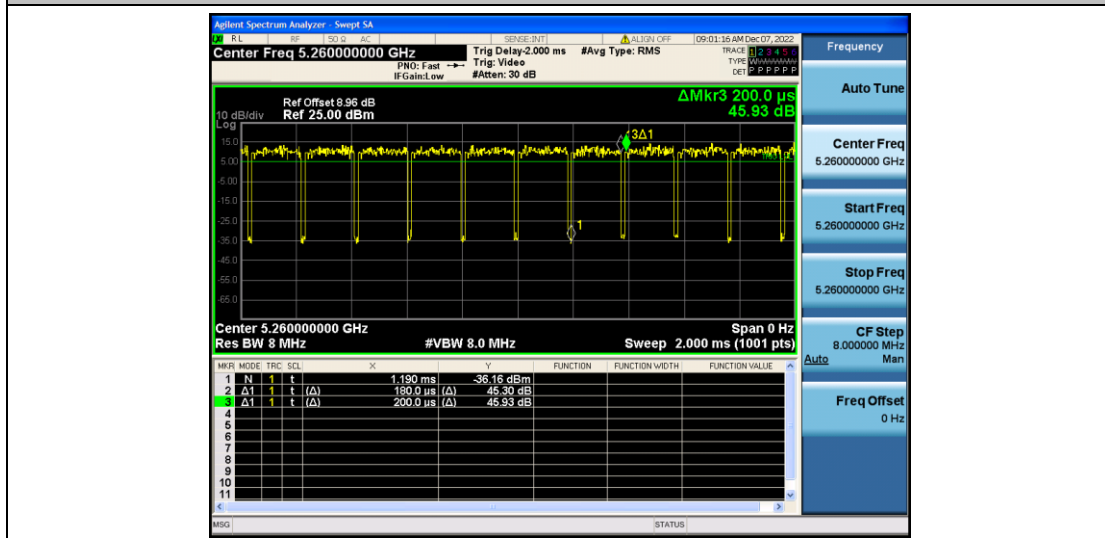


11A_Ant1_5300



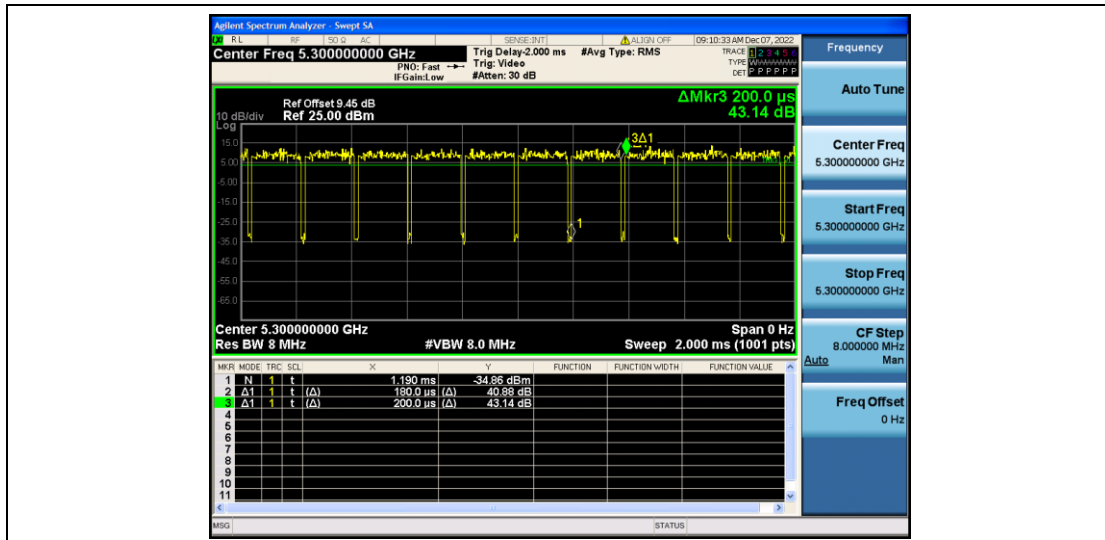


11A_Ant1_5320

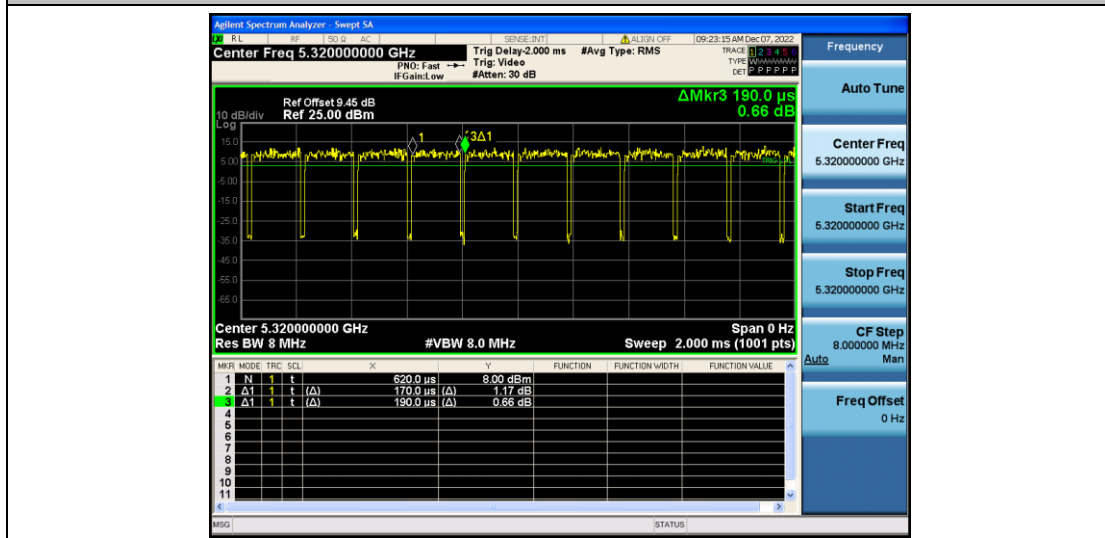


11A_Ant1_5500



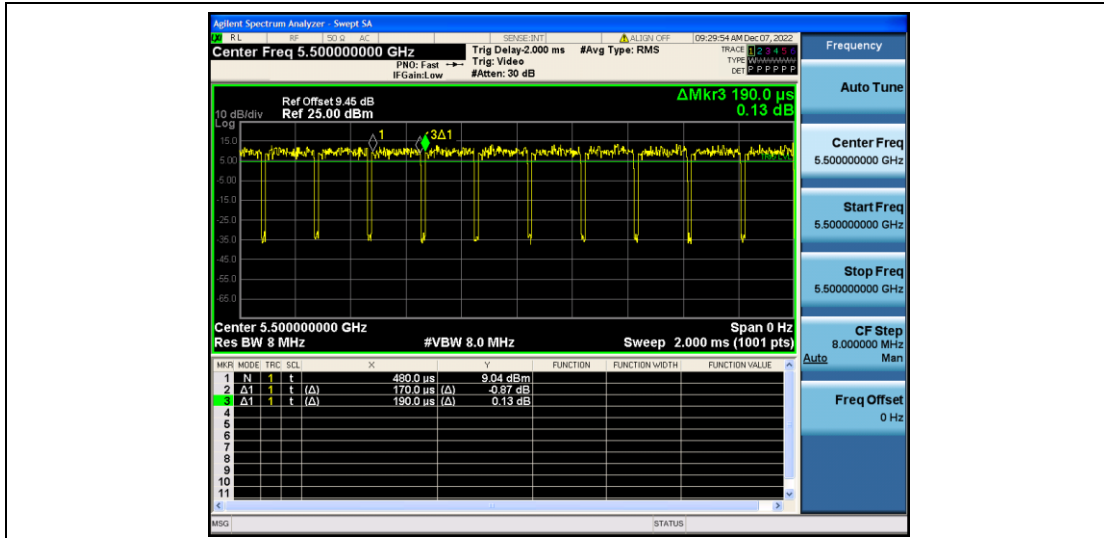

11A_Ant1_5580

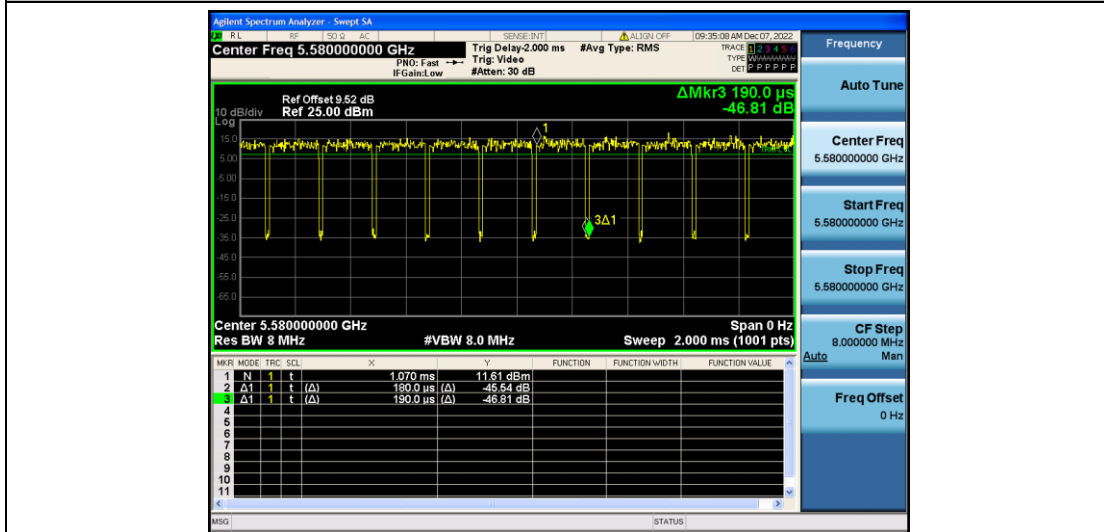


11A_Ant1_5700




Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com
 NO.588 West Jindu Road, Songjiang District, Shanghai China 201612 t (86-21) 61915666 f (86-21) 61915678 www.sgs.com.cn
 中国·上海·松江区金都西路588号 邮编: 201612 t (86-21) 61915666 f (86-21) 61915678 sgs.china@sgs.com

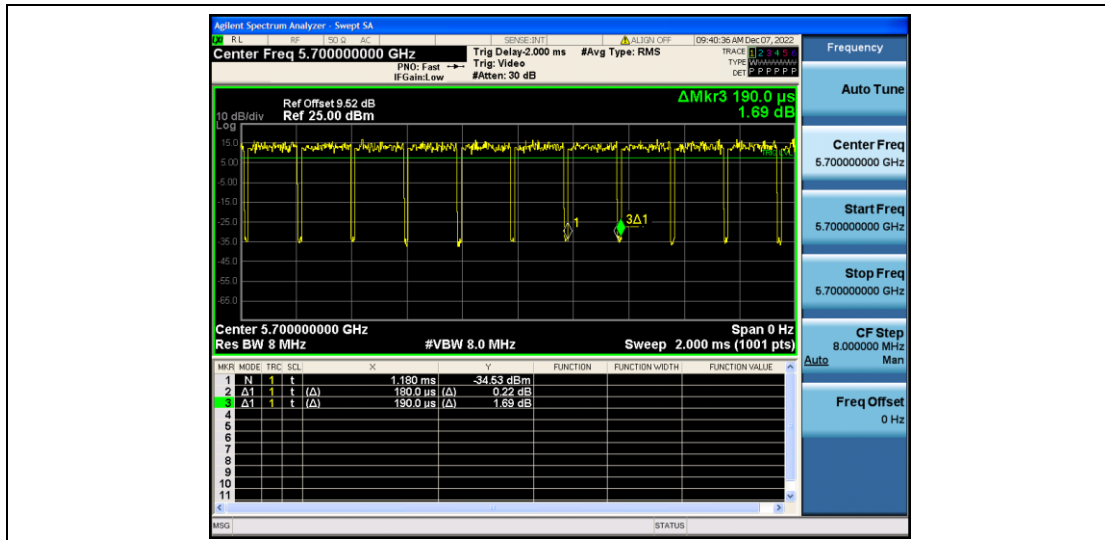

11A_Ant1_5745

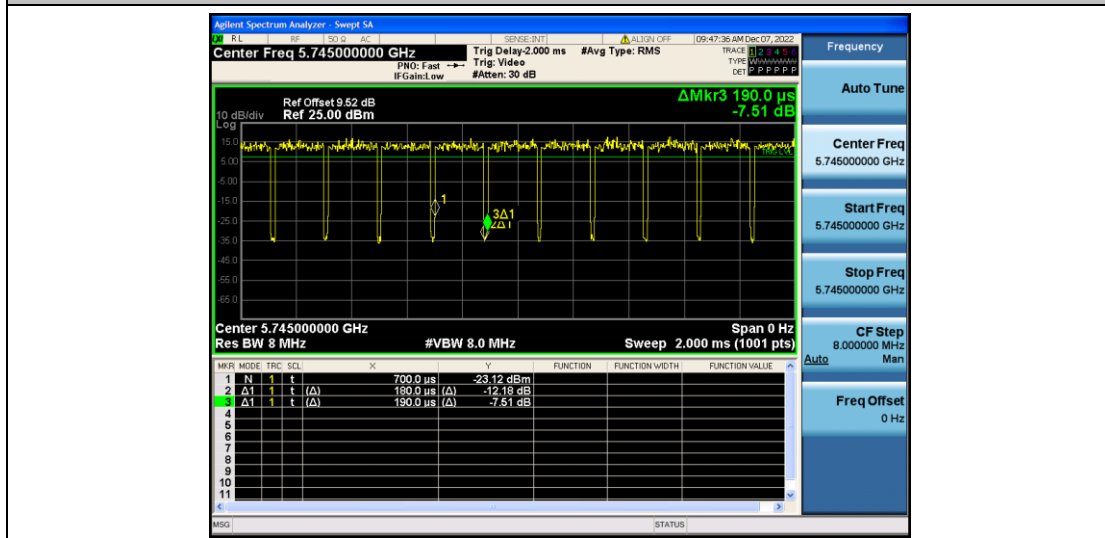

11A_Ant1_5785

