



HCT Co., Ltd.

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A:
Test Setup
Photo

FCC ID A3LSMA516V			
File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC021-P	HCT-RF-2006-FC026-P
	HCT-RF-2006-FC017-P	HCT-RF-2006-FC022-P	
	HCT-RF-2006-FC018-P	HCT-RF-2006-FC023-P	
	HCT-RF-2006-FC019-P	HCT-RF-2006-FC024-P	
	HCT-RF-2006-FC020-P	HCT-RF-2006-FC025-P	

REVISION HISTORY

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	June 18, 2020	Initial Release

File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				


1. Radiated Test Setup Photo



File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				

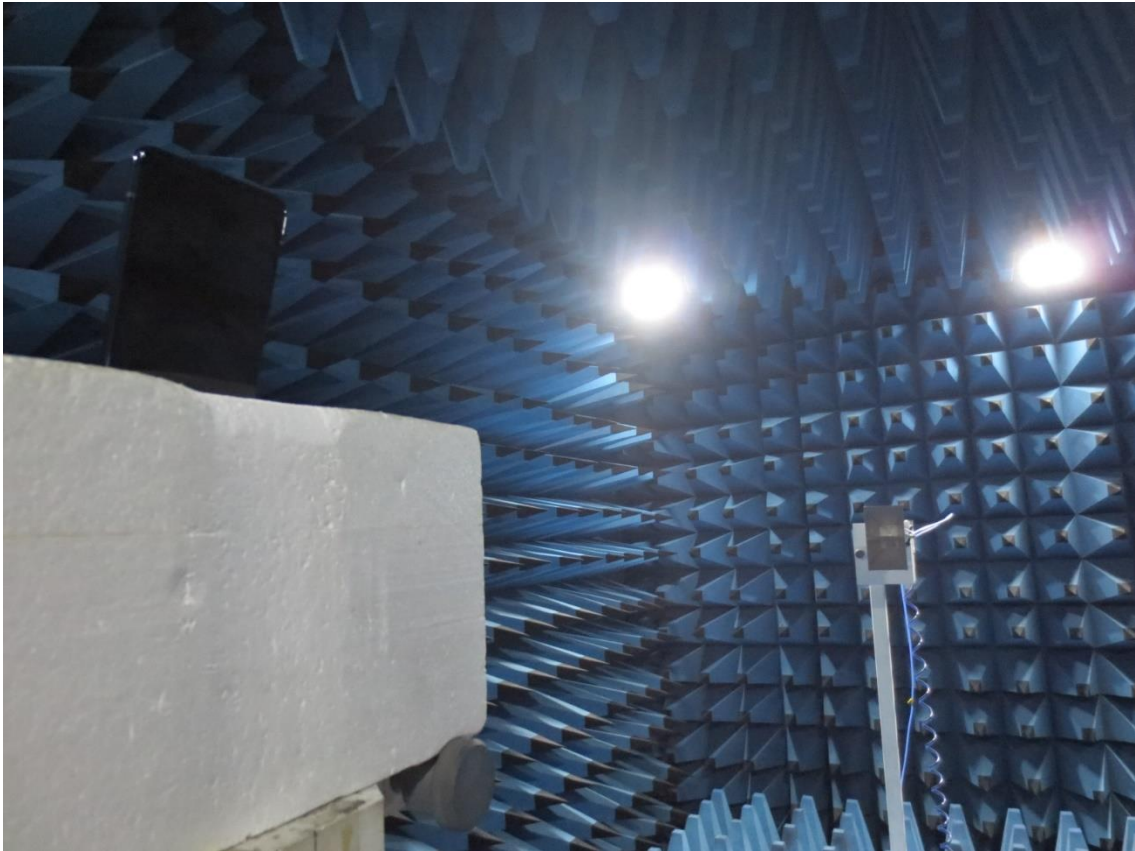

File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				

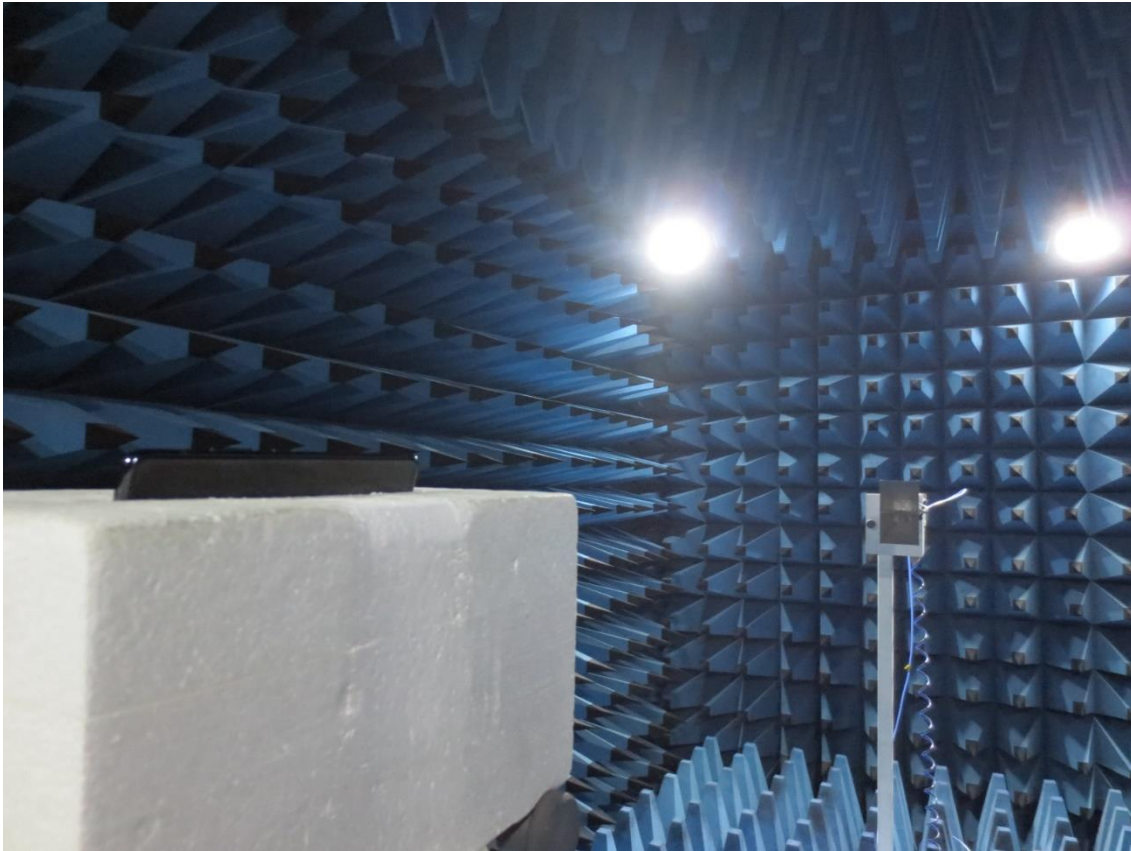

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P


HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P


HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

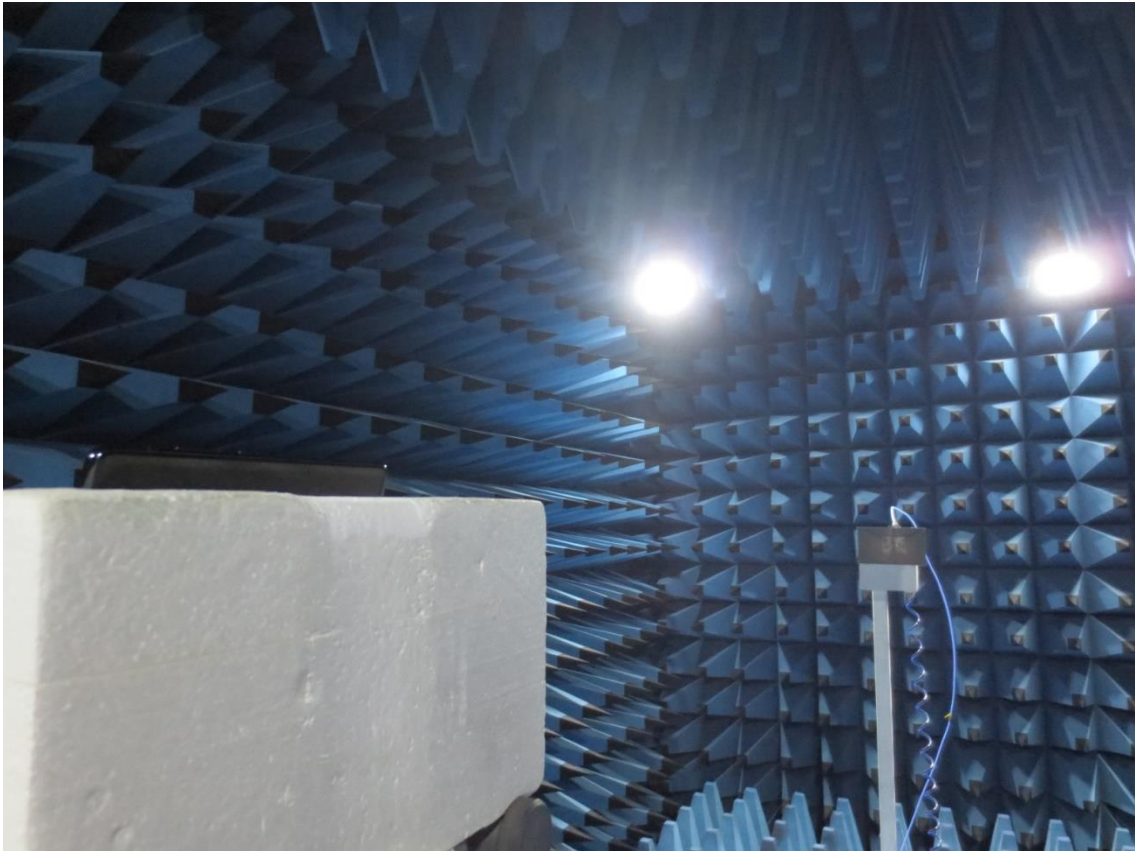

File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				

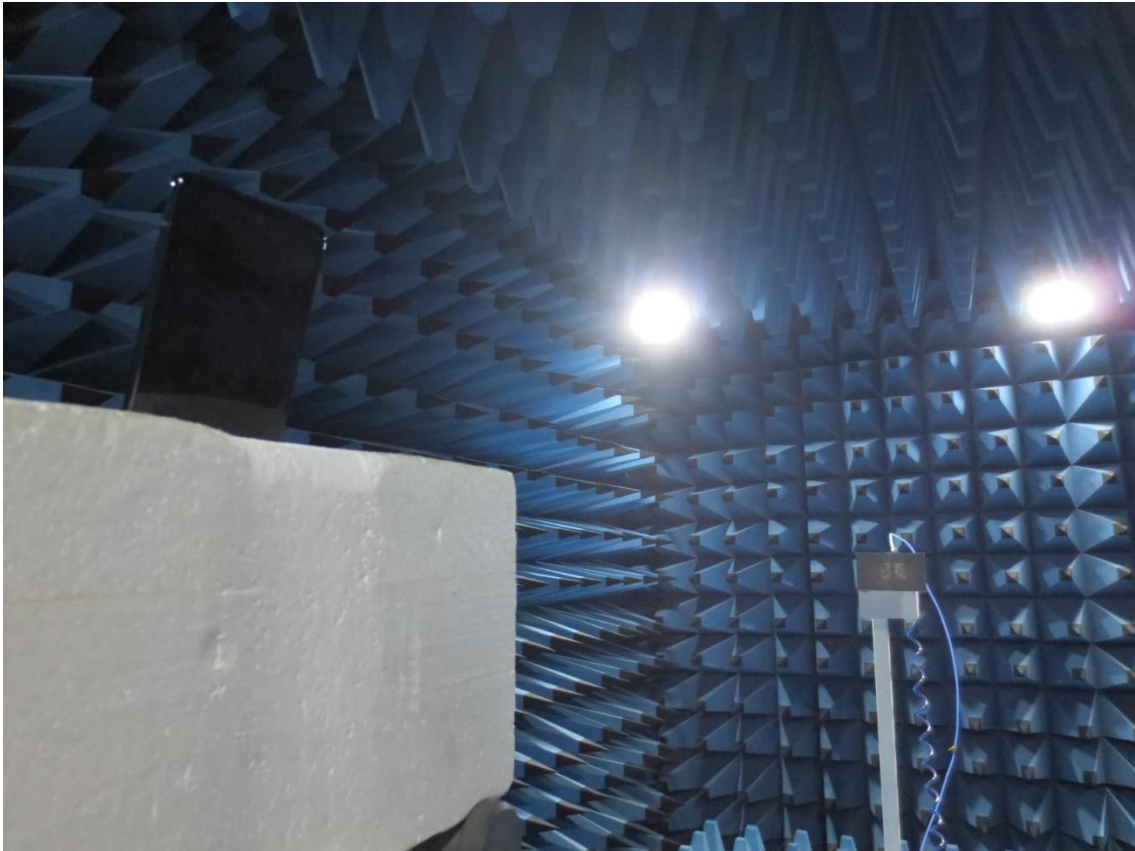

File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				

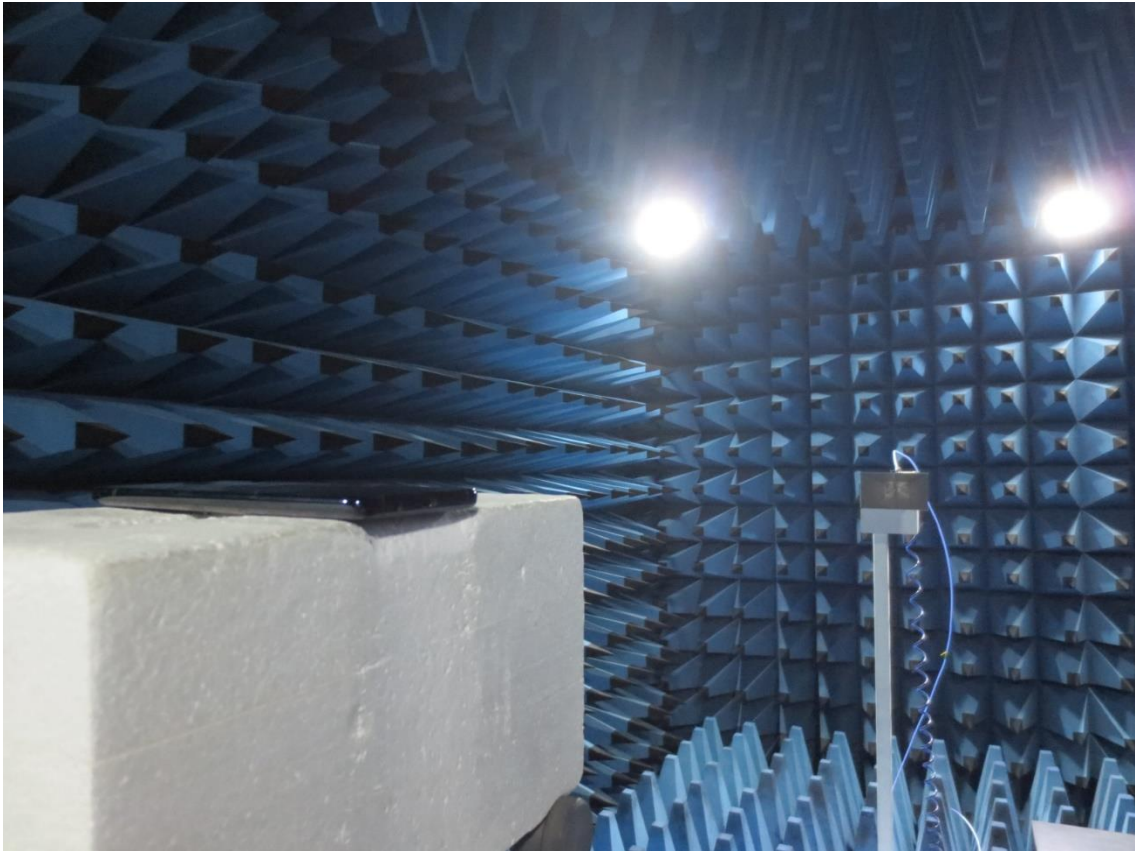

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

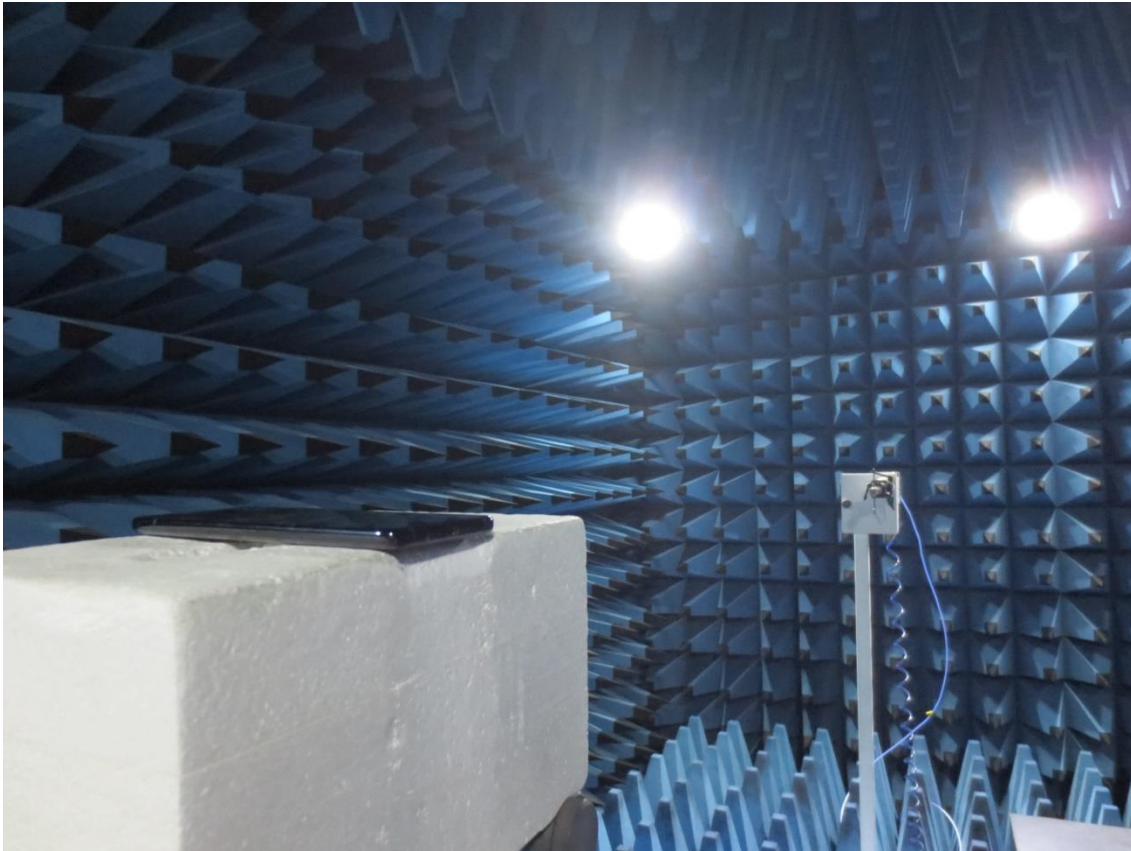

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

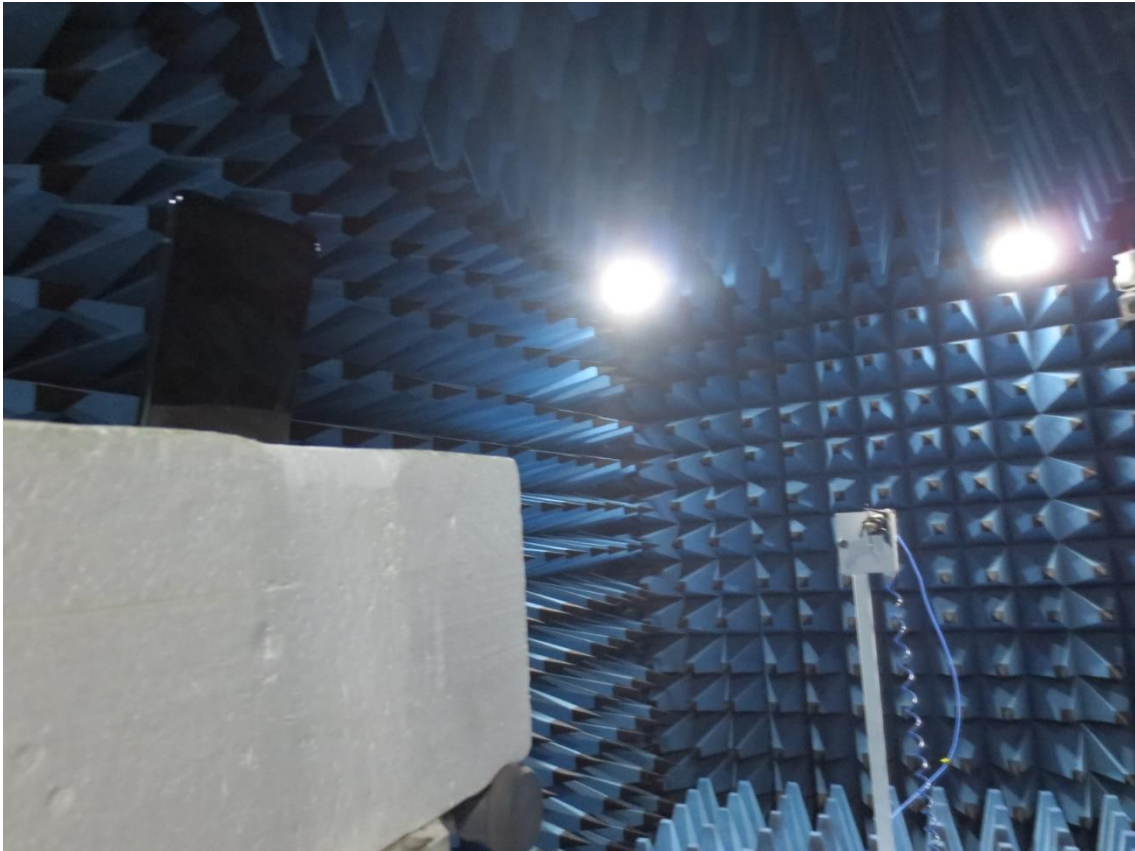

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

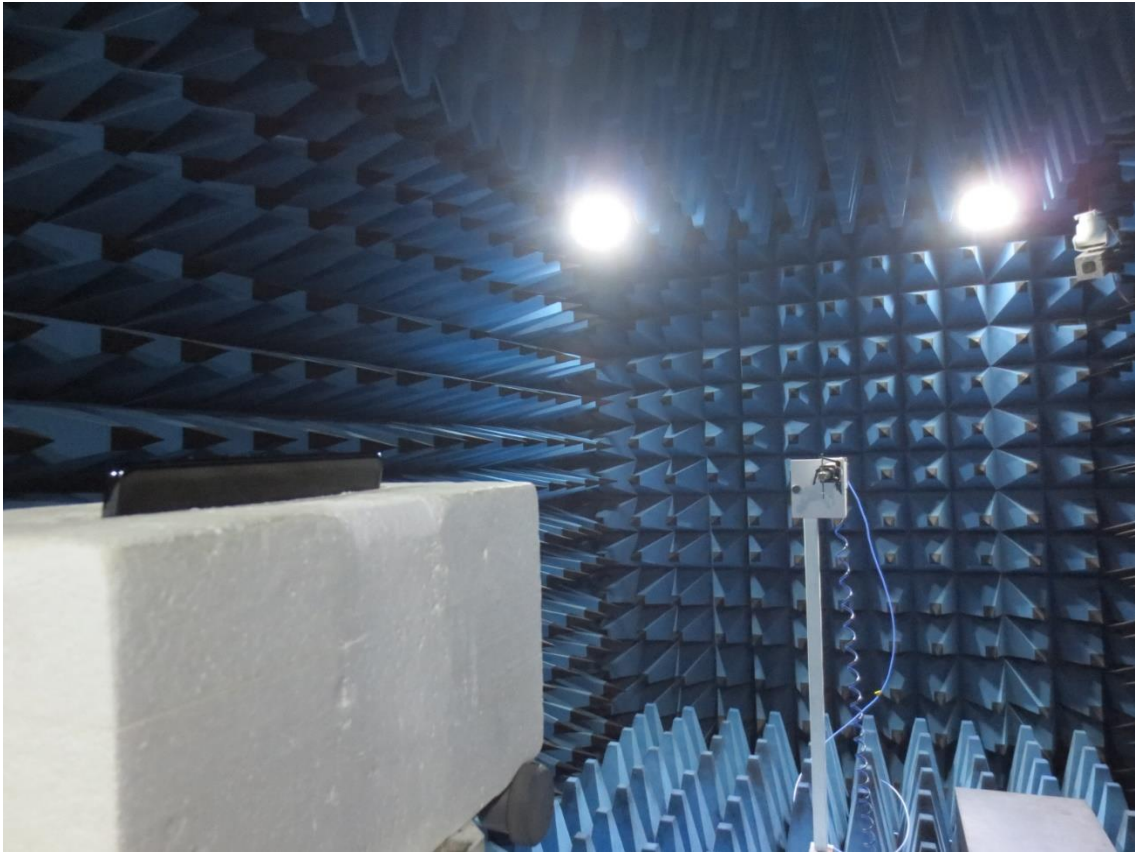

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

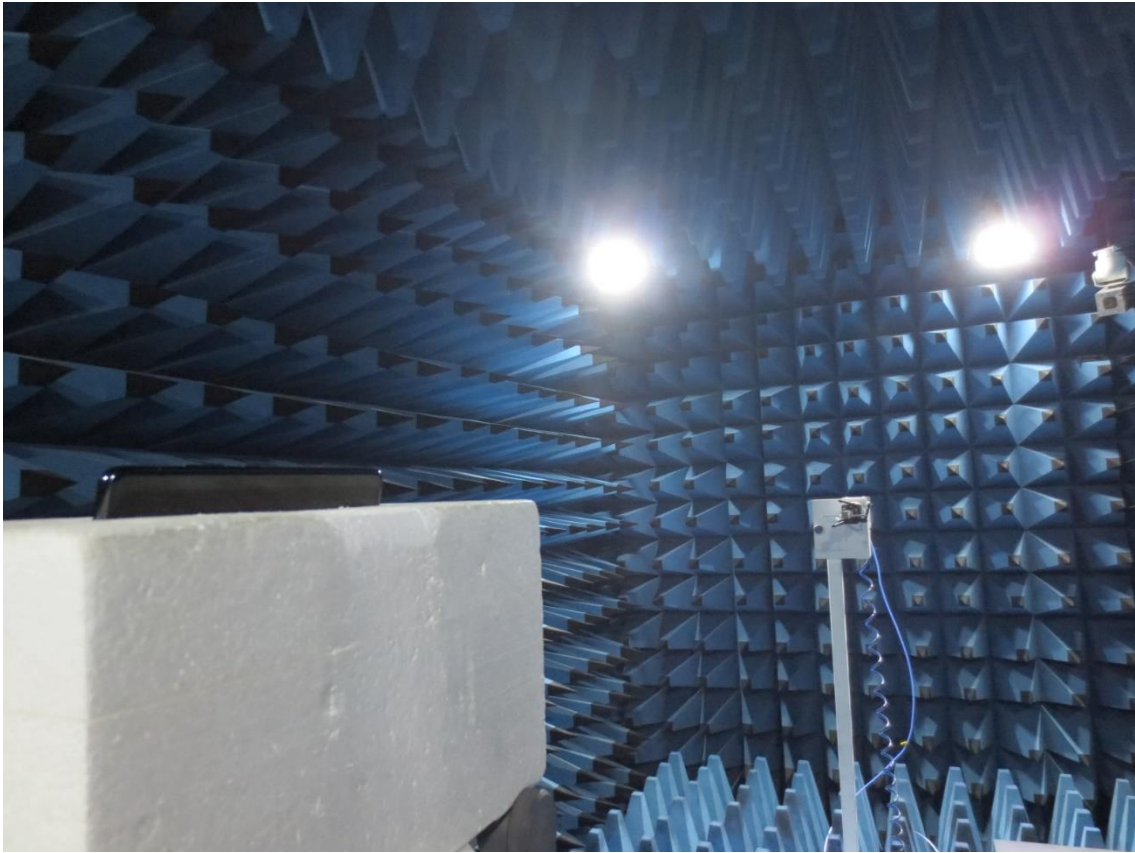

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

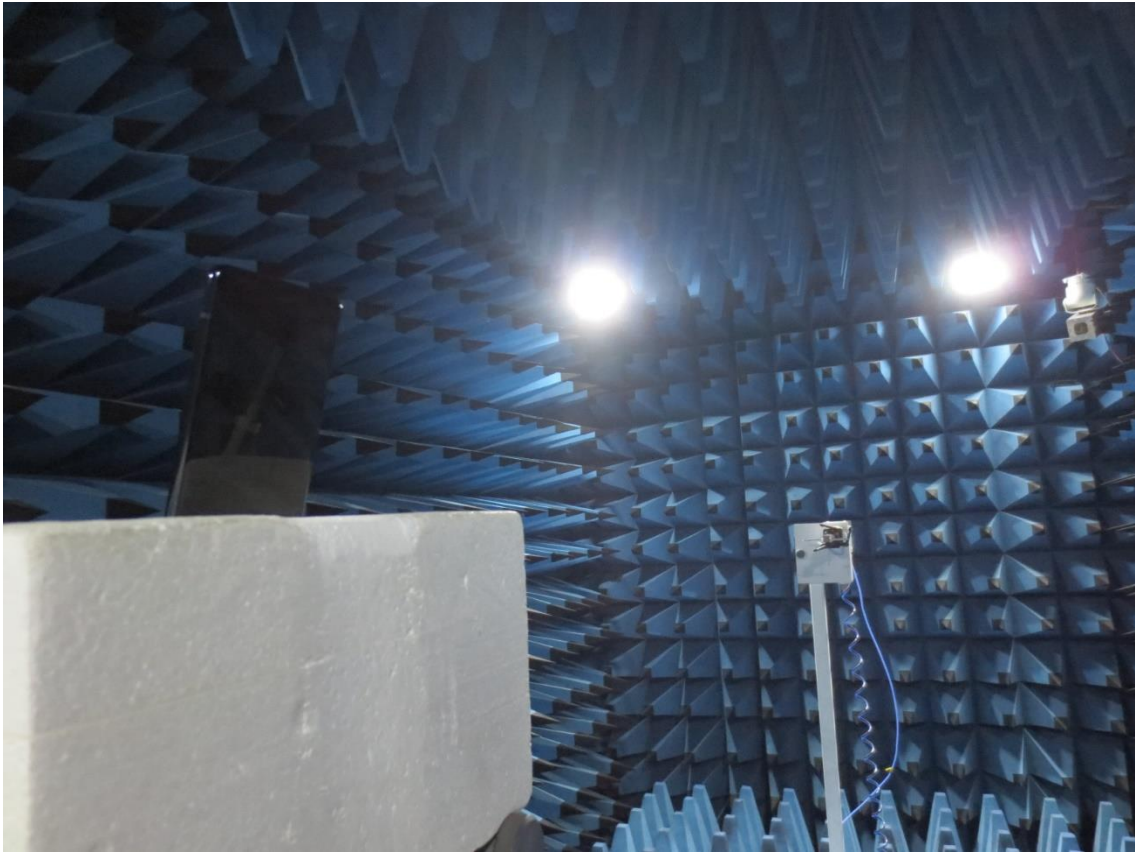

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

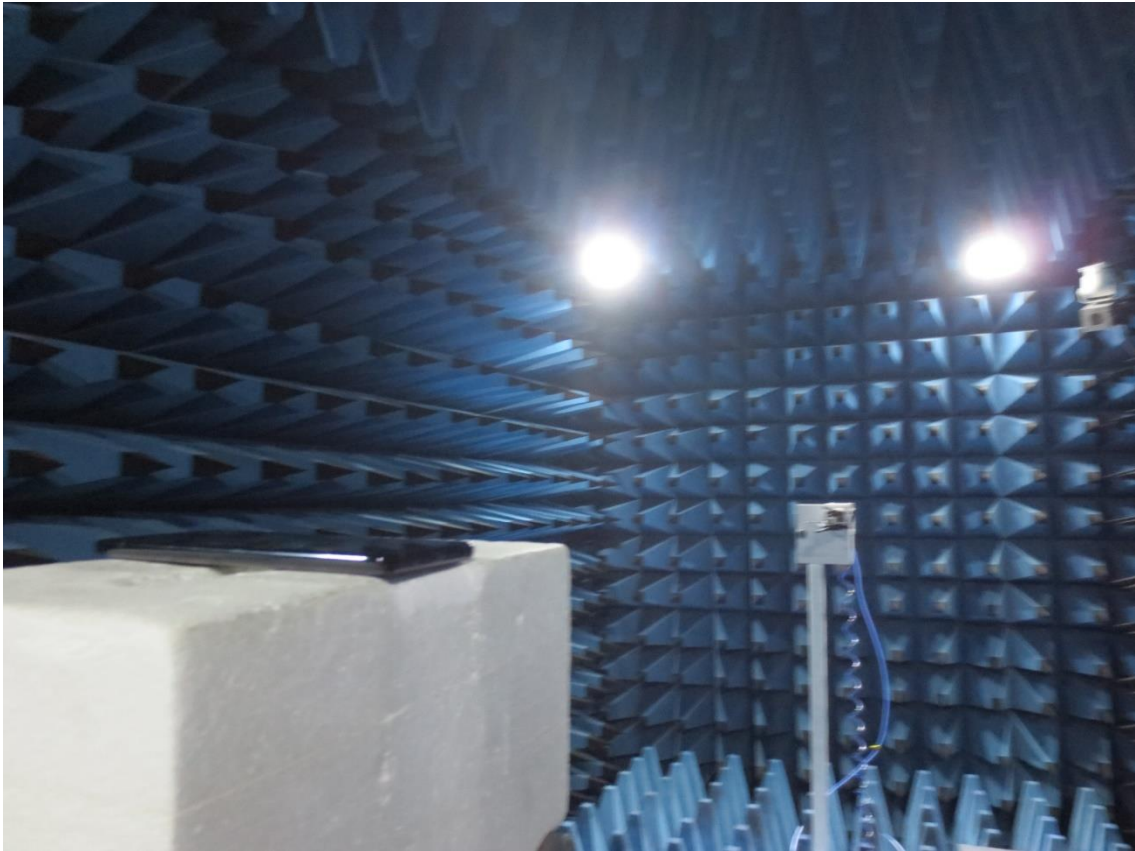

File No.	HCT-RF-2006-FC016-P	HCT-RF-2006-FC017-P	HCT-RF-2006-FC018-P	HCT-RF-2006-FC019-P	HCT-RF-2006-FC020-P
	HCT-RF-2006-FC021-P	HCT-RF-2006-FC022-P	HCT-RF-2006-FC023-P	HCT-RF-2006-FC024-P	HCT-RF-2006-FC025-P
	HCT-RF-2006-FC026-P				

2. Conducted Test Setup Photo



File
No.

HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P


HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

3. mmWave Test Setup Photo_Bilog

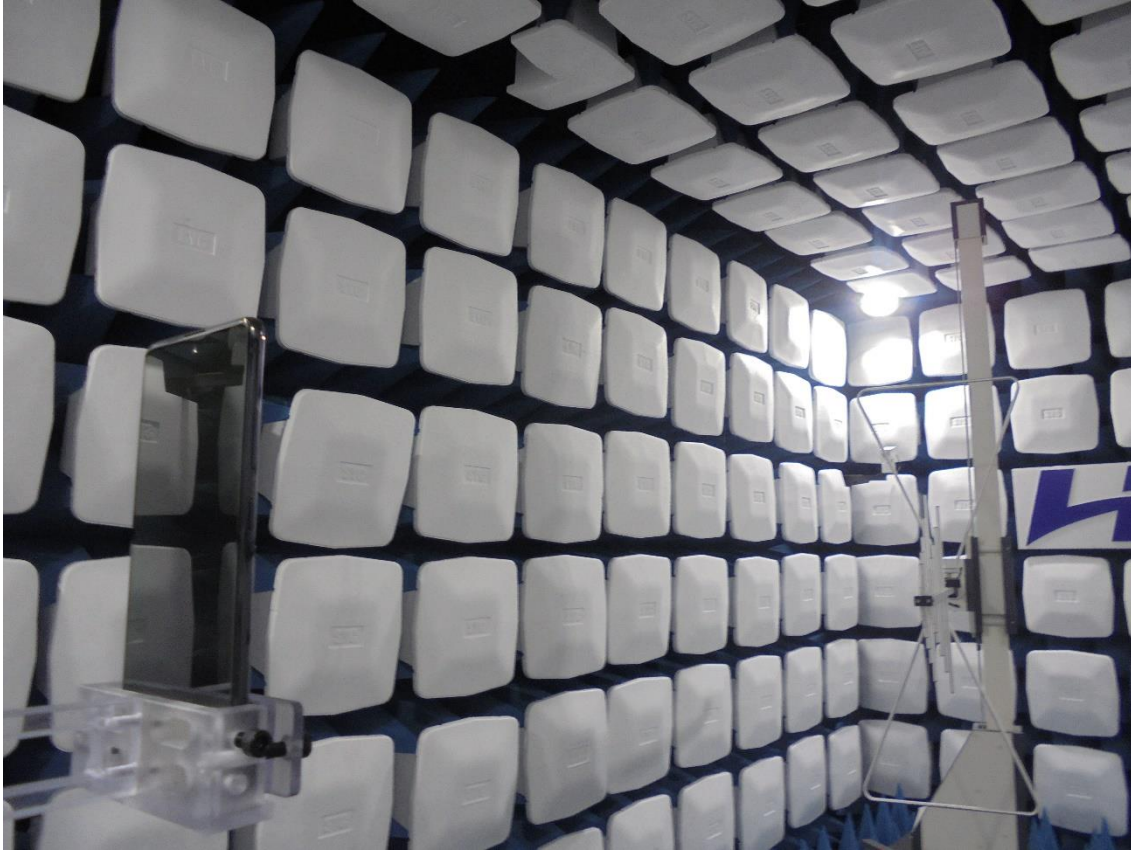

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

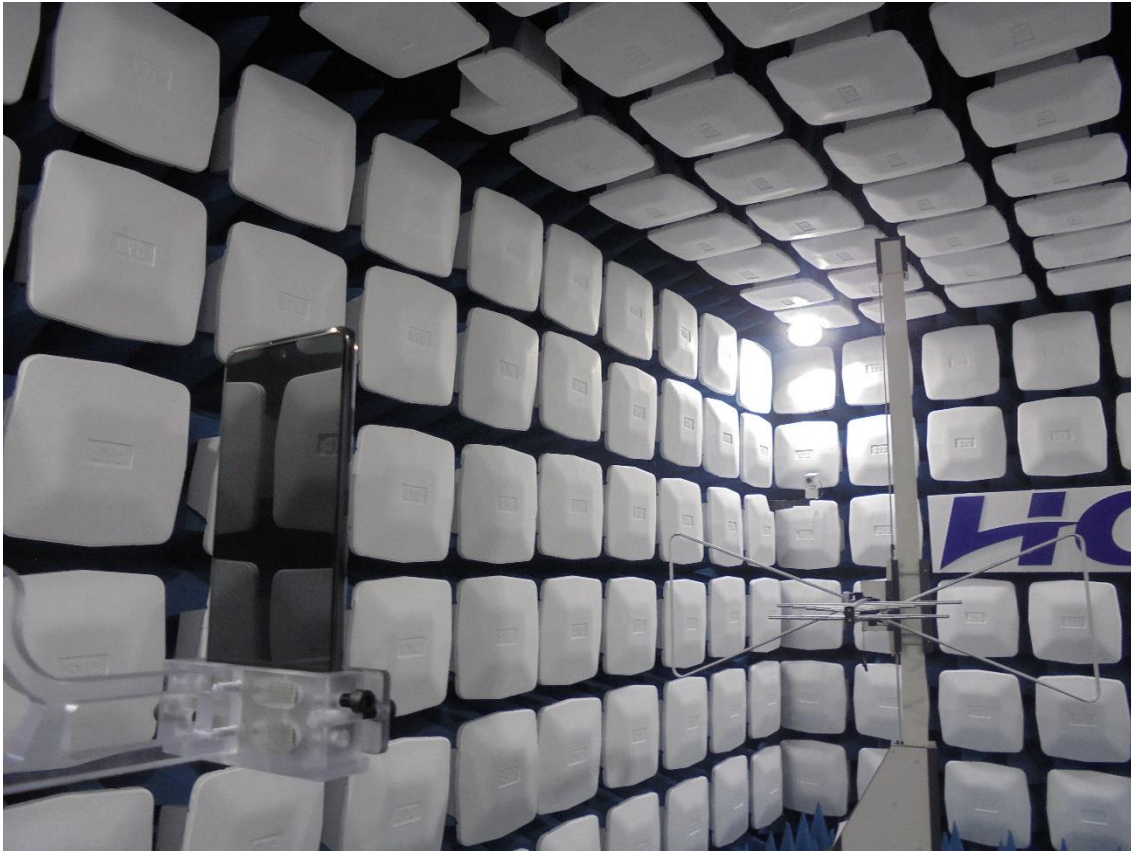

File
No.

HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P


HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

4. mmWave Test Setup Photo_ Horn_18G

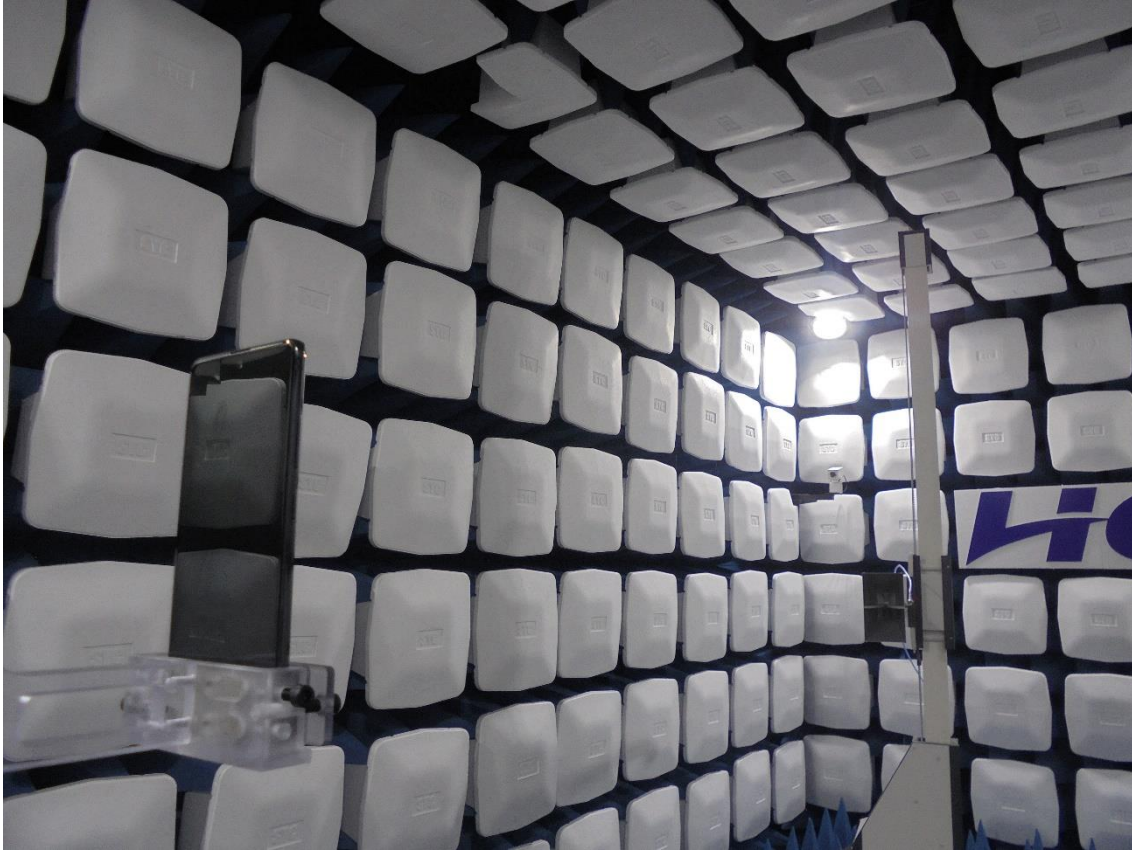

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

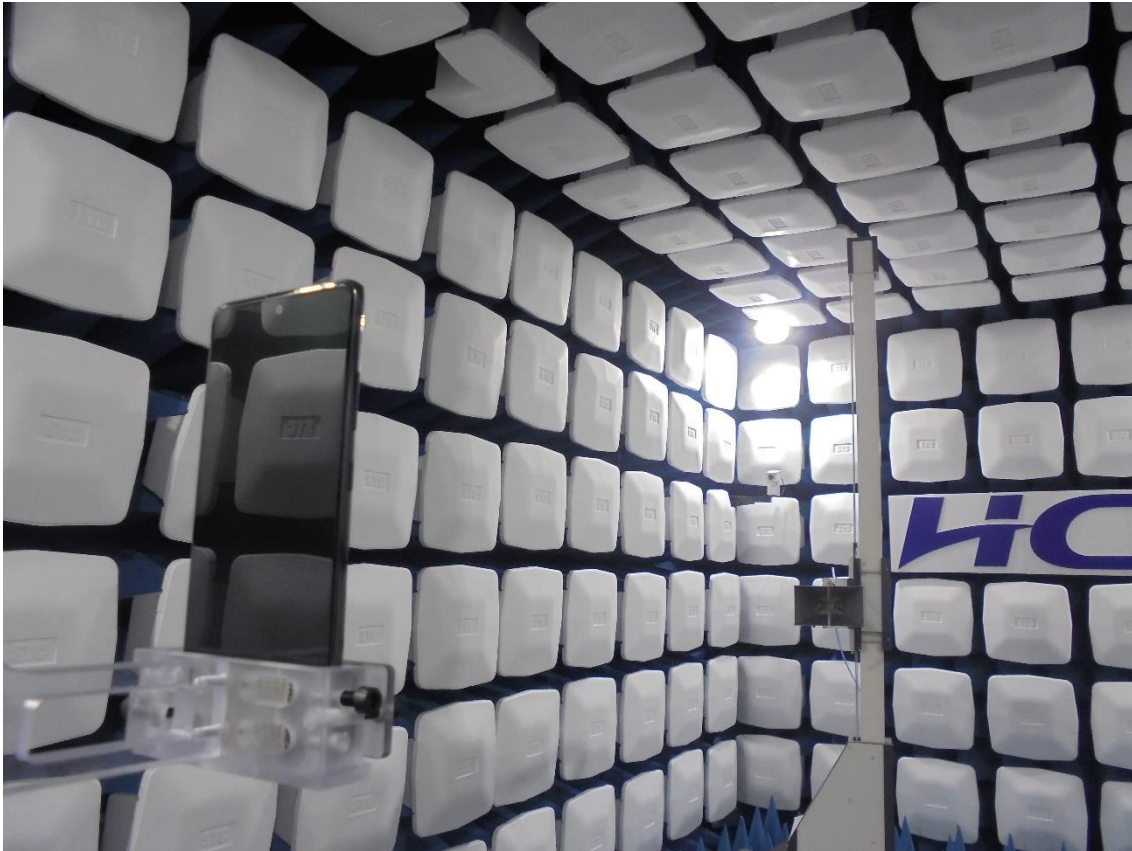

File
No.

HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P


HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

5. mmWave Test Setup Photo_ Horn_40G

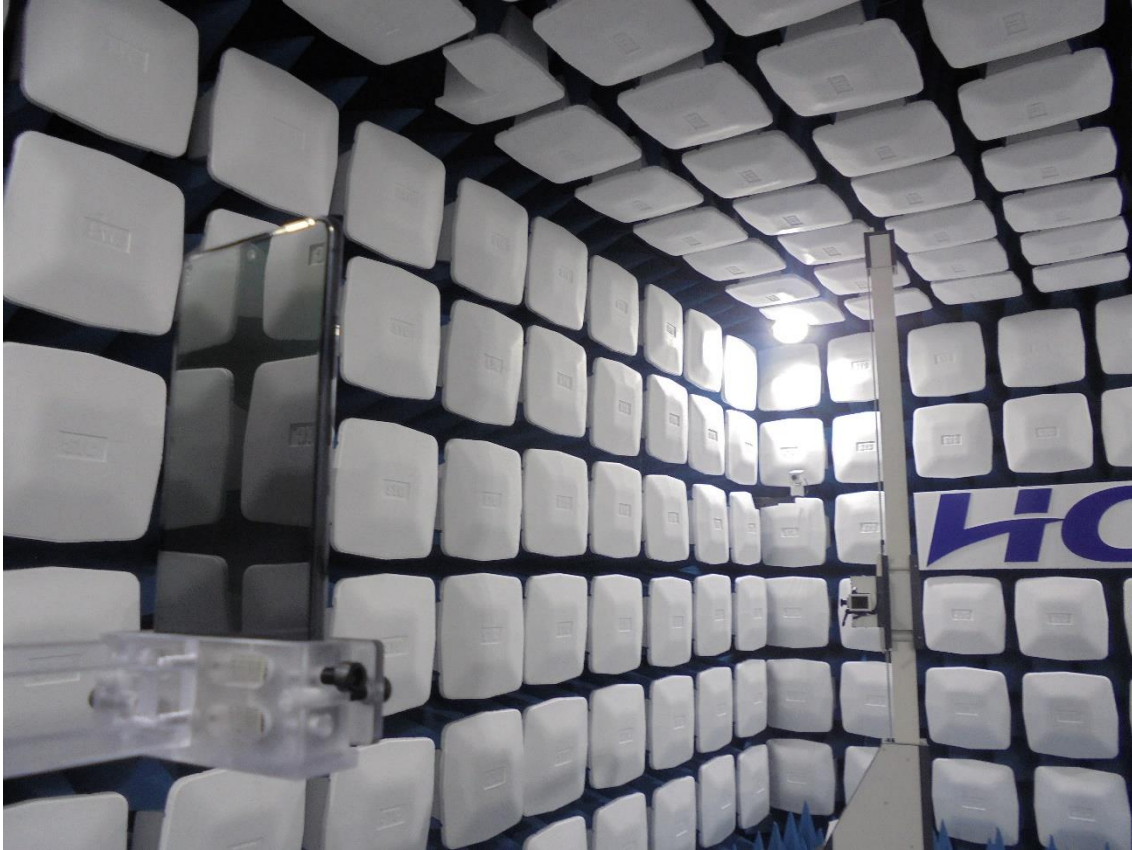

File
No.


HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P

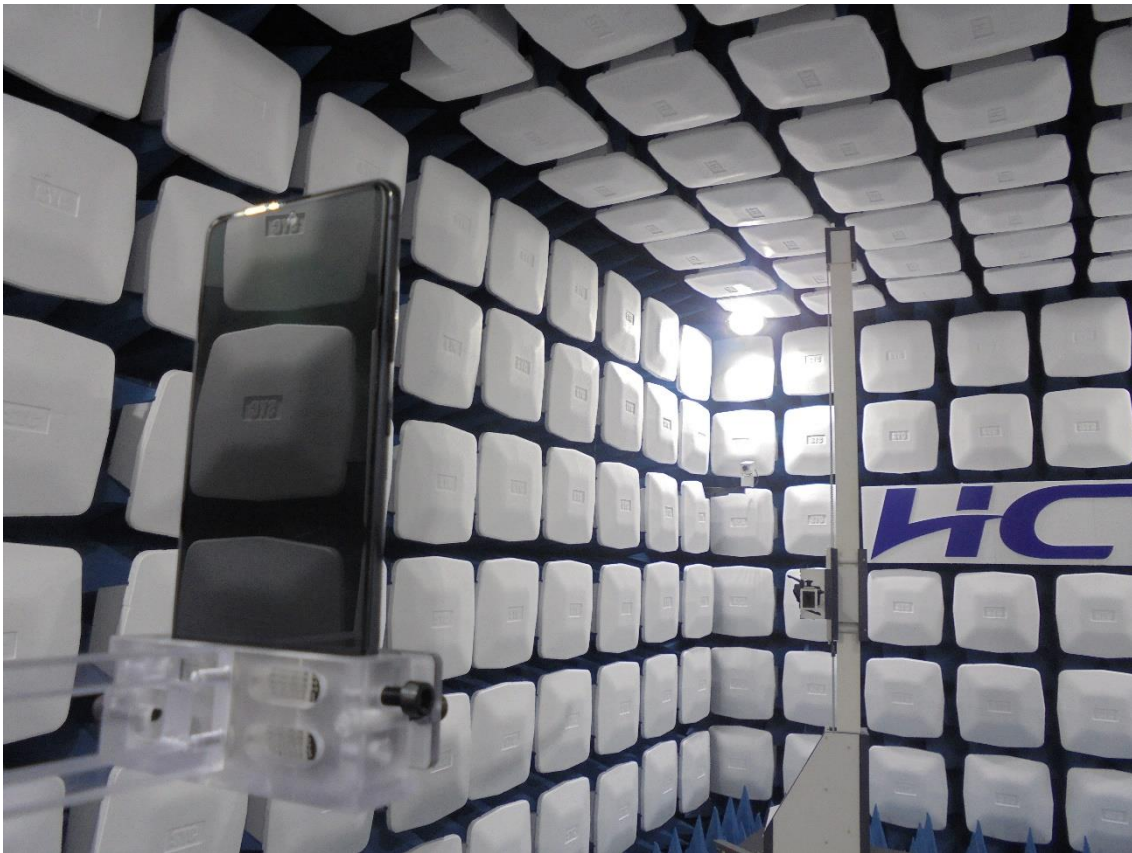

File
No.

HCT-RF-2006-FC016-P
HCT-RF-2006-FC021-P
HCT-RF-2006-FC026-P

HCT-RF-2006-FC017-P
HCT-RF-2006-FC022-P

HCT-RF-2006-FC018-P
HCT-RF-2006-FC023-P

HCT-RF-2006-FC019-P
HCT-RF-2006-FC024-P

HCT-RF-2006-FC020-P
HCT-RF-2006-FC025-P