



**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA  
Tel. +82 31 634 6300 Fax. +82 31 645 6401

<h1 style="margin: 0;">Appendix A:</h1> <h2 style="margin: 0;">Test Setup</h2> <h3 style="margin: 0;">Photo</h3>	<b>FCC ID</b> A3LSMG770F	
	<b>File No.</b> HCT-RF-1910-FC010-P      HCT-RF-1910-FC015-P HCT-RF-1910-FC011-P      HCT-RF-1910-FC016-P HCT-RF-1910-FC012-P      HCT-RF-1910-FC017-P HCT-RF-1910-FC013-P HCT-RF-1910-FC014-P	

**REVISION HISTORY**

The revision history for this document is shown in table.

Revision No.	Date of Issue	Description
0	October 31, 2019	Initial Release

File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		


### 1. Radiated Test Setup Photo



File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		



File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

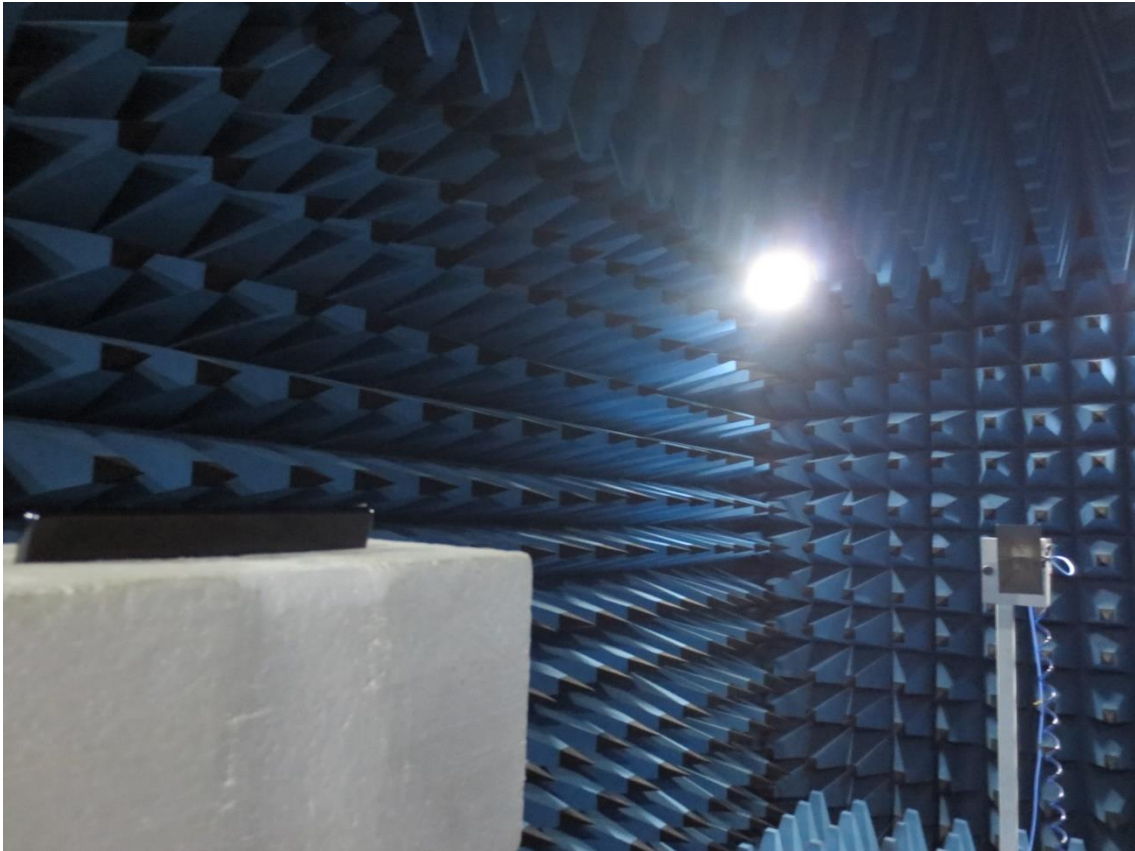


File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		



File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		




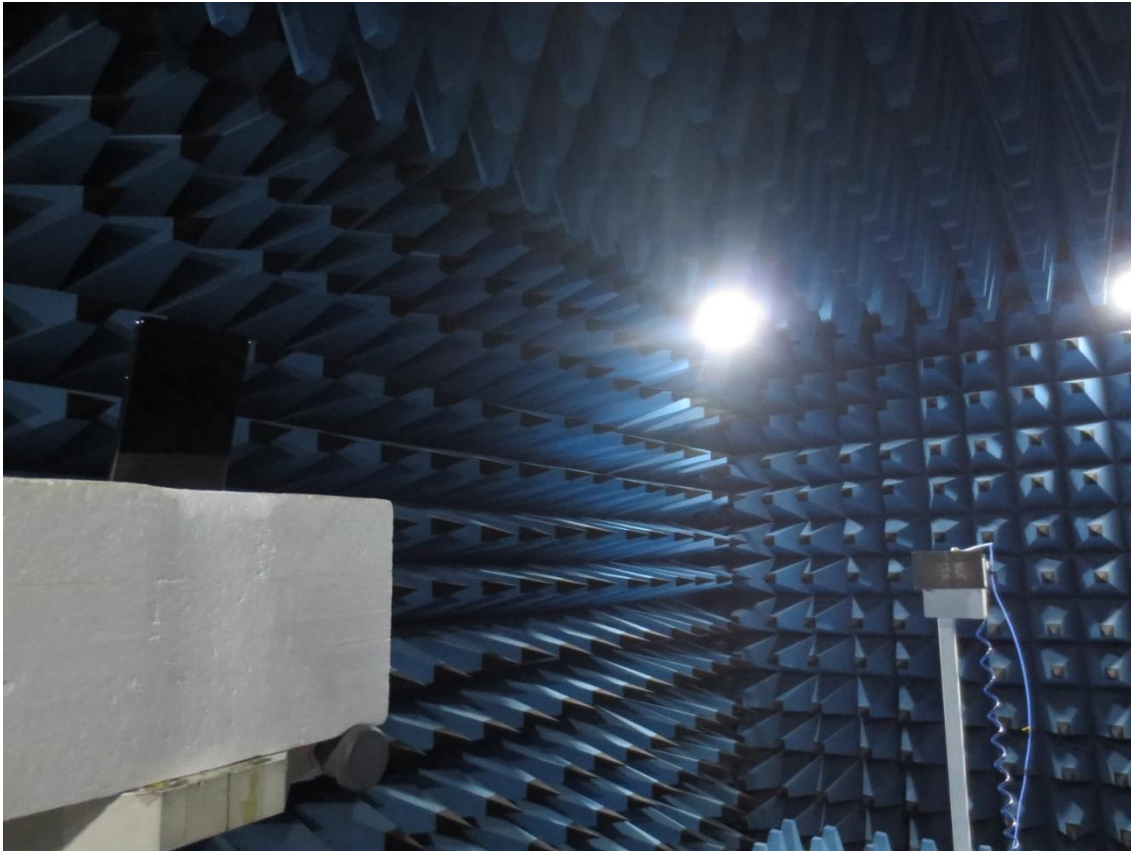

File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		




File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

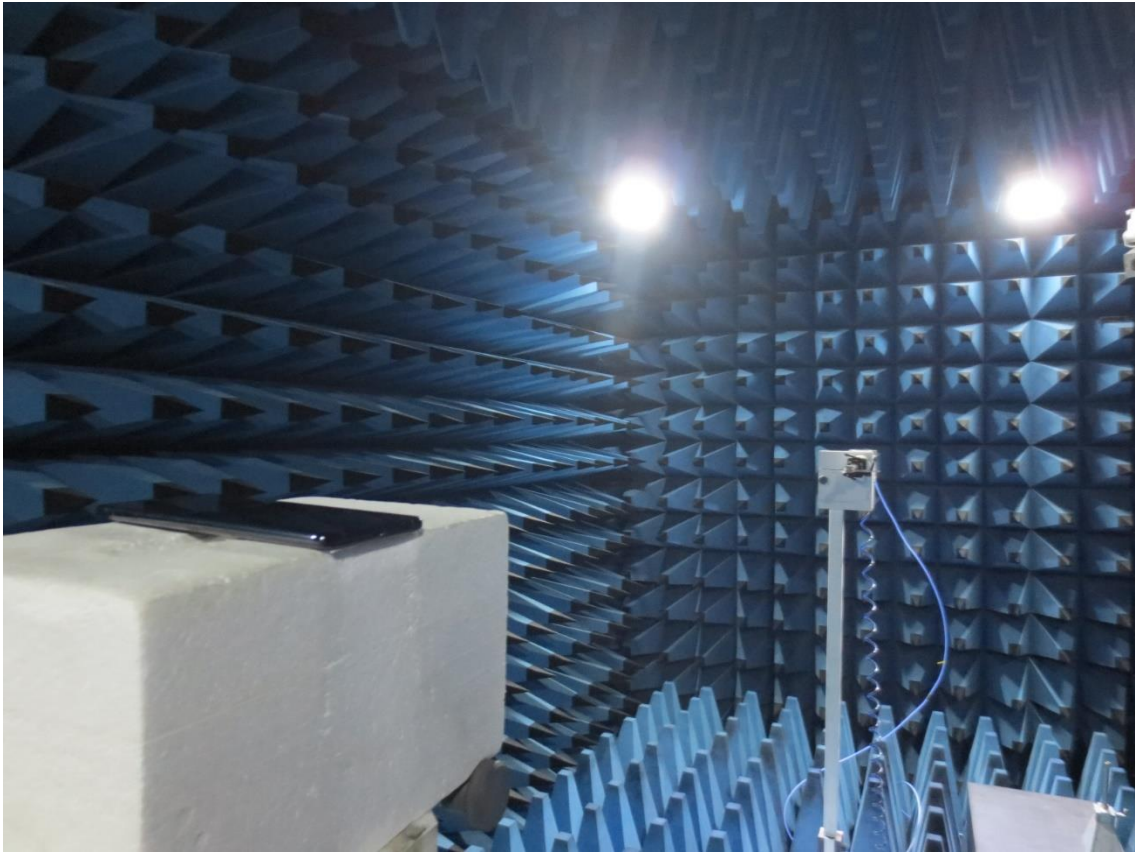


File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		




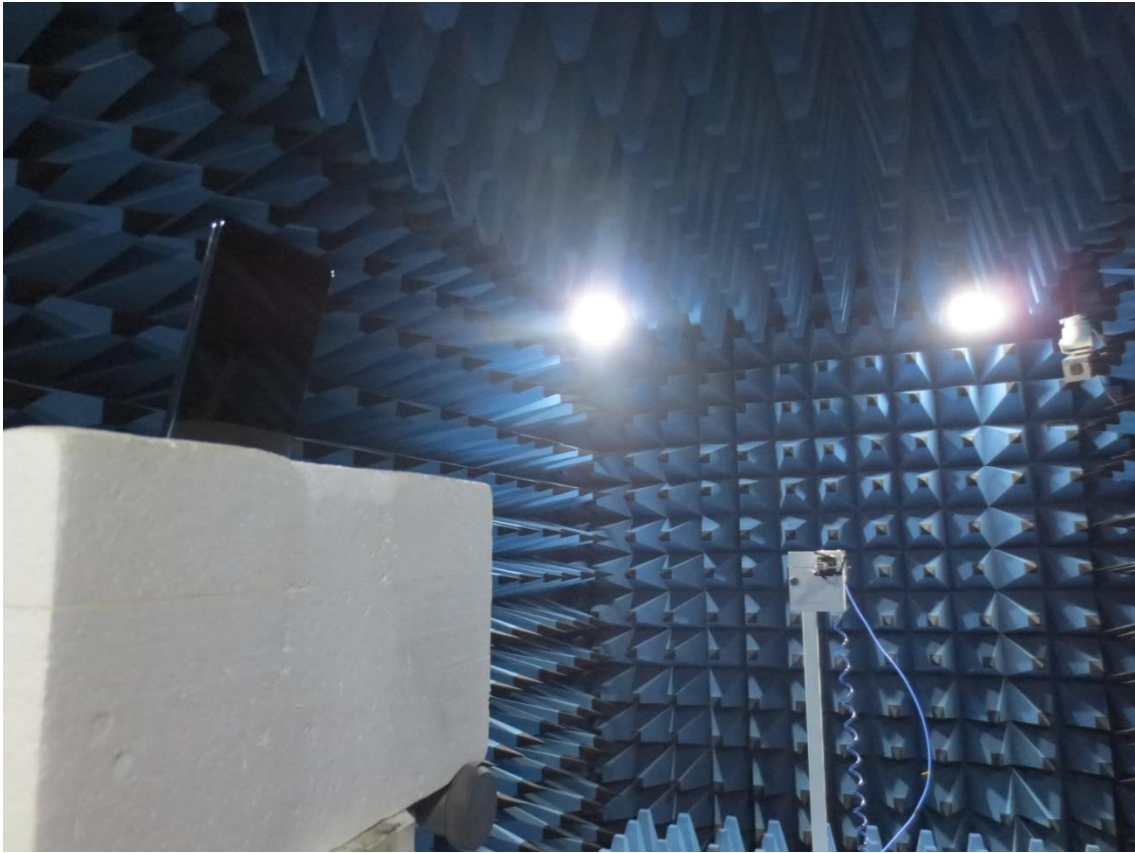


File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

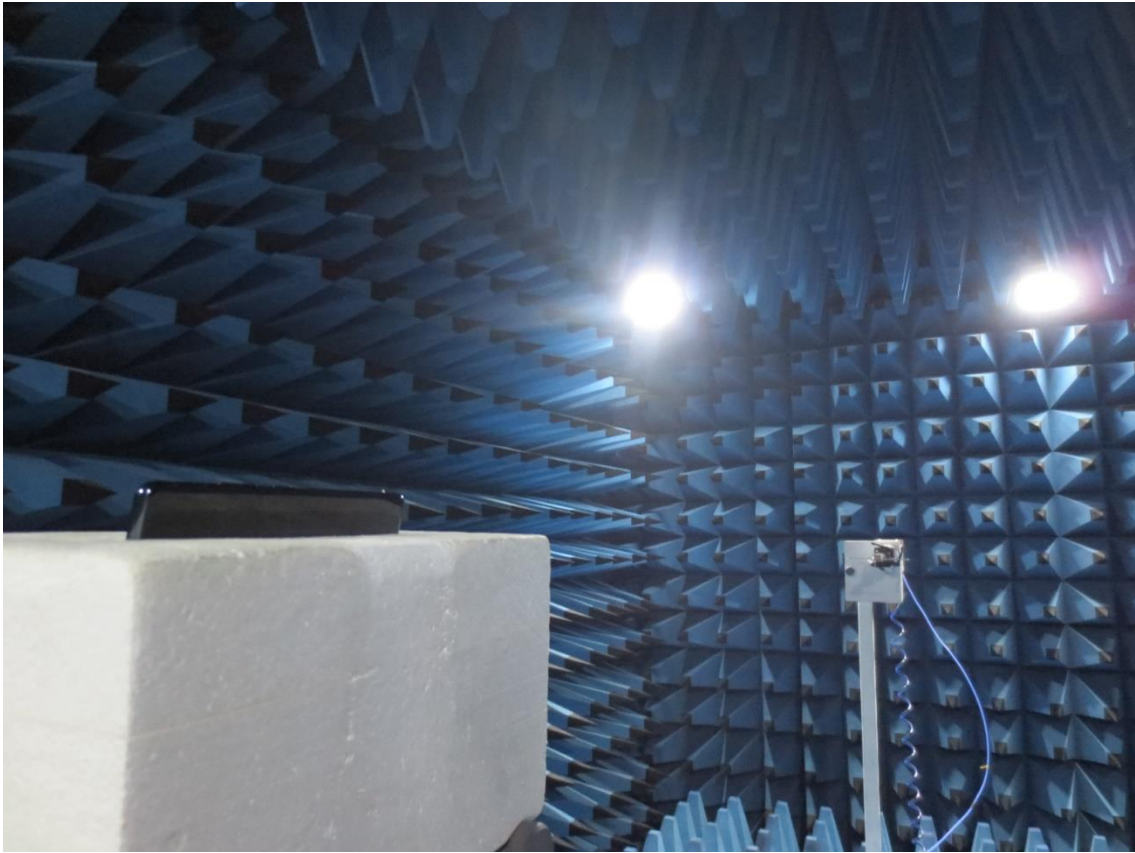

File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

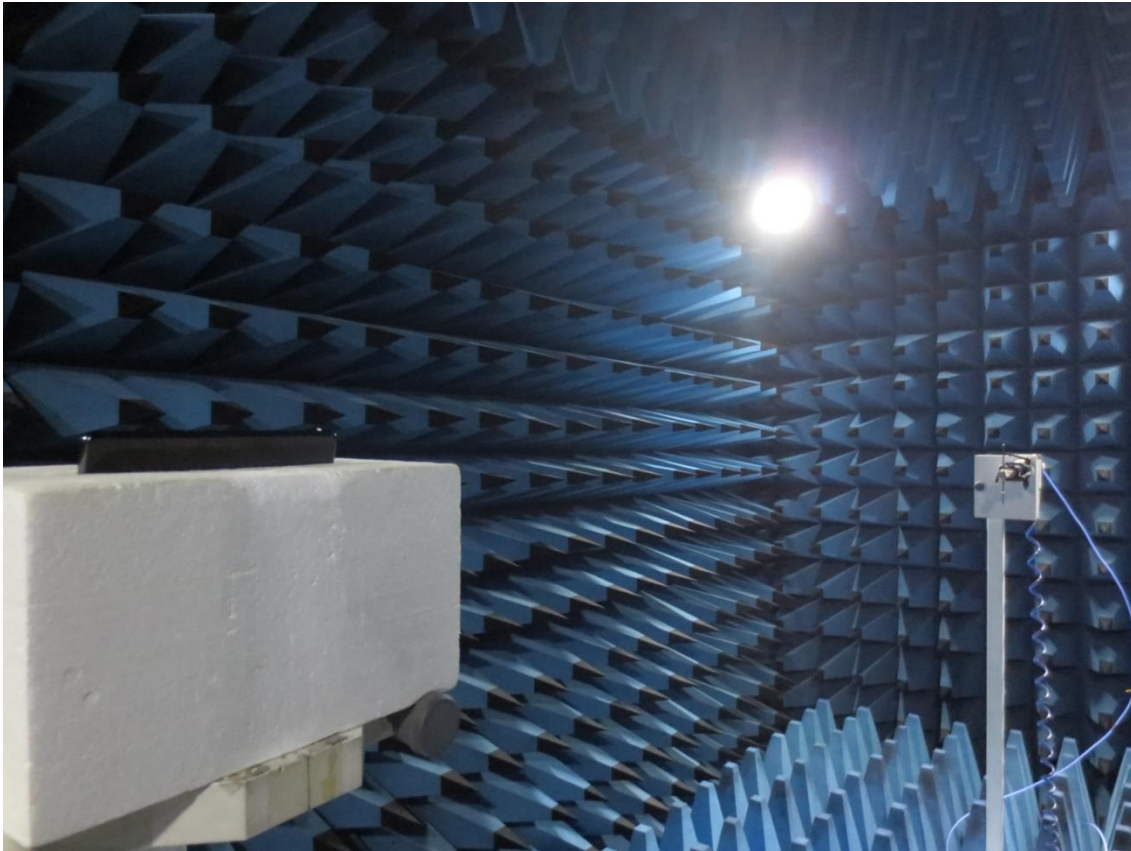


File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

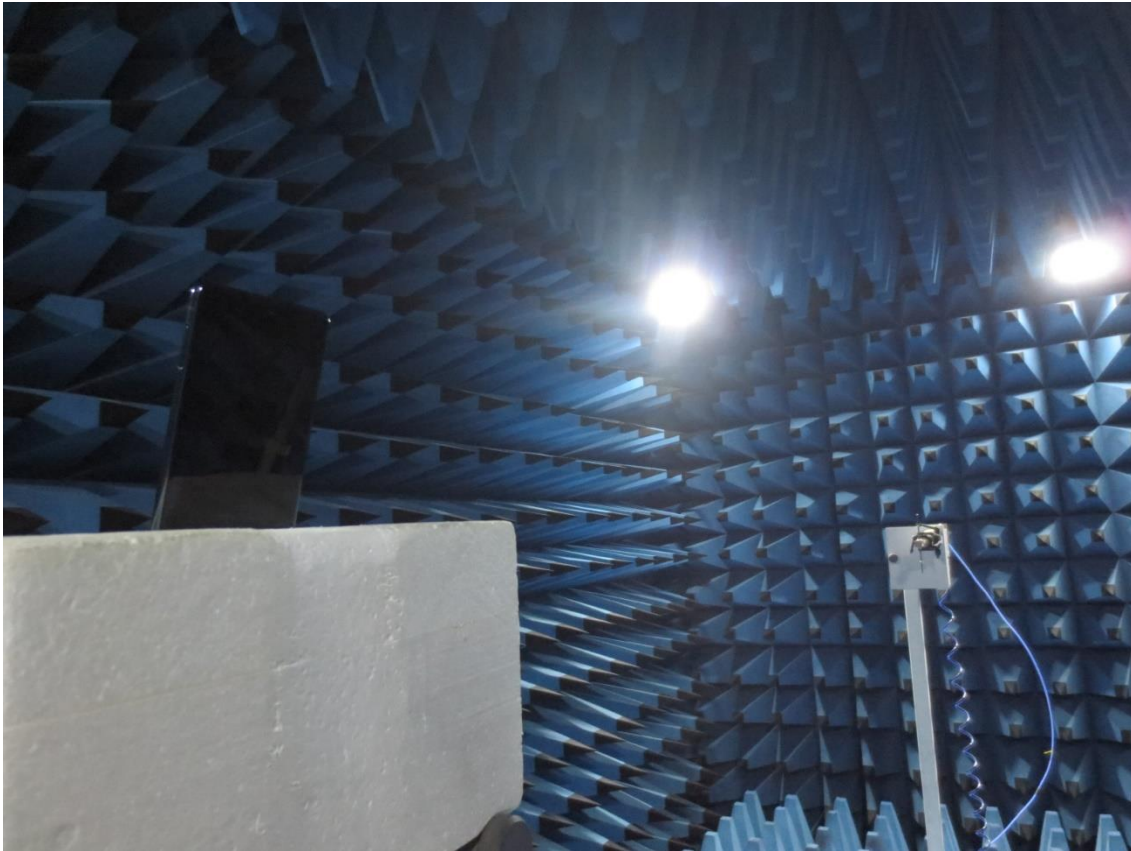


File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		



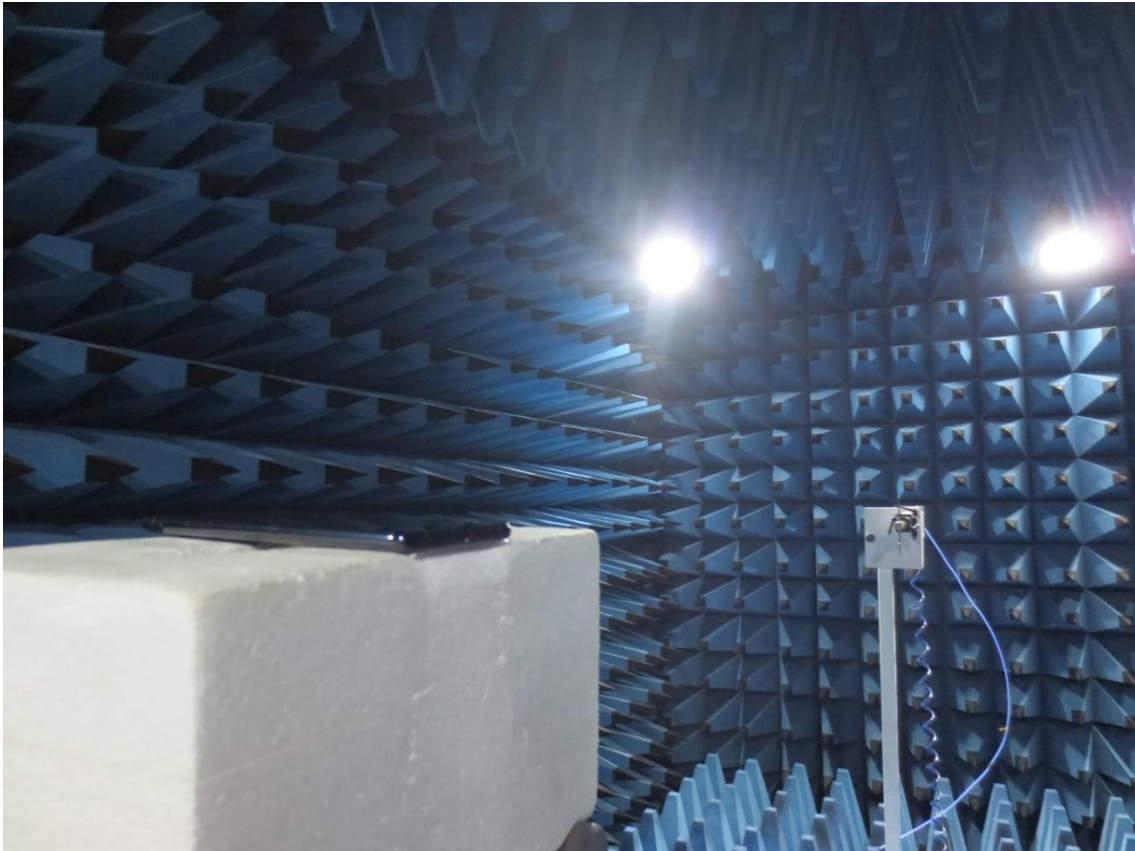

File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		

## 2. Conducted Test Setup Photo

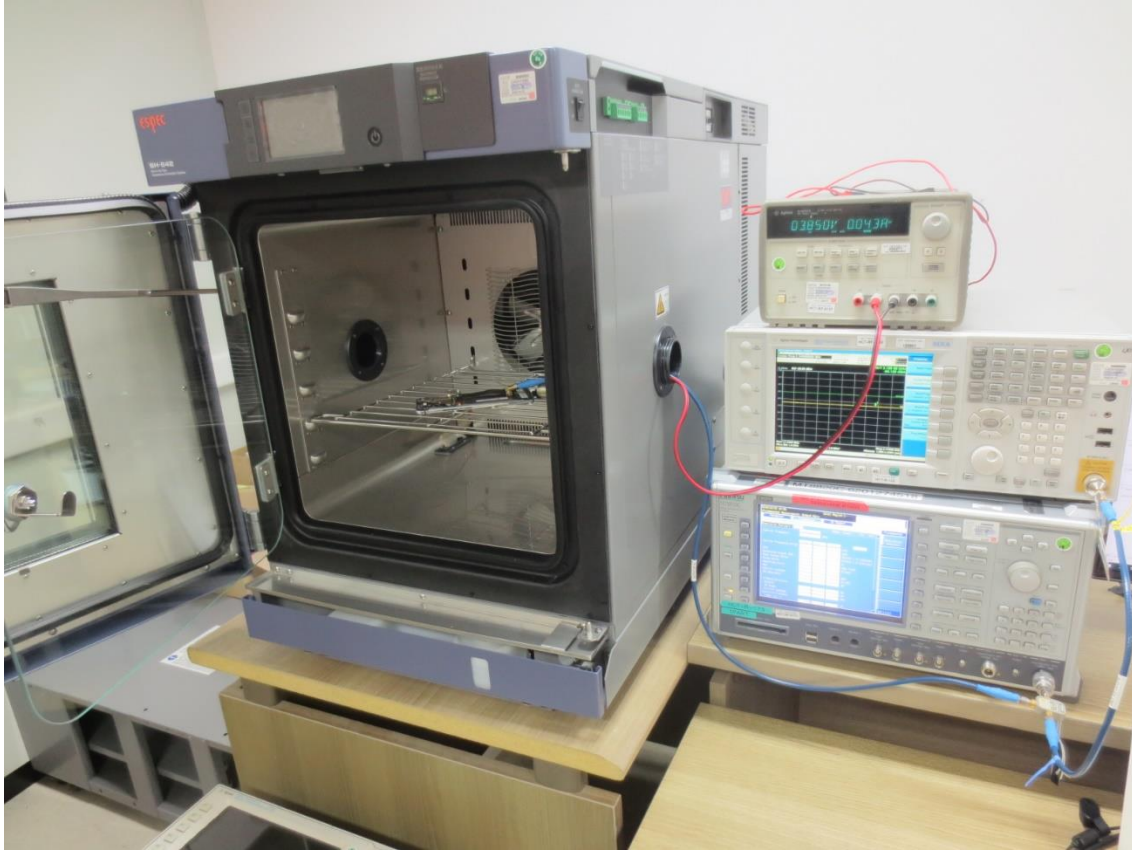

File	HCT-RF-1910-FC010-P	HCT-RF-1910-FC011-P	HCT-RF-1910-FC012-P	HCT-RF-1910-FC013-P	HCT-RF-1910-FC014-P
No.	HCT-RF-1910-FC015-P	HCT-RF-1910-FC016-P	HCT-RF-1910-FC017-P		