



HCT Co., Ltd.

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A:
Test Setup
Photo

FCC ID
A3LSMG990B2

File No.			
HCT-RF-2206-FC001-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC020-P	
HCT-RF-2206-FC002-P	HCT-RF-2206-FC018-P	HCT-RF-2206-FC021-P	
HCT-RF-2206-FC016-P	HCT-RF-2206-FC019-P	HCT-RF-2206-FC022-P	


REVISION HISTORY

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	June 17, 2022	Initial Release

File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	


1. Radiated Test Setup Photo

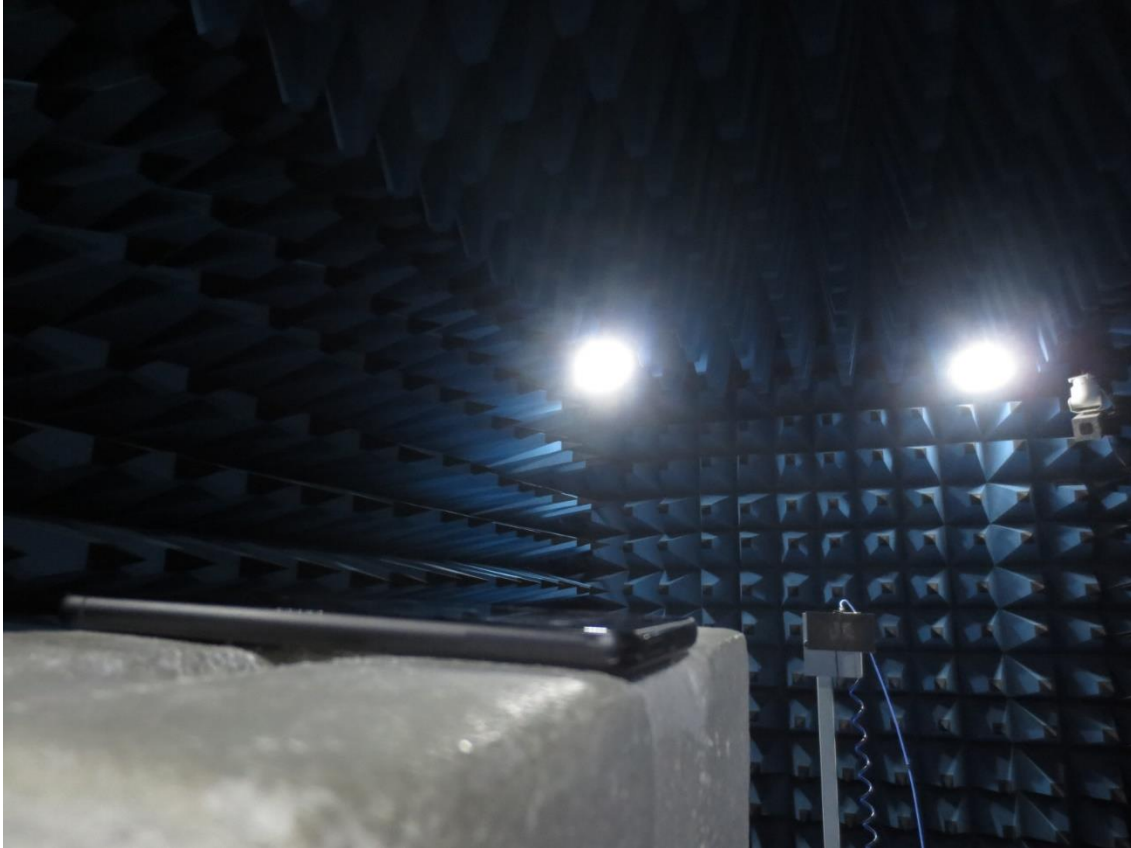


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

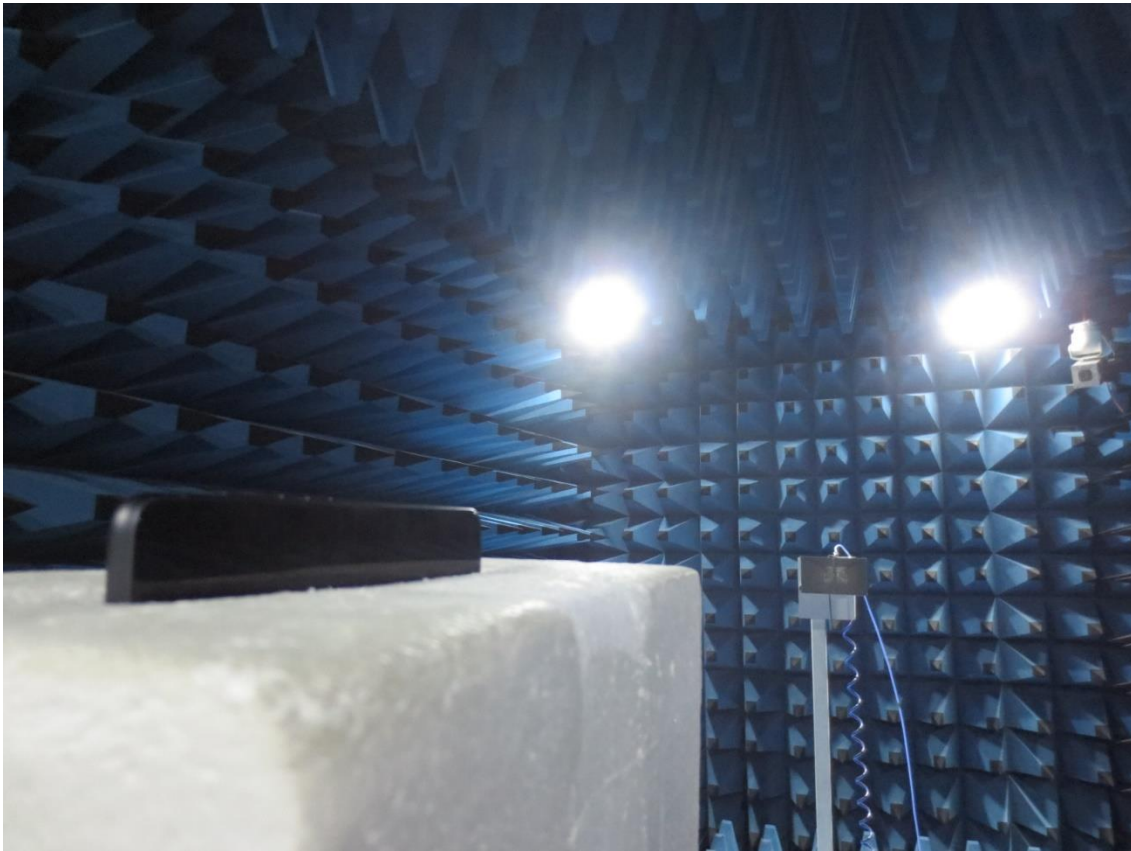


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

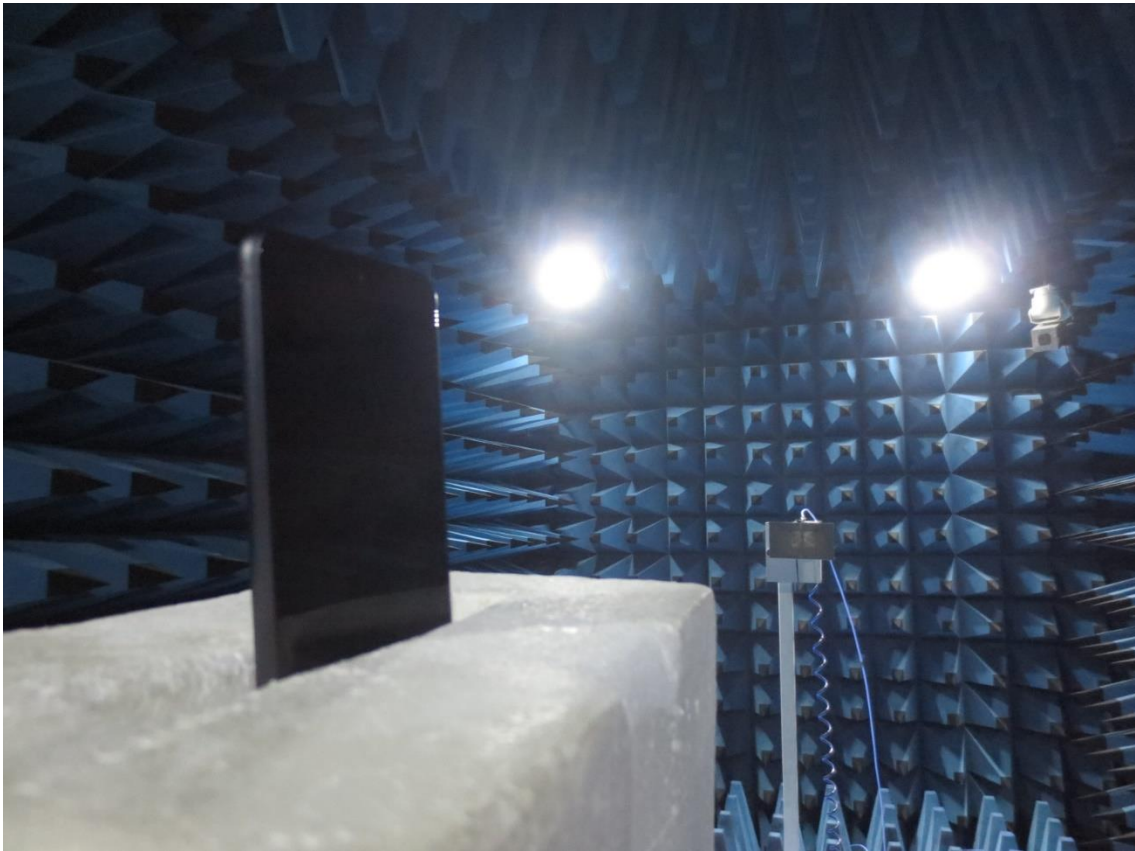


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

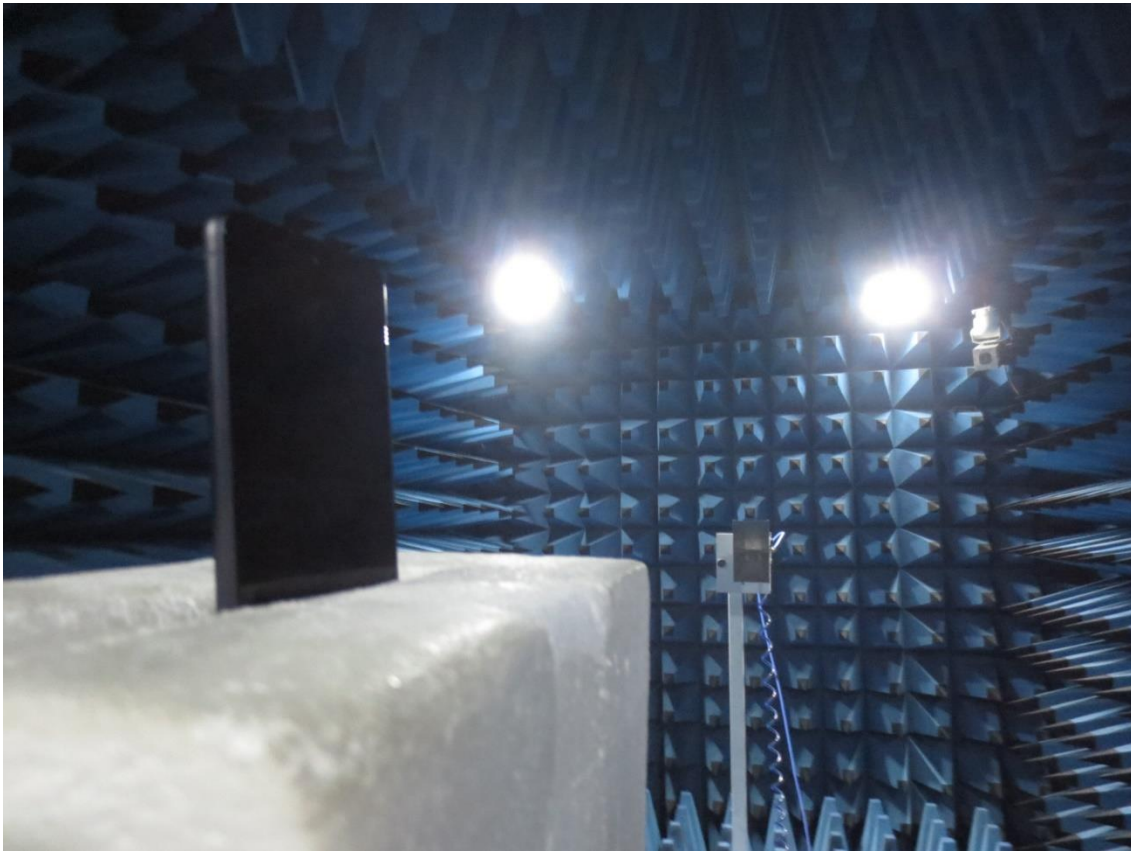


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

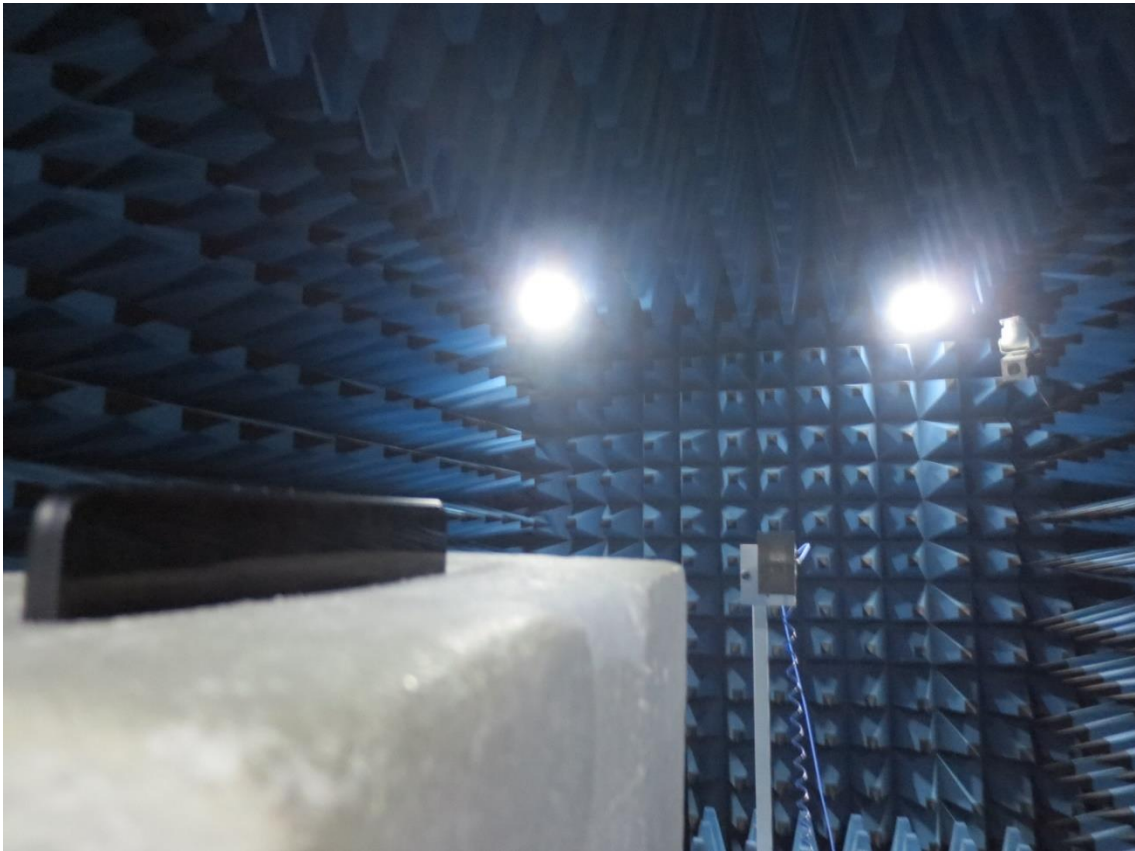


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

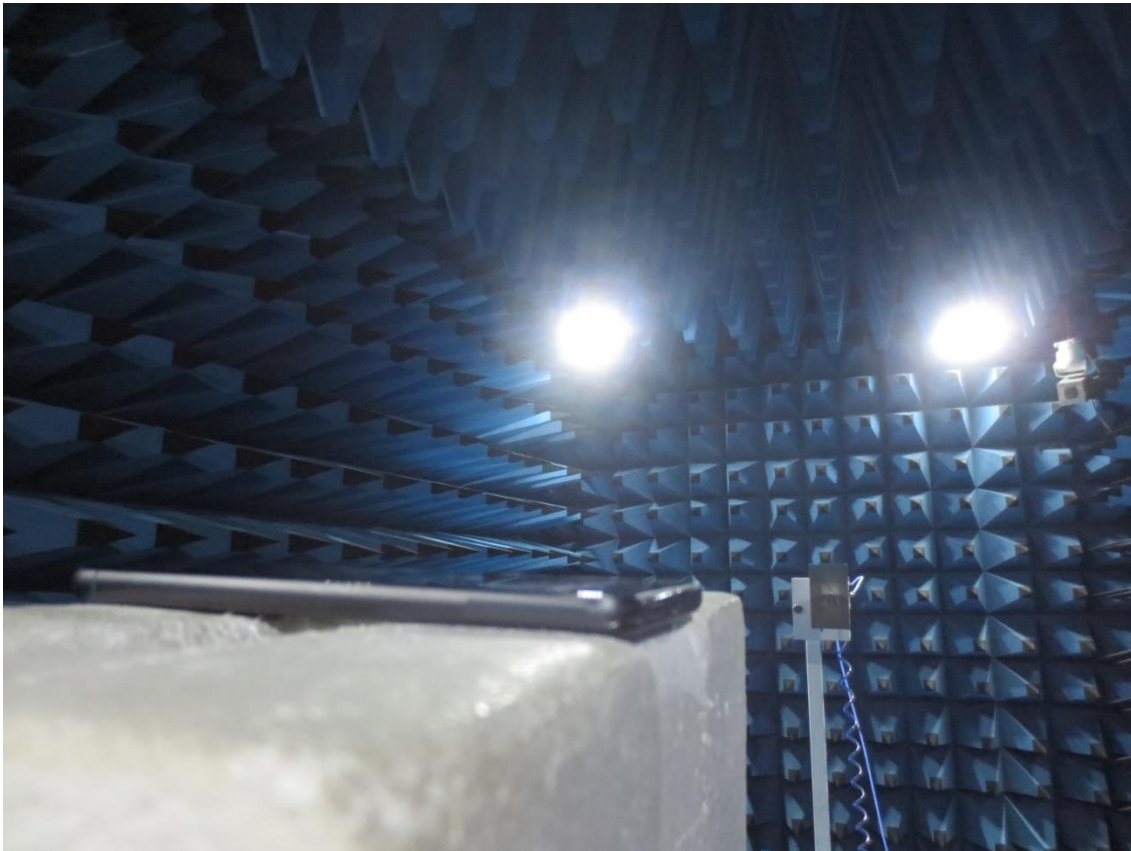


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

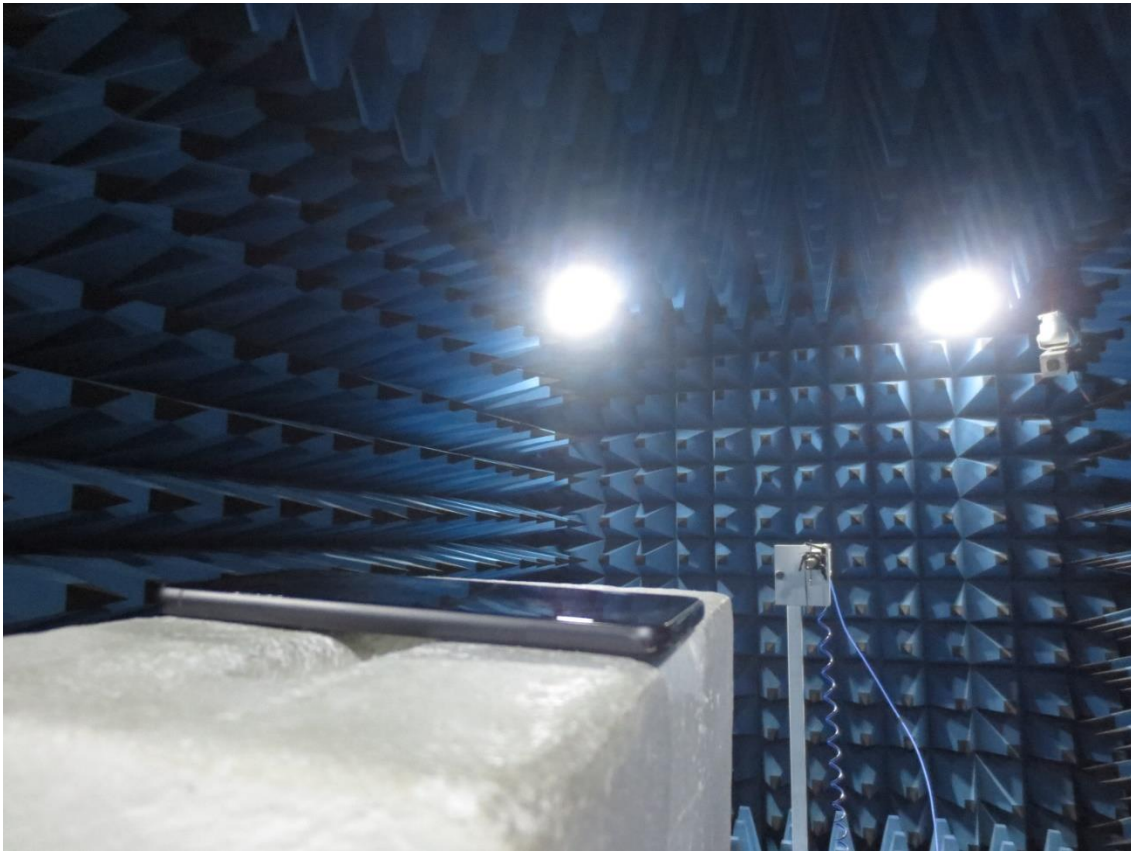


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

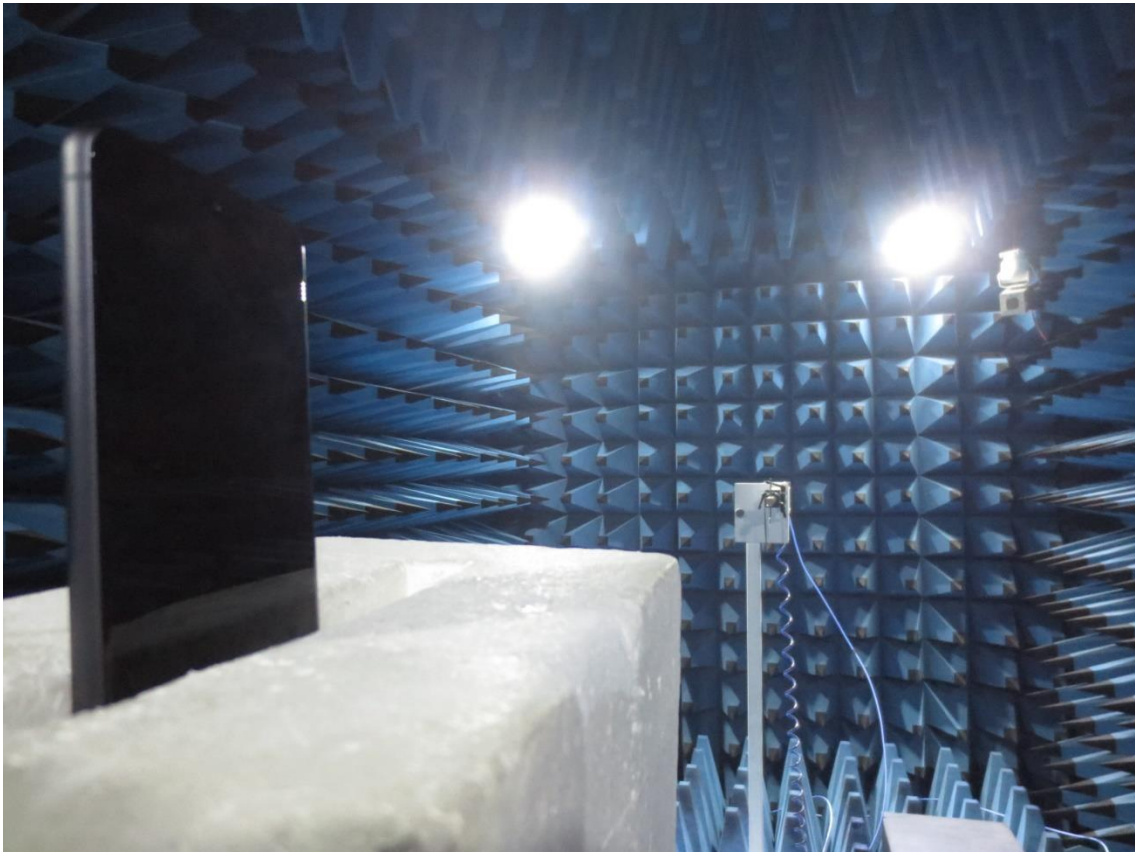


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

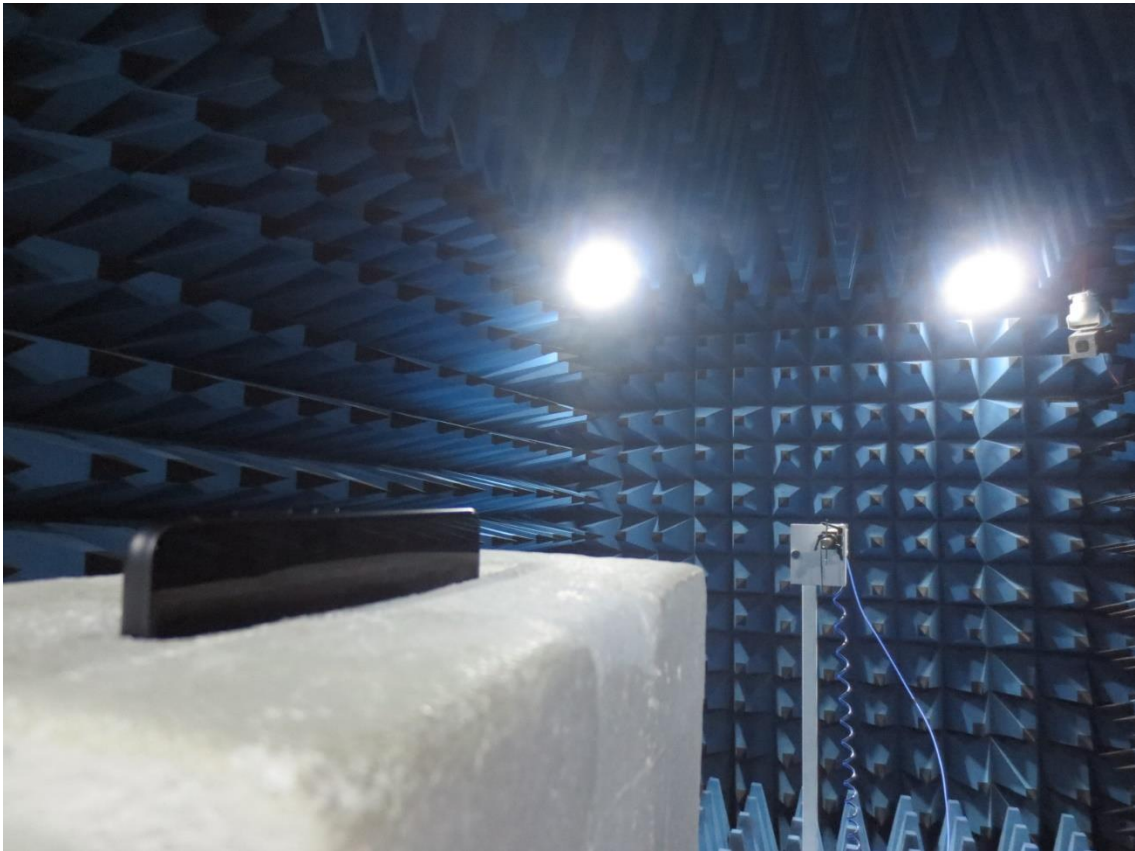


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

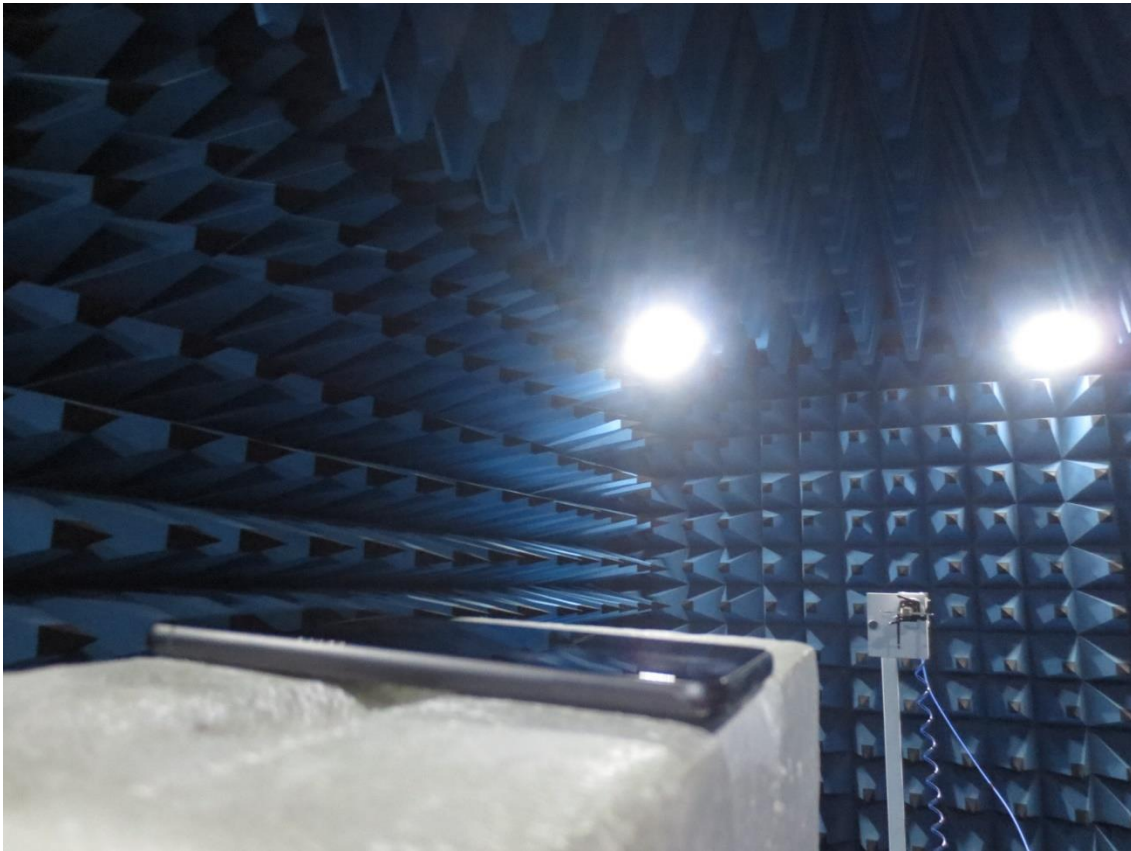


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

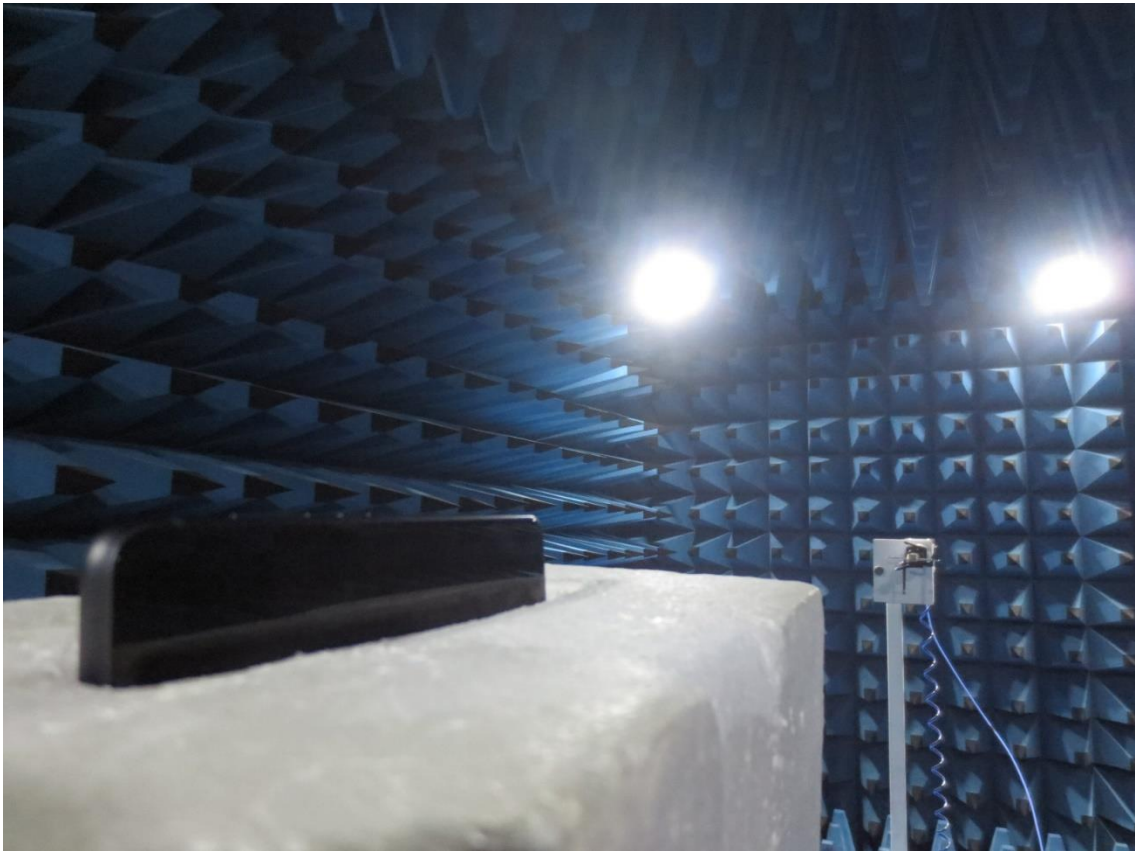


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

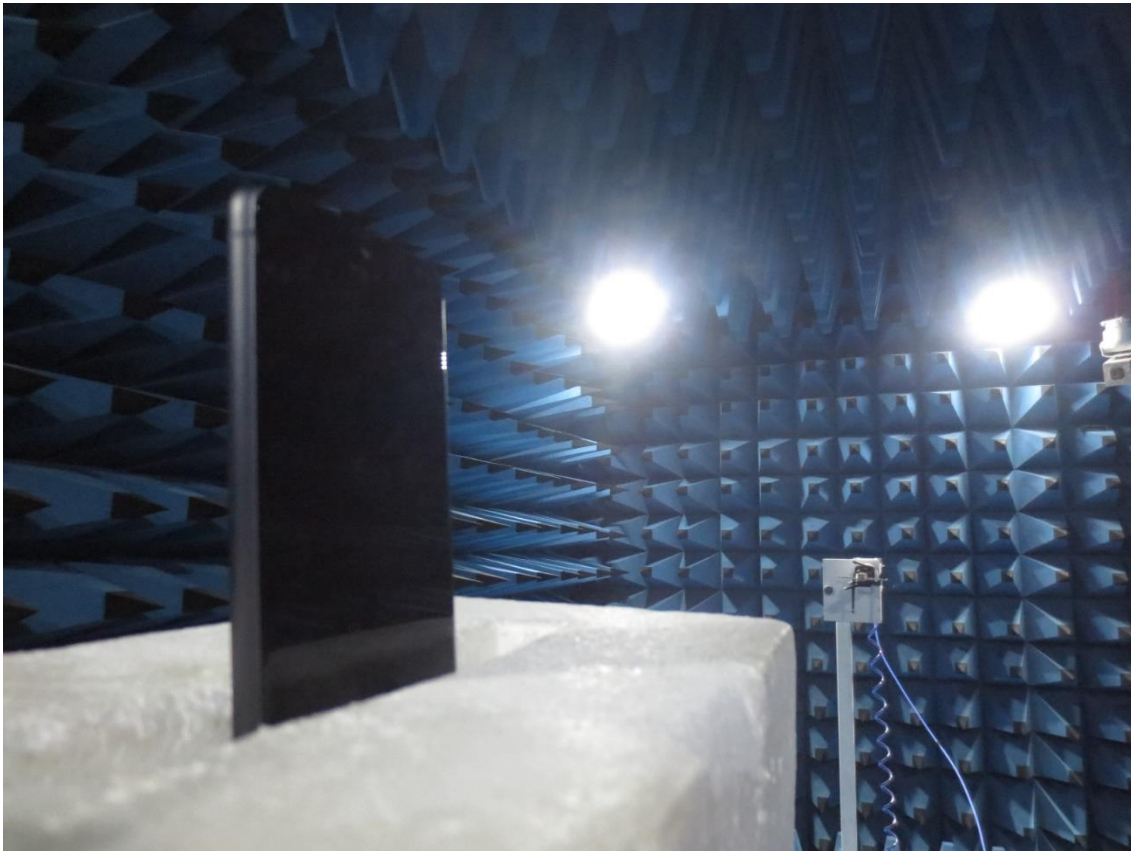


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

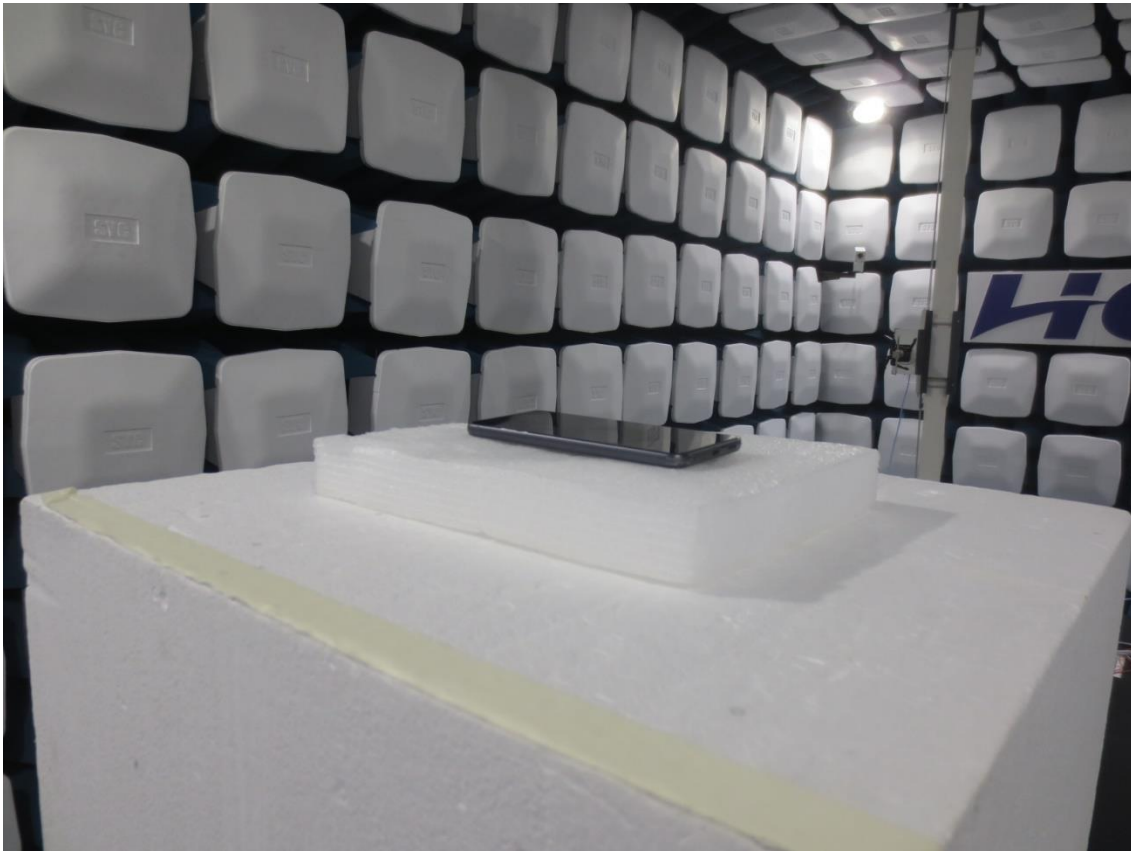


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

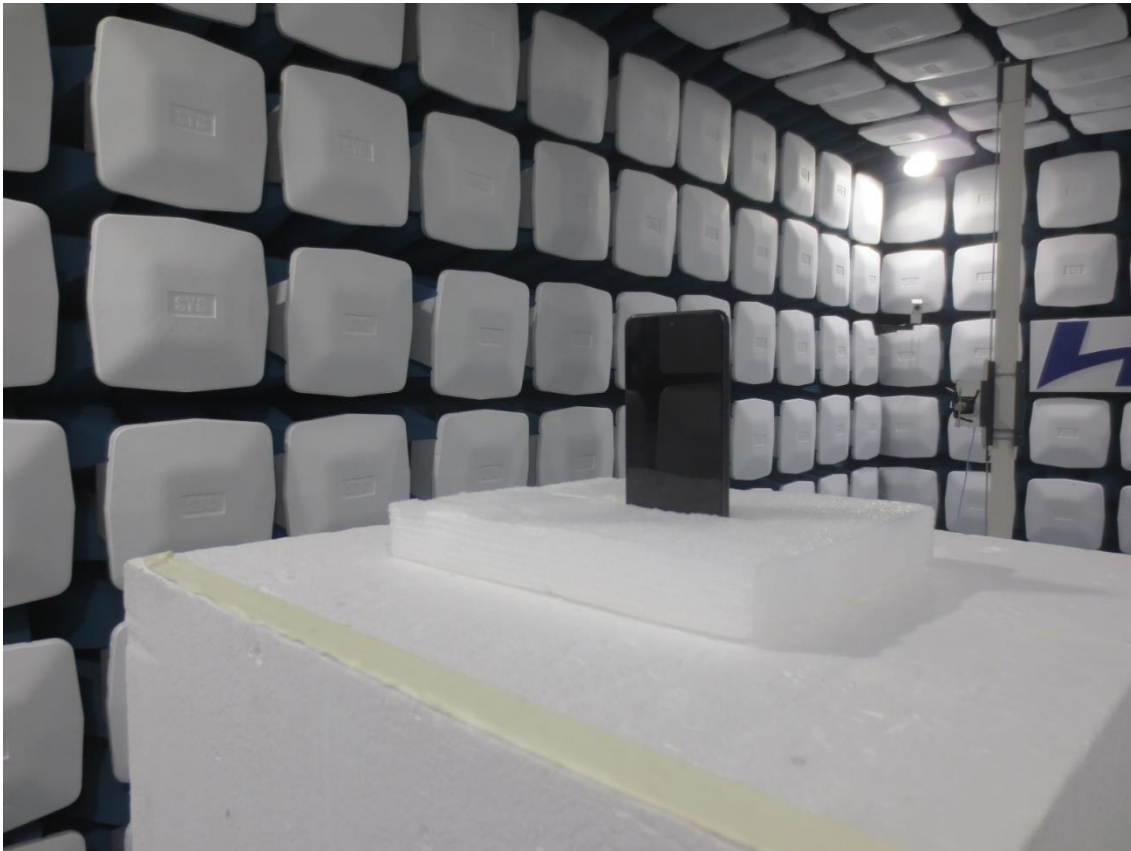


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

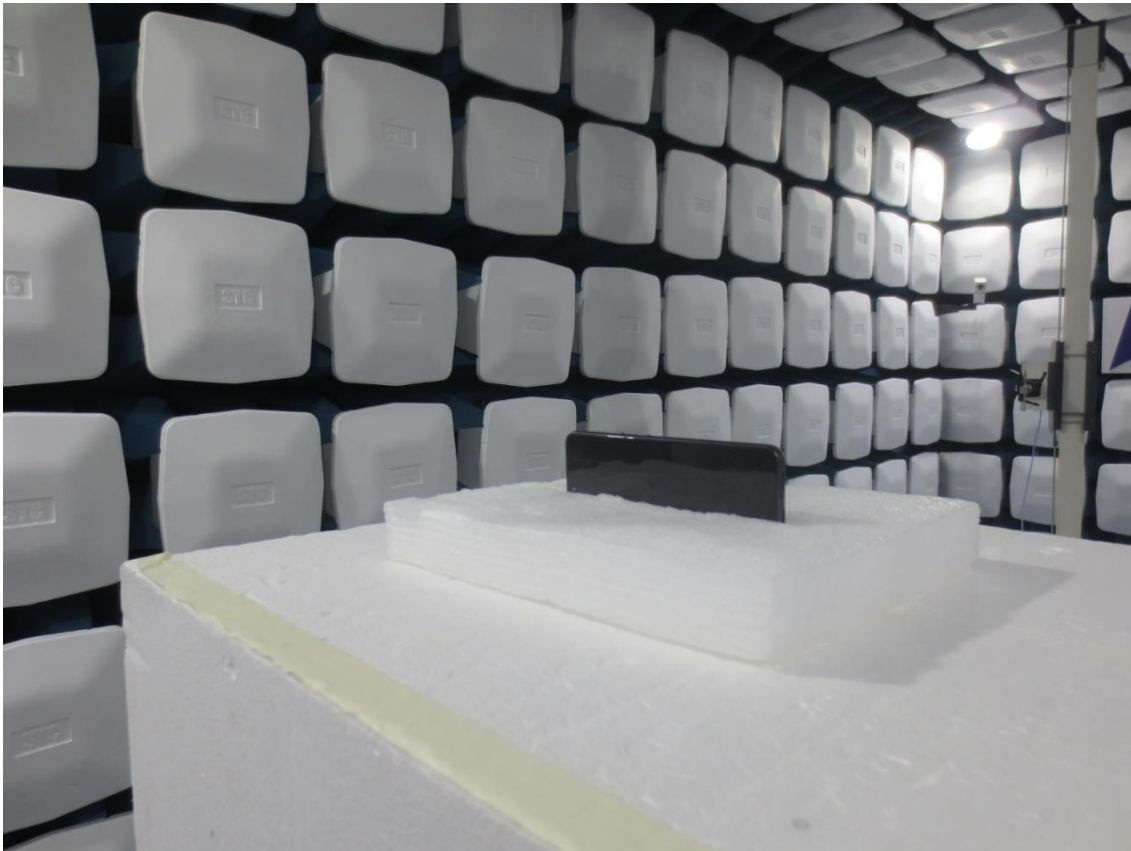


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

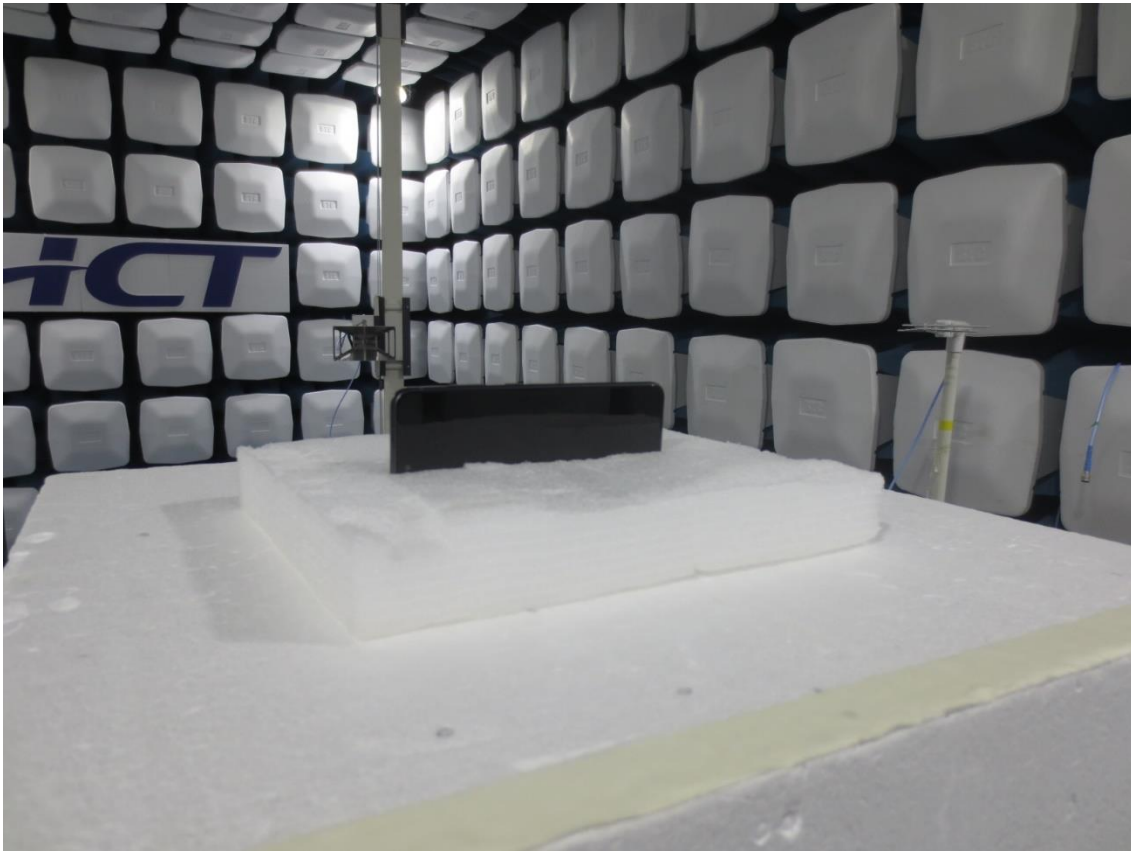


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

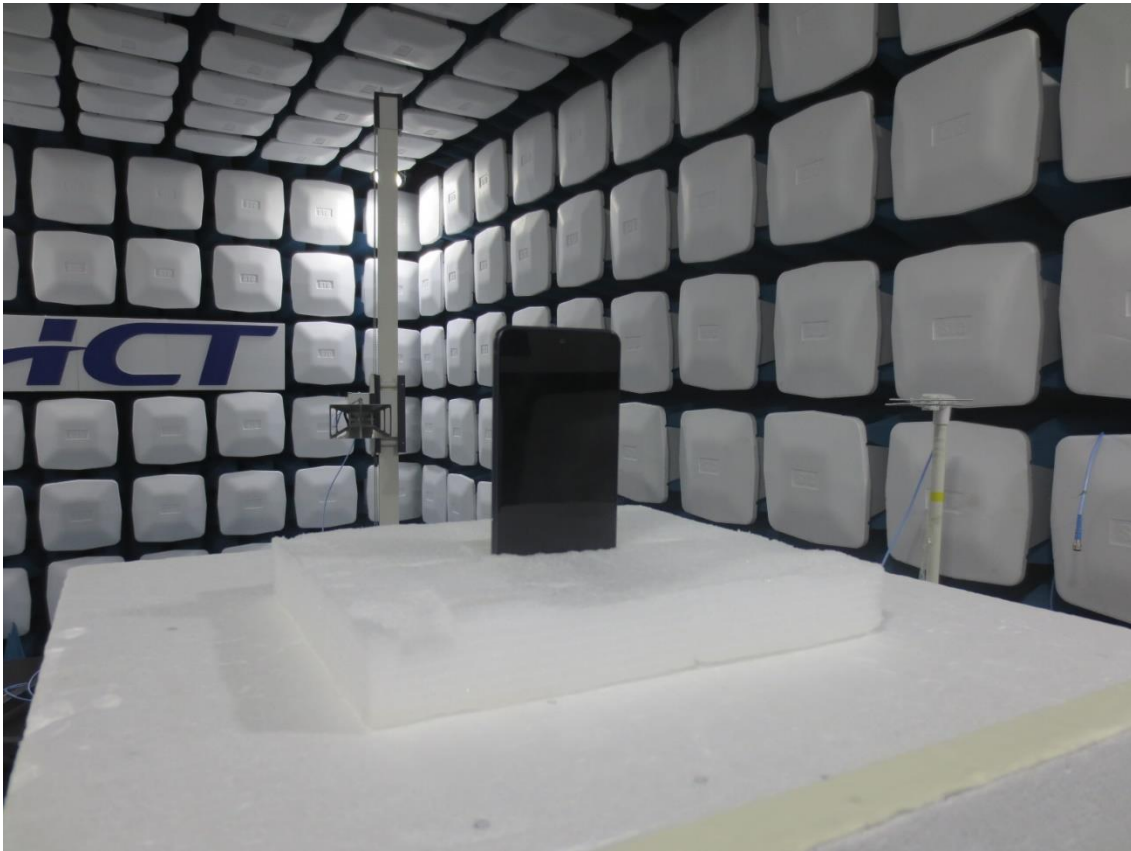


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

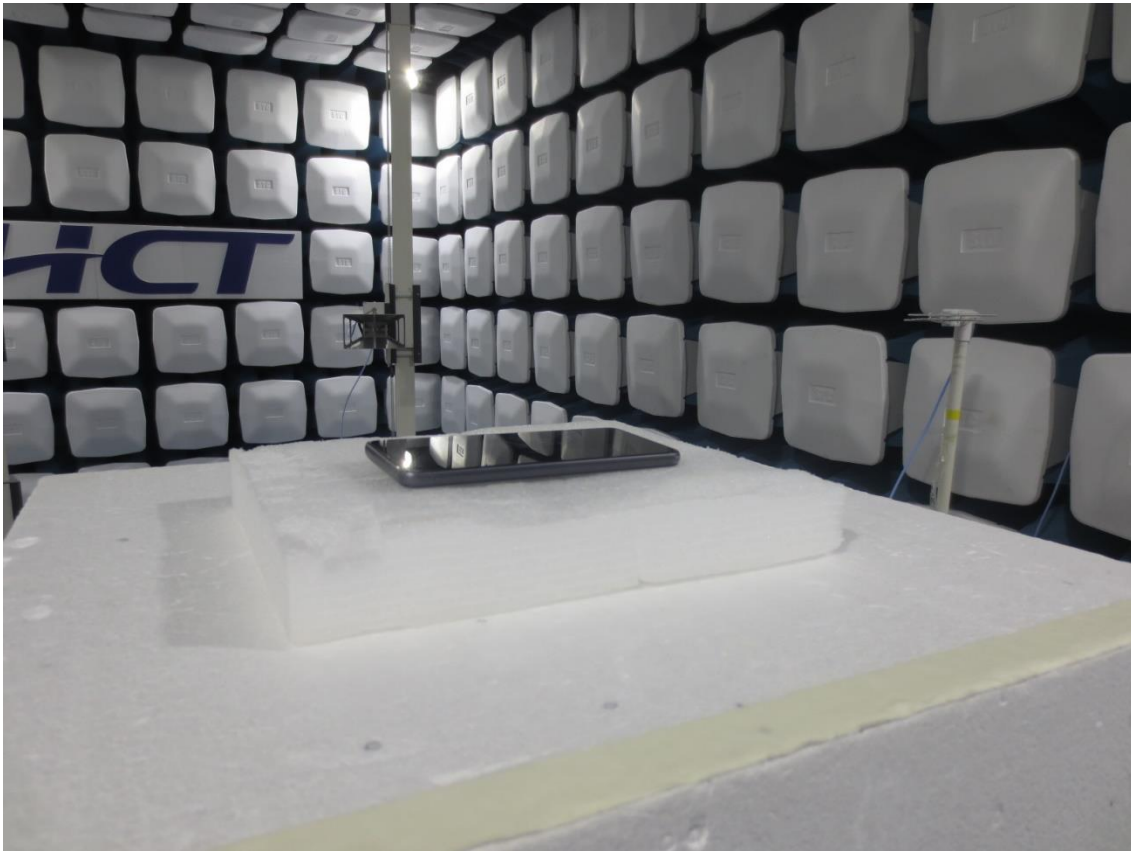


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

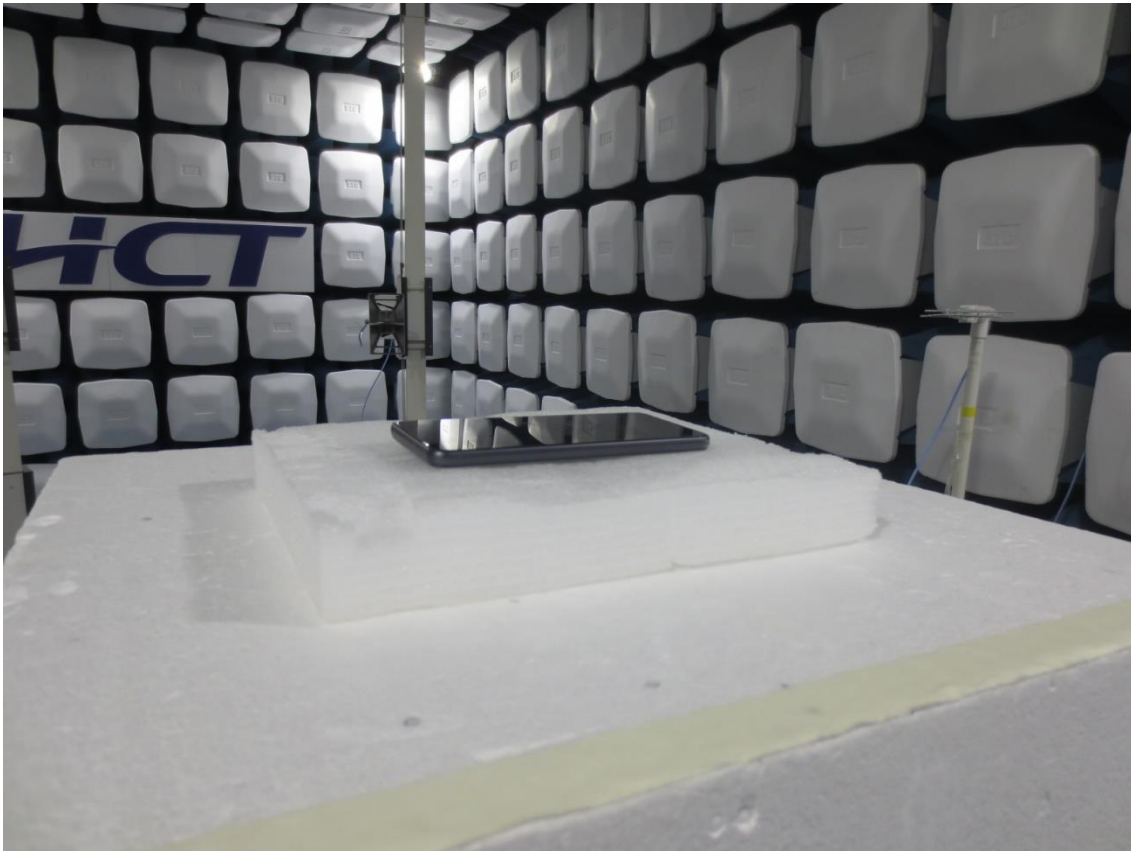


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

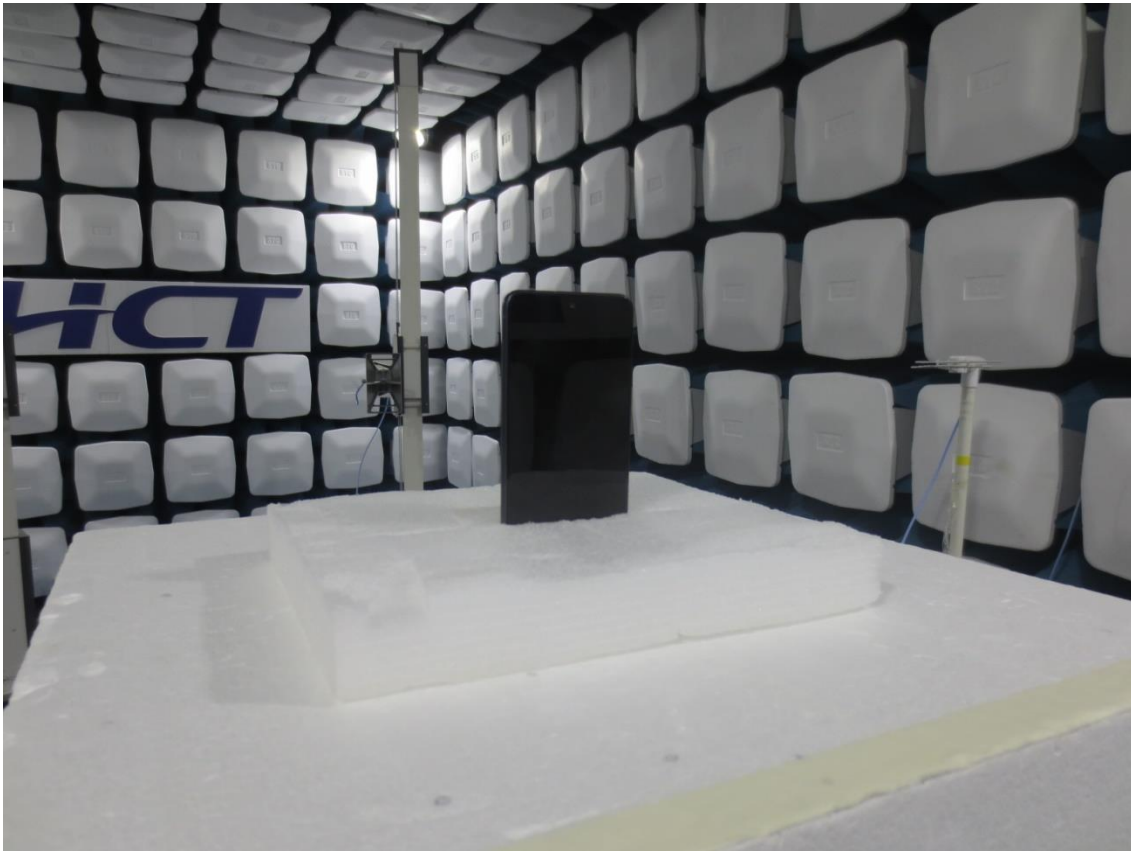


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

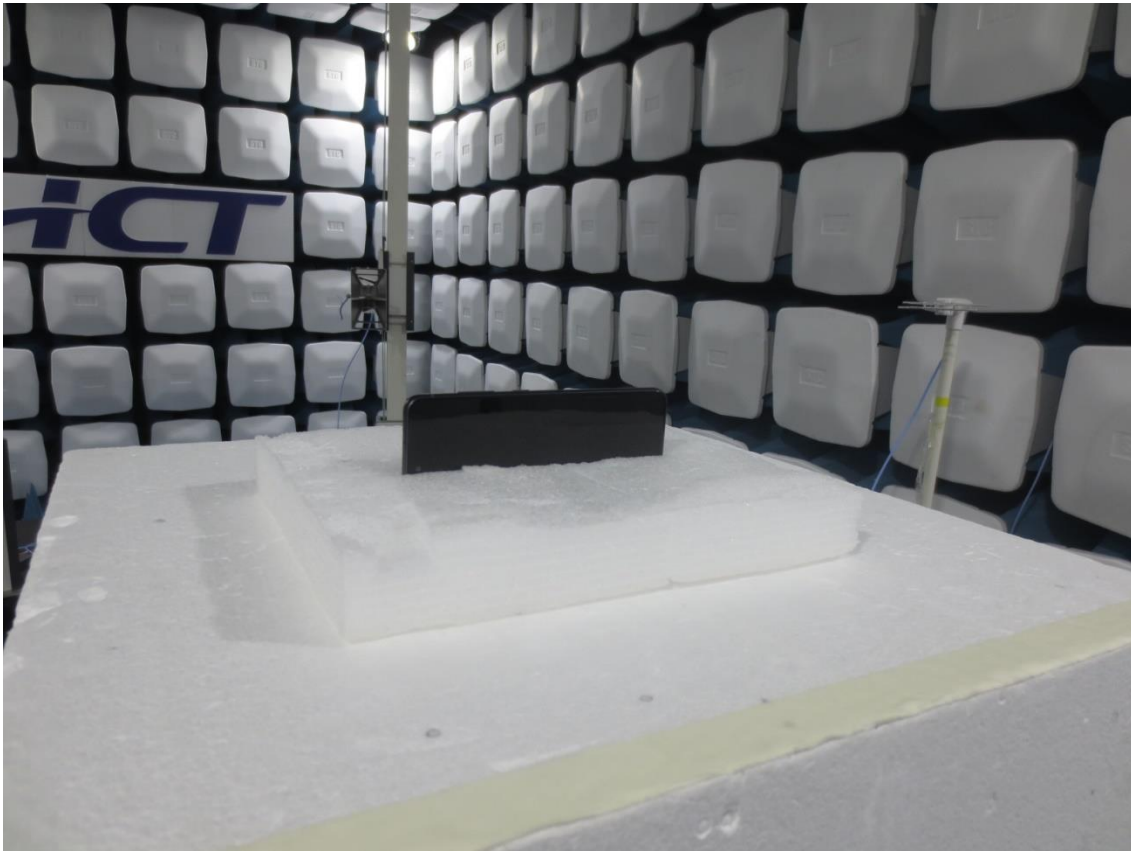


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

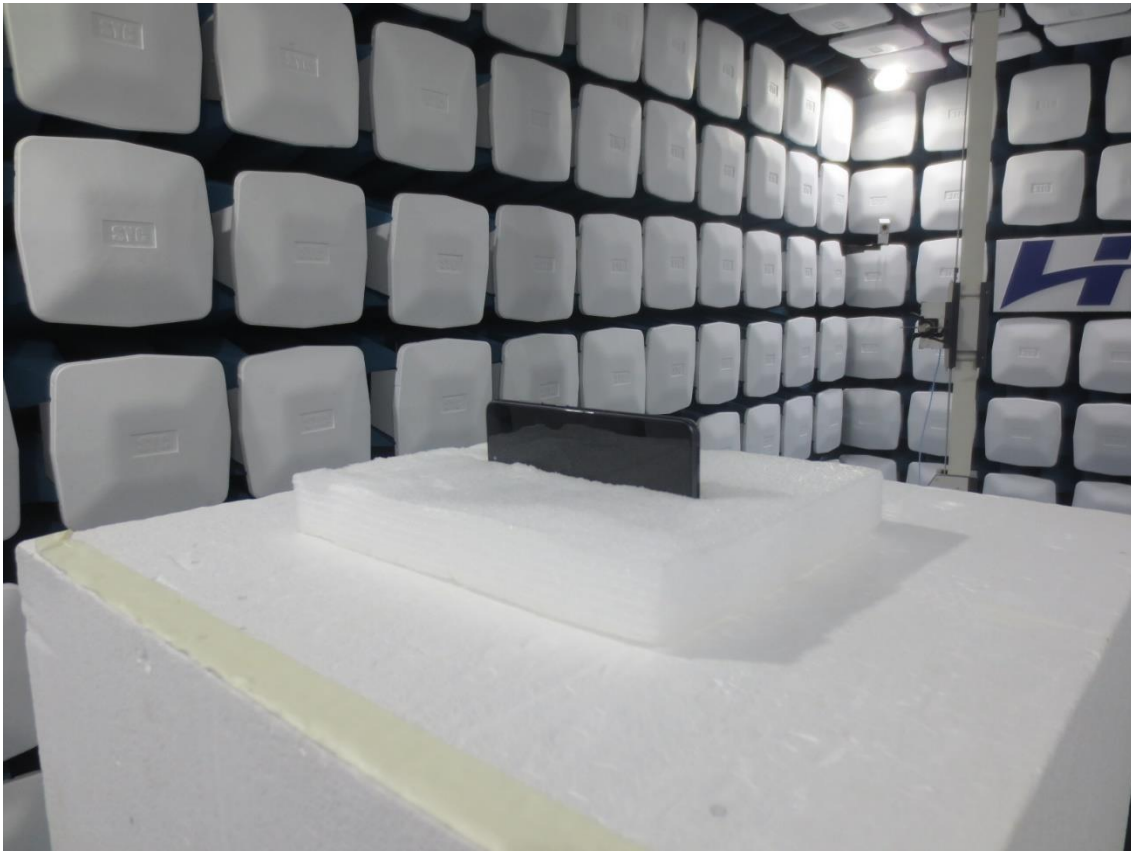

File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

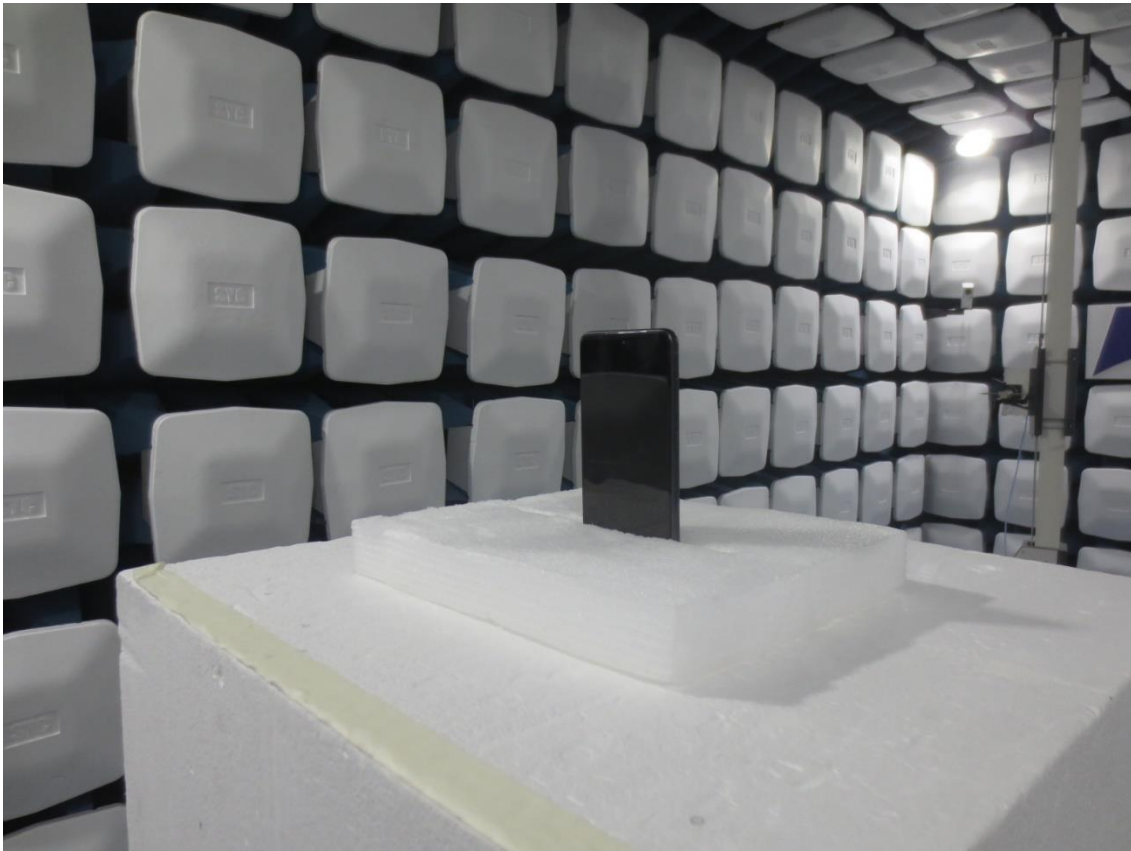


File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

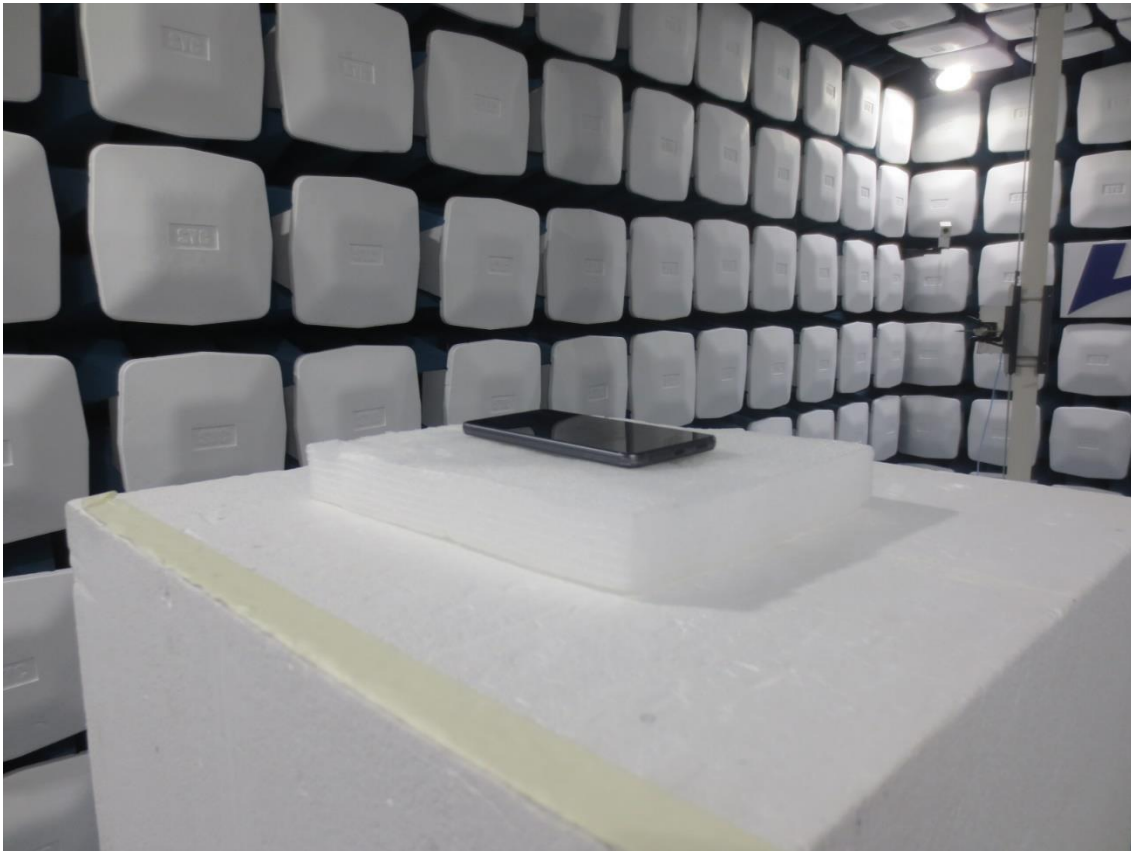

File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	

2. Conducted Test Setup Photo

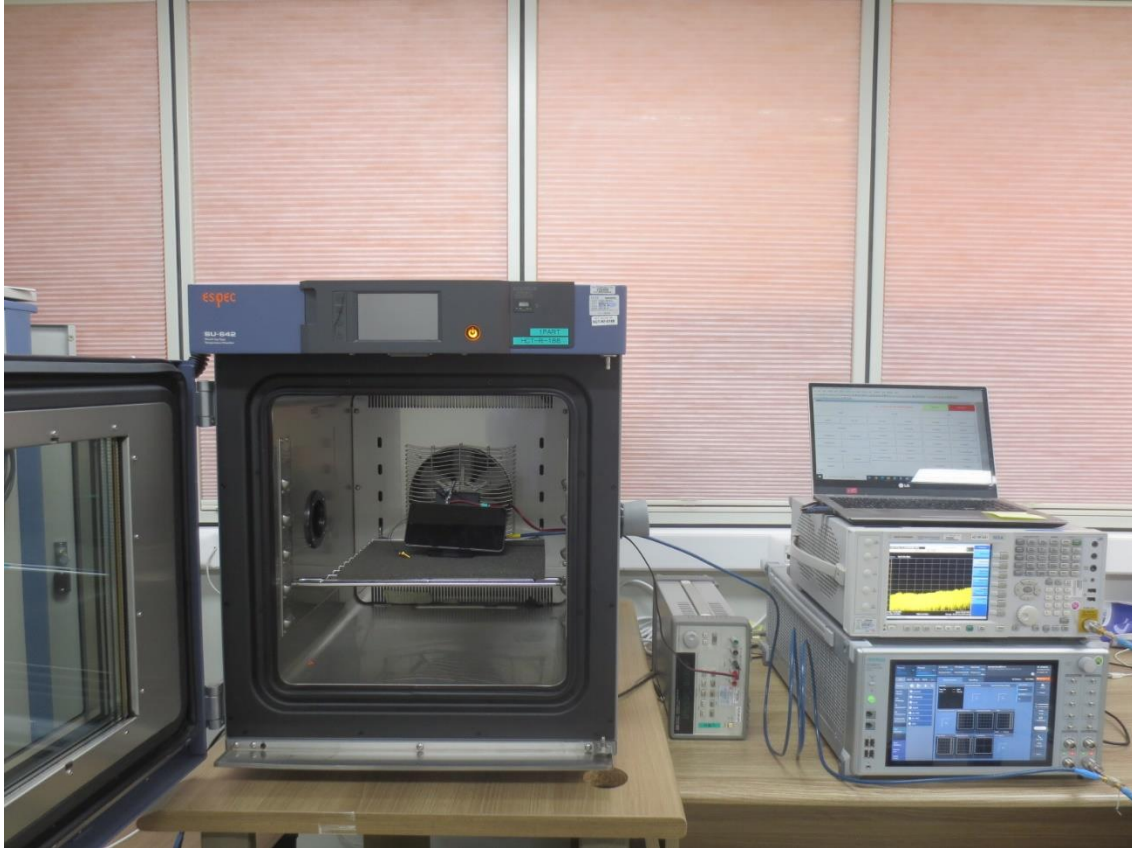

File	HCT-RF-2206-FC001-P	HCT-RF-2206-FC002-P	HCT-RF-2206-FC016-P	HCT-RF-2206-FC017-P	HCT-RF-2206-FC018-P
No.	HCT-RF-2206-FC019-P	HCT-RF-2206-FC020-P	HCT-RF-2206-FC021-P	HCT-RF-2206-FC022-P	