



HCT Co., Ltd.

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

<h1 style="margin: 0;">Appendix A:</h1> <h2 style="margin: 0;">Test Setup</h2> <h3 style="margin: 0;">Photo</h3>	<p>FCC ID A3LSMM325FV</p> <p>File No. HCT-RF-2105-FC049-P HCT-RF-2105-FC053-P HCT-RF-2105-FC050-P HCT-RF-2105-FC054-P HCT-RF-2105-FC051-P HCT-RF-2105-FC055-P HCT-RF-2105-FC052-P</p>
--	---


REVISION HISTORY

The revision history for this document is shown in table.

Revision No.	Date of Issue	Description
0	May 27, 2021	Initial Release

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			


1. Radiated Test Setup Photo

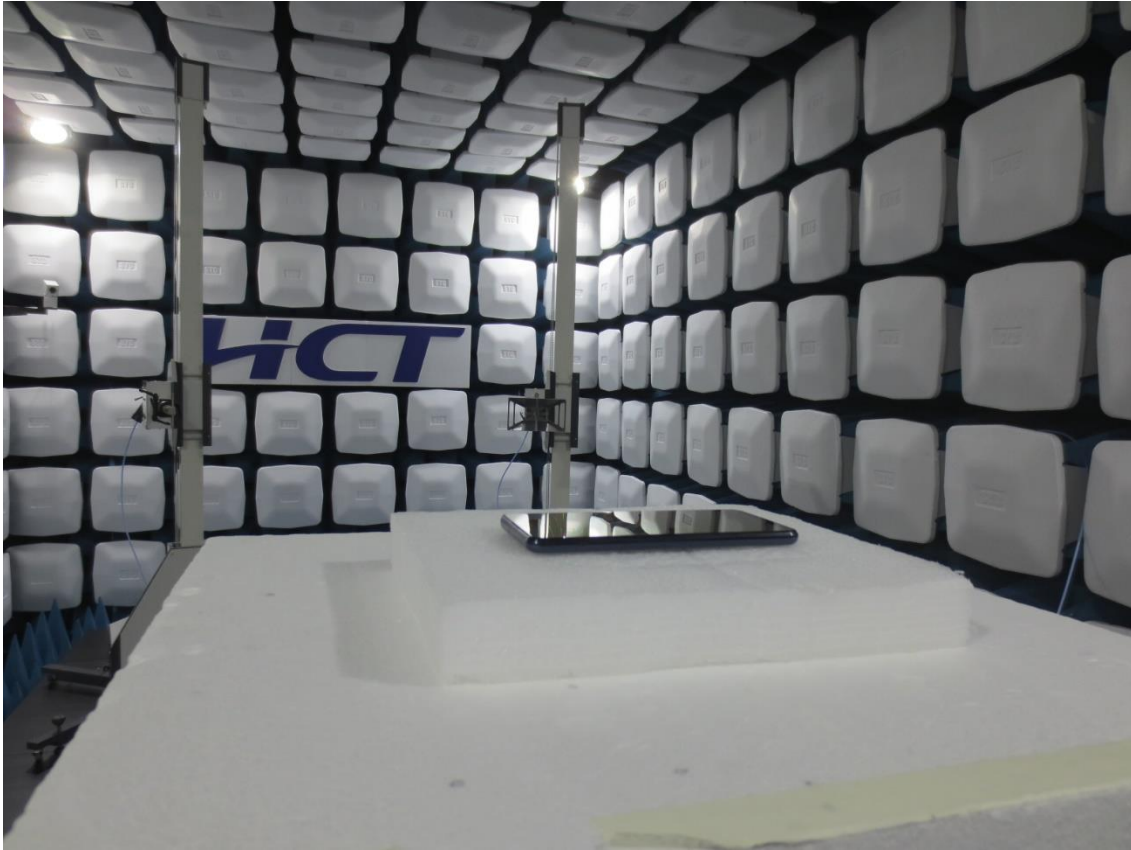

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			




File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

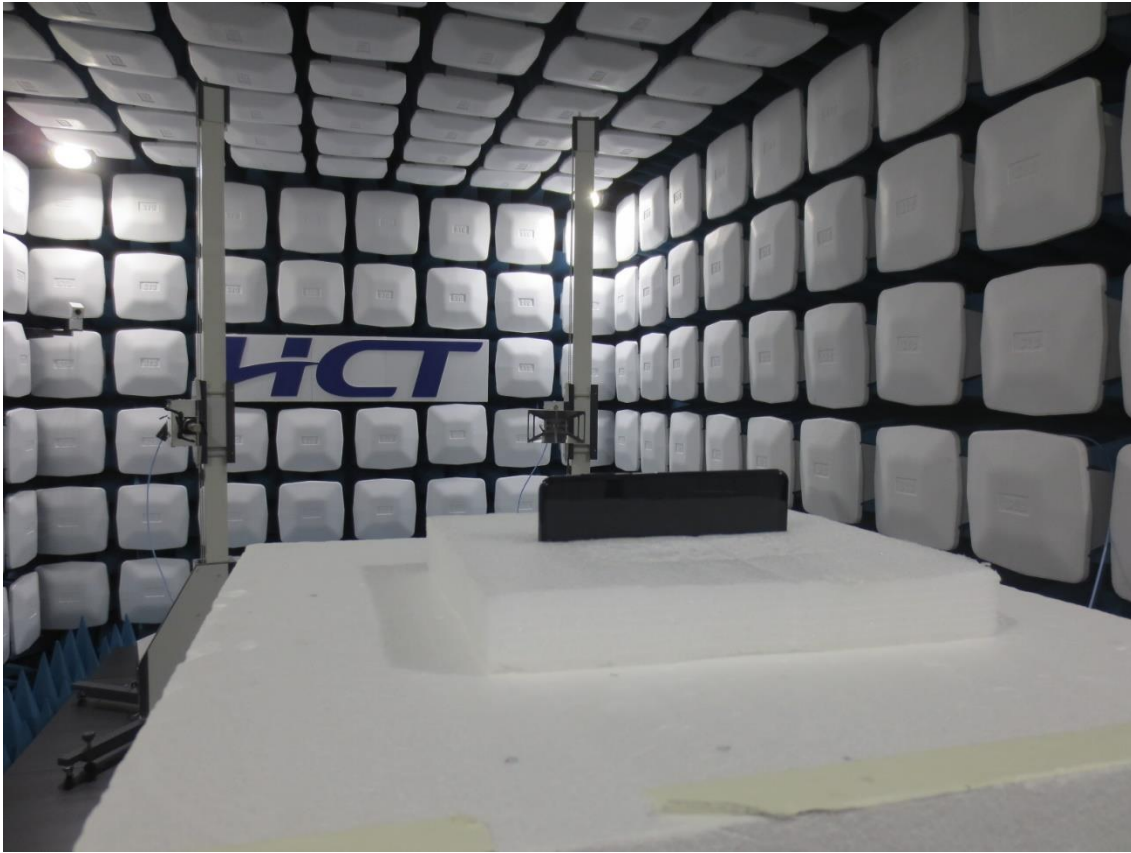


File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			




File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

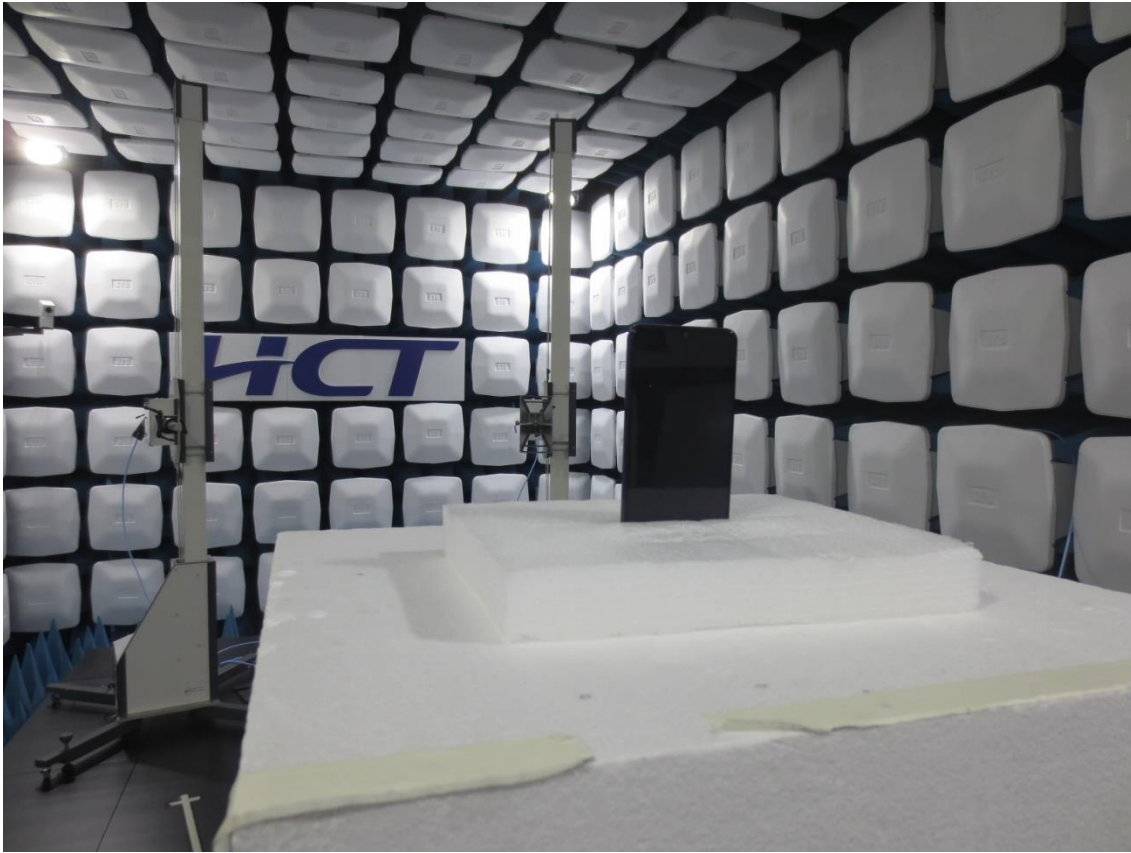


File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

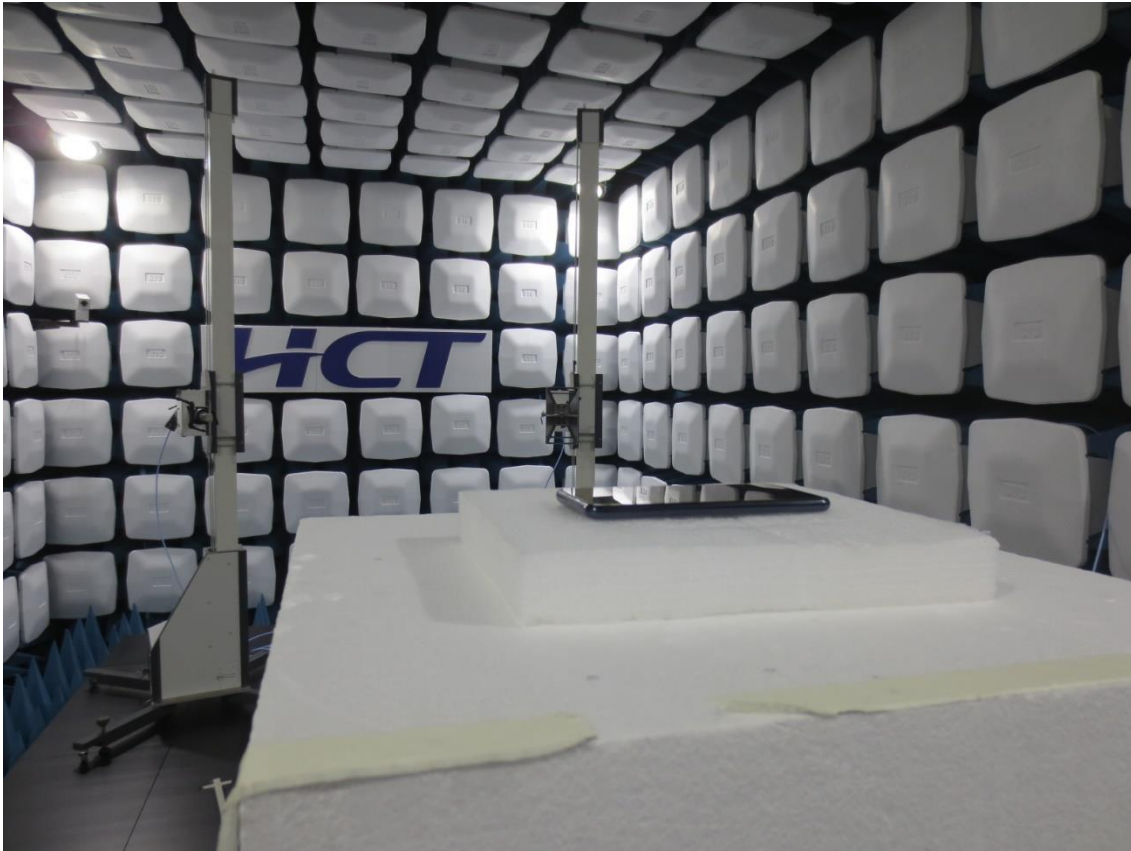

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

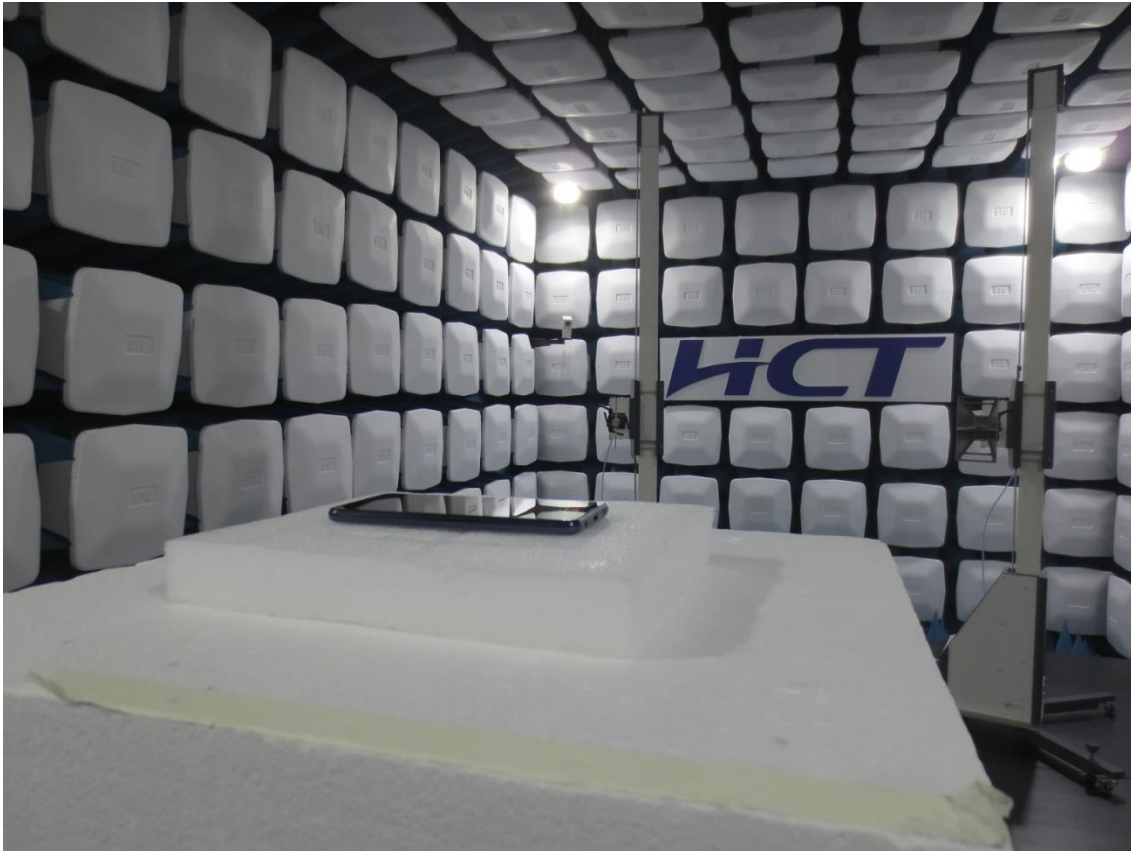


File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

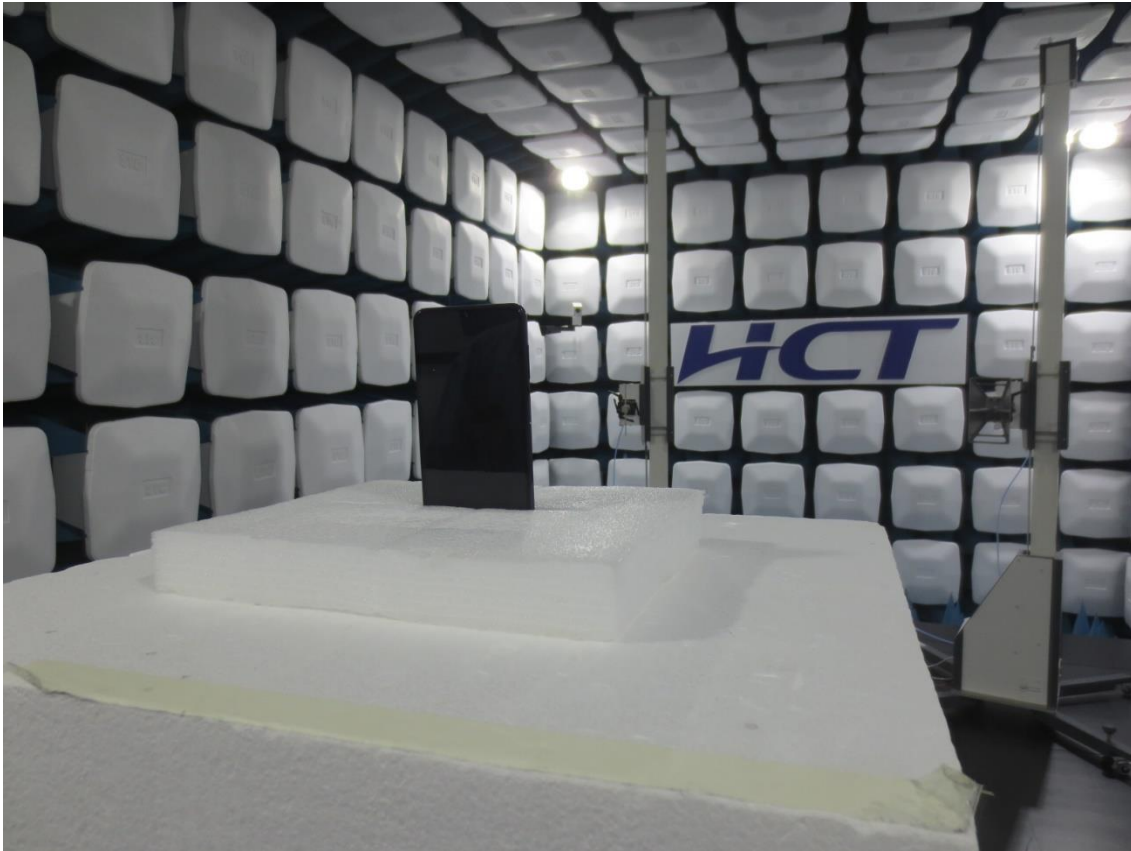


File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			




File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

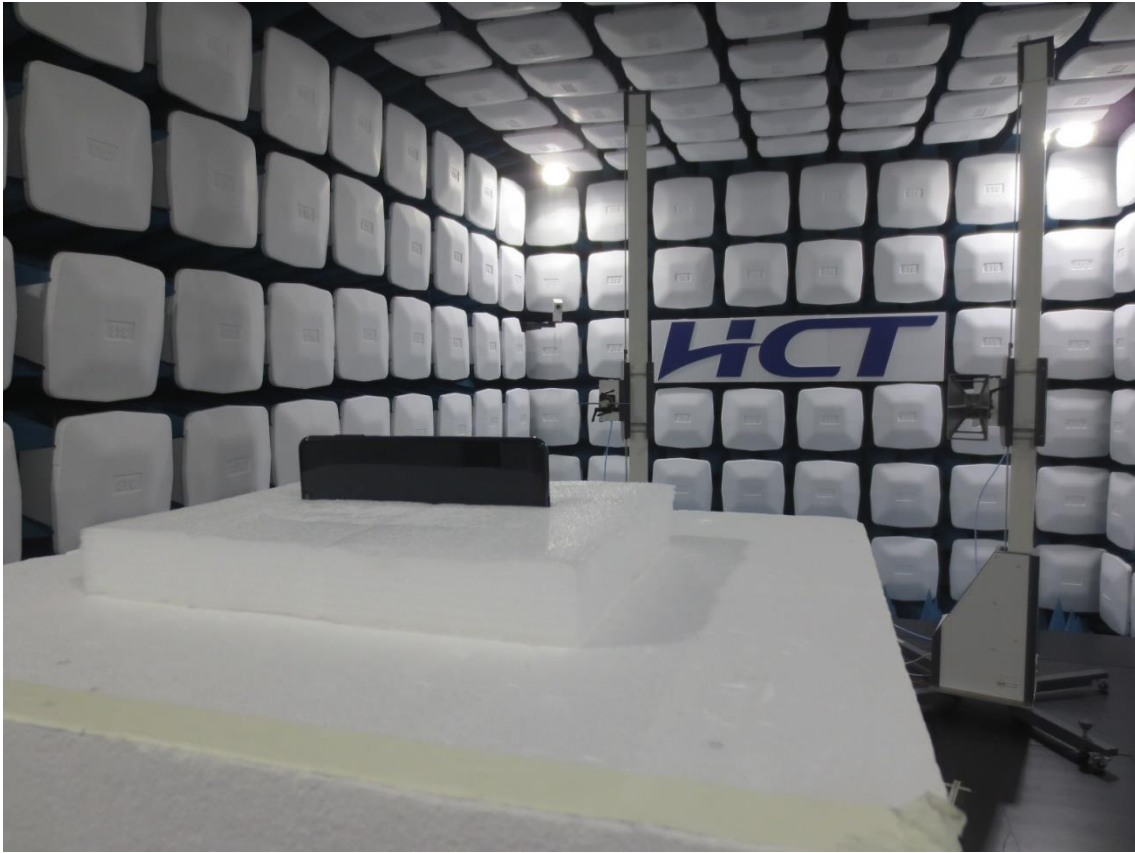

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

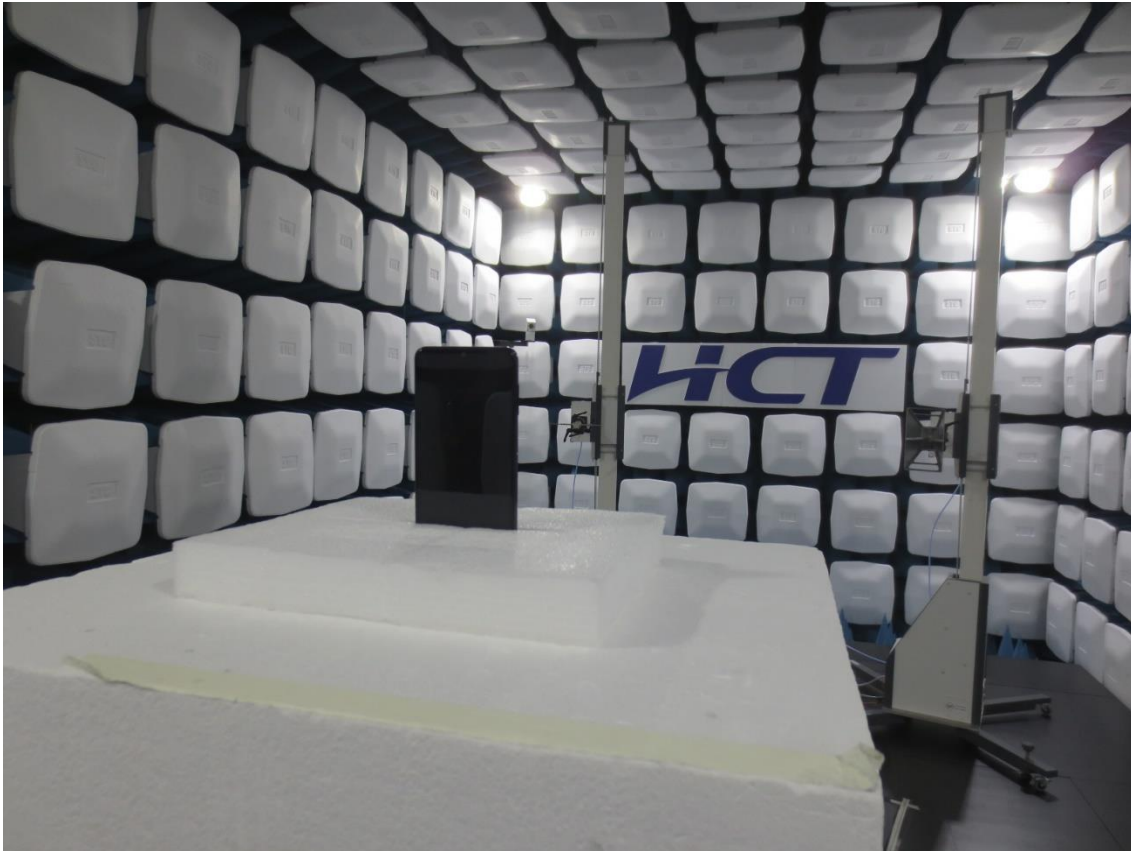


File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

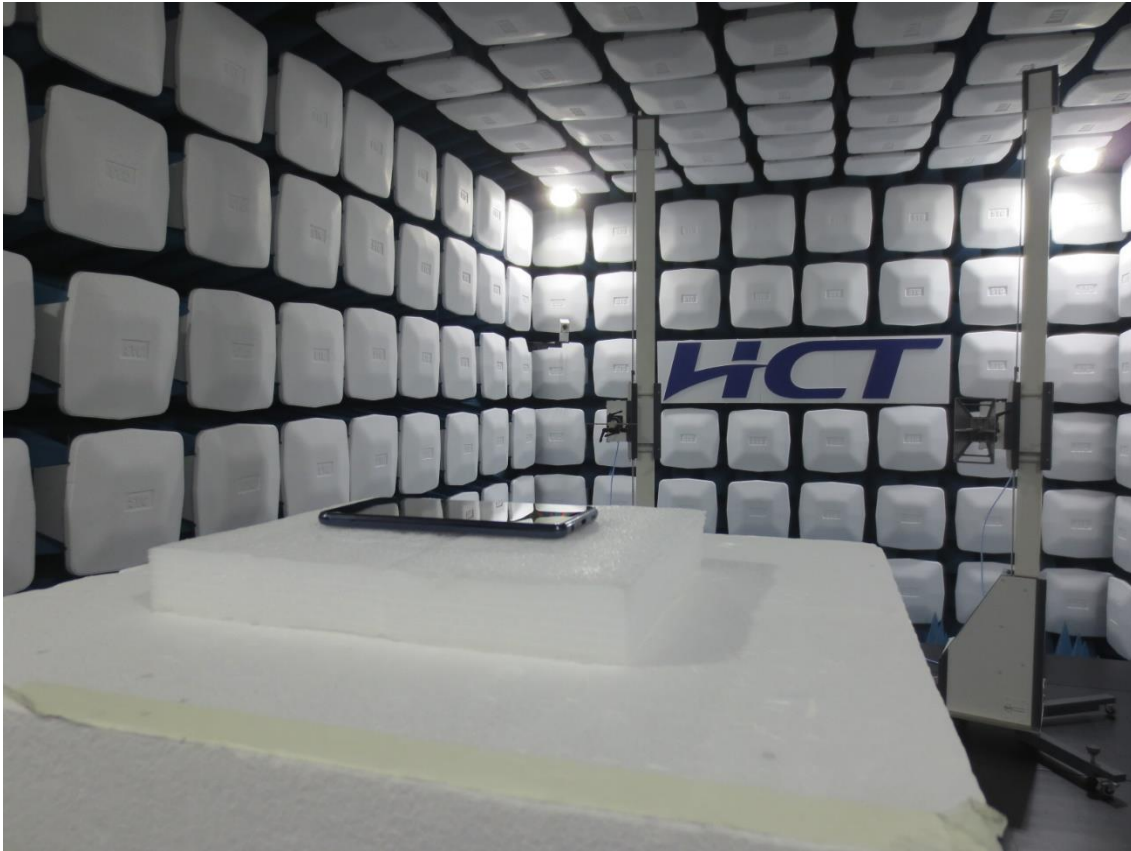

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			

2. Conducted Test Setup Photo

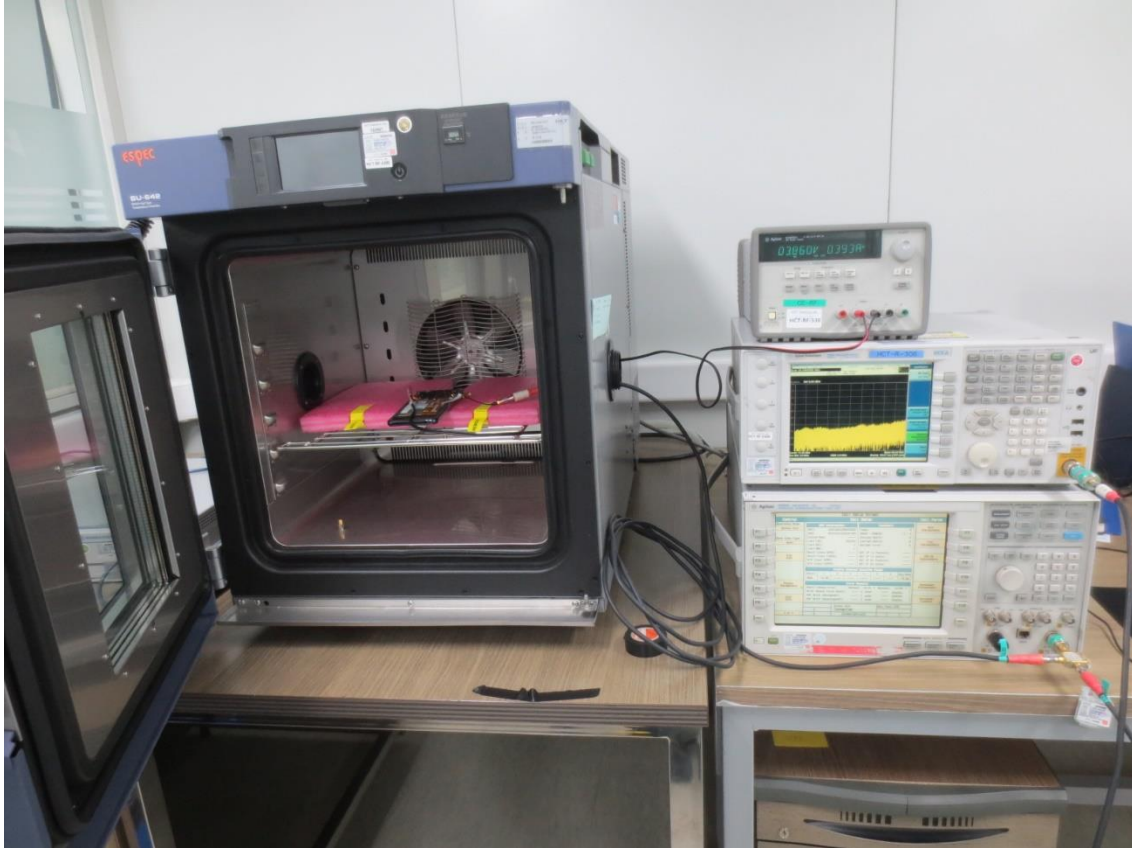

File	HCT-RF-2105-FC049-P	HCT-RF-2105-FC050-P	HCT-RF-2105-FC051-P	HCT-RF-2105-FC052-P	HCT-RF-2105-FC053-P
No.	HCT-RF-2105-FC054-P	HCT-RF-2105-FC055-P			