



**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA  
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A:  
Test Setup  
Photo

FCC ID  
A3LSMN980F1

File No.

HCT-RF-2110-FC038-P	HCT-RF-2110-FC042-P	HCT-RF-2110-FC046-P
HCT-RF-2110-FC039-P	HCT-RF-2110-FC043-P	HCT-RF-2110-FC047-P
HCT-RF-2110-FC040-P	HCT-RF-2110-FC044-P	
HCT-RF-2110-FC041-P	HCT-RF-2110-FC045-P	

**REVISION HISTORY**

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	October 29, 2021	Initial Release

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P


### 1. Radiated Test Setup Photo




File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

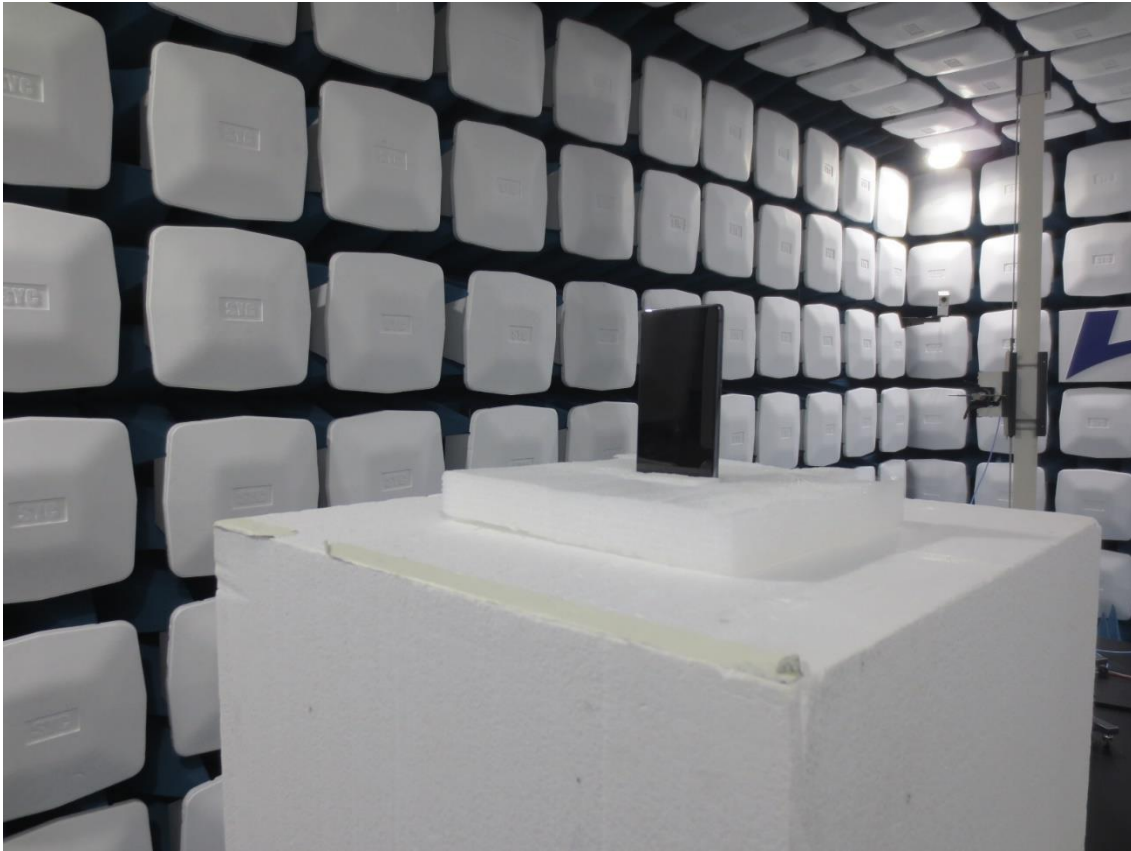


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

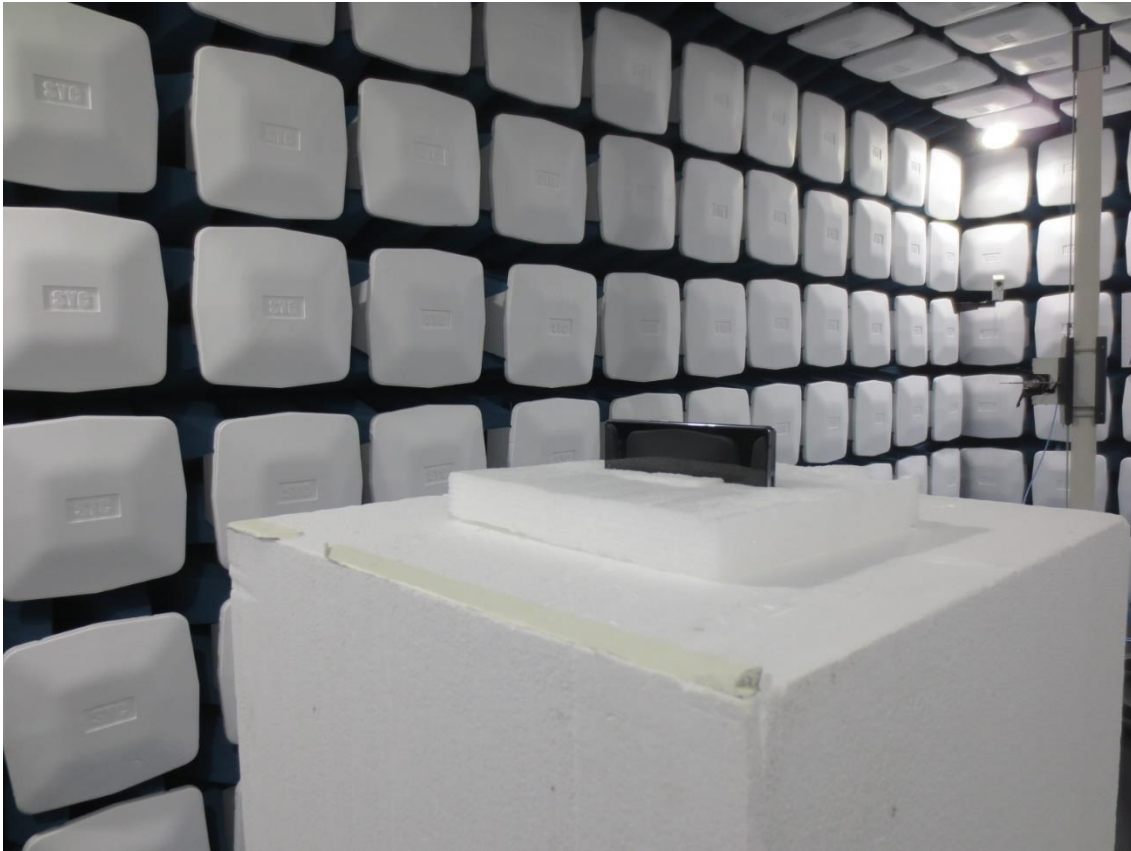

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

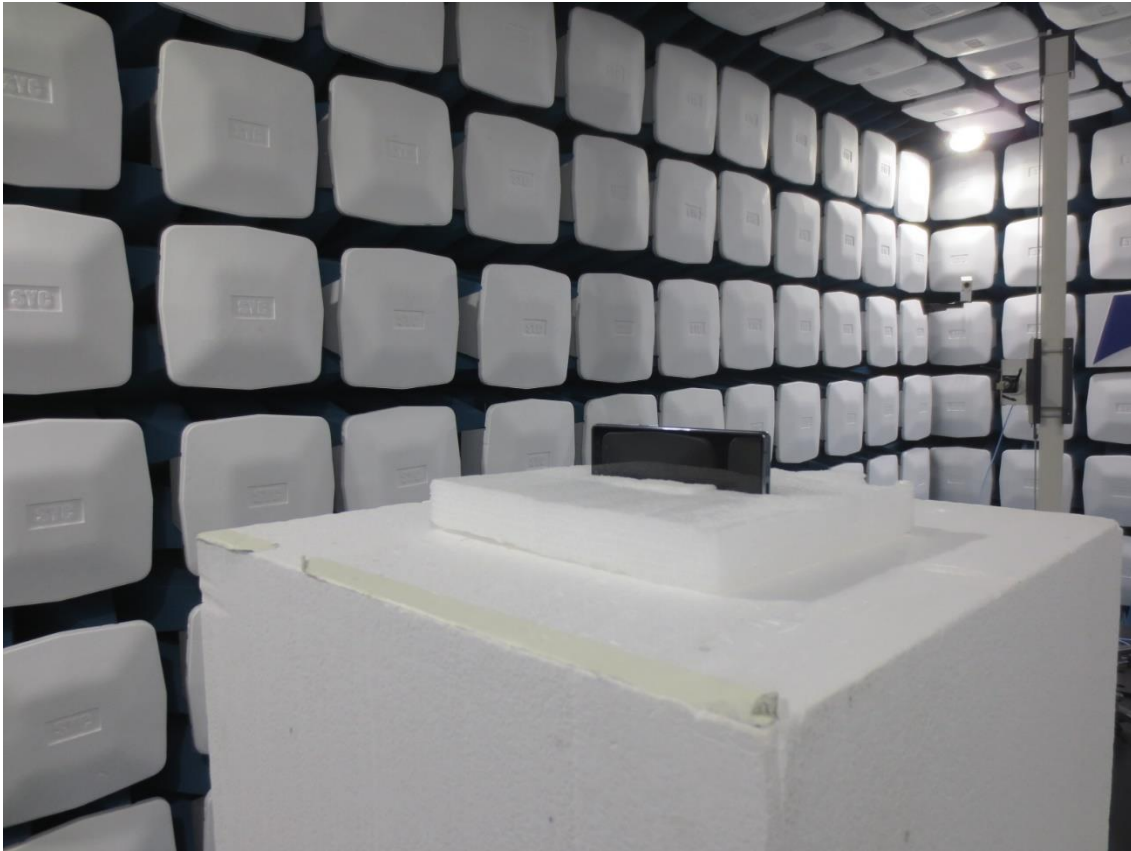


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

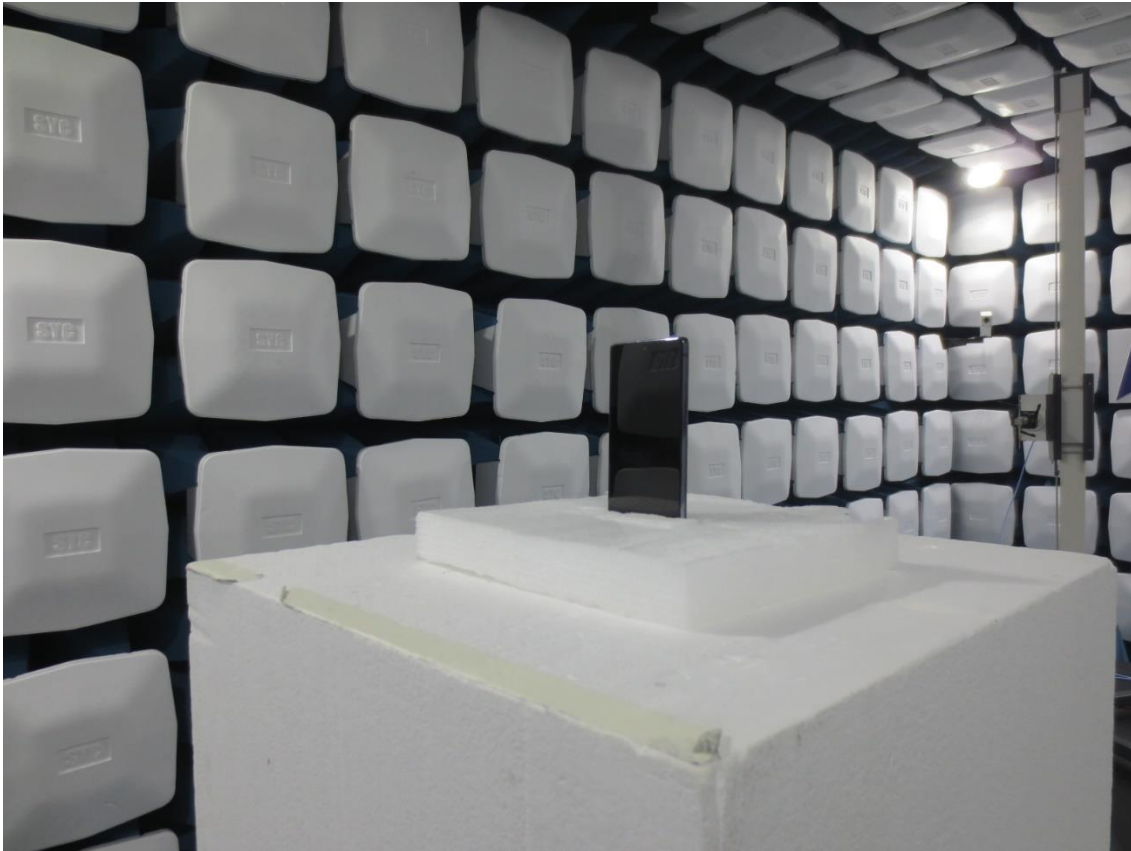

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P




File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

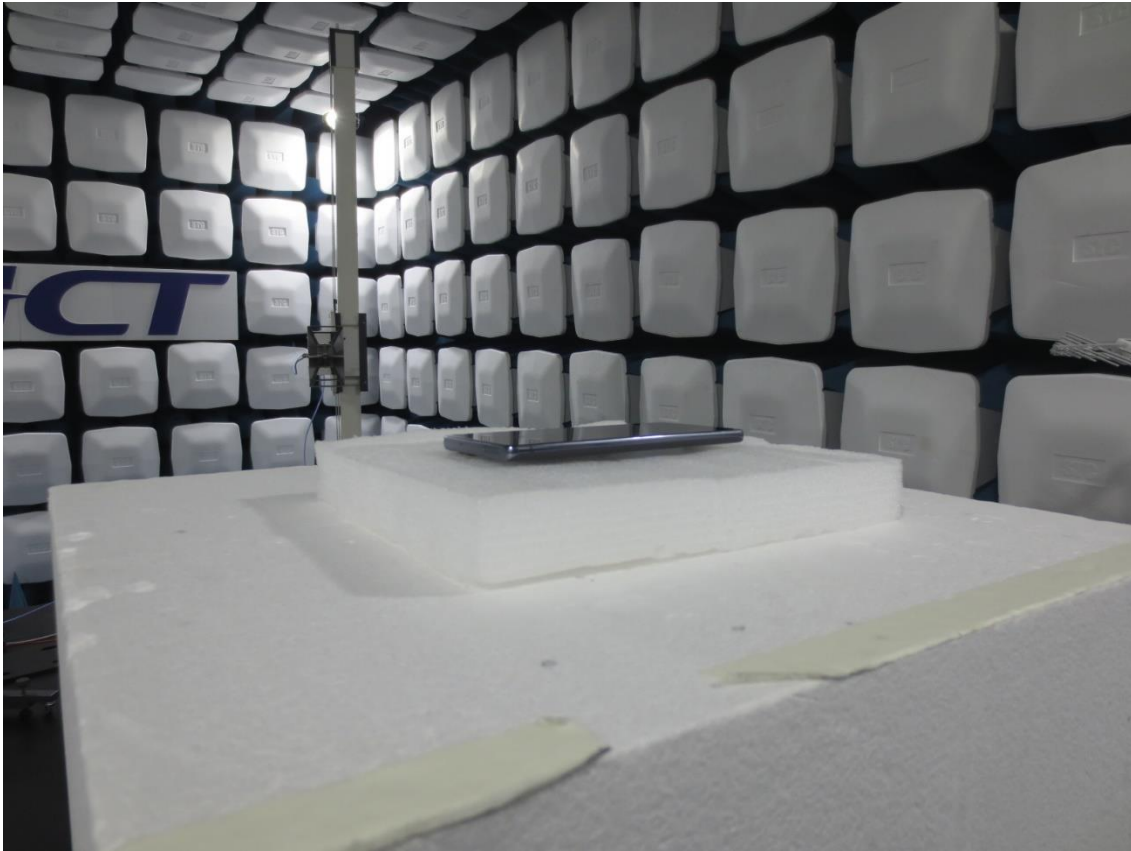


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P




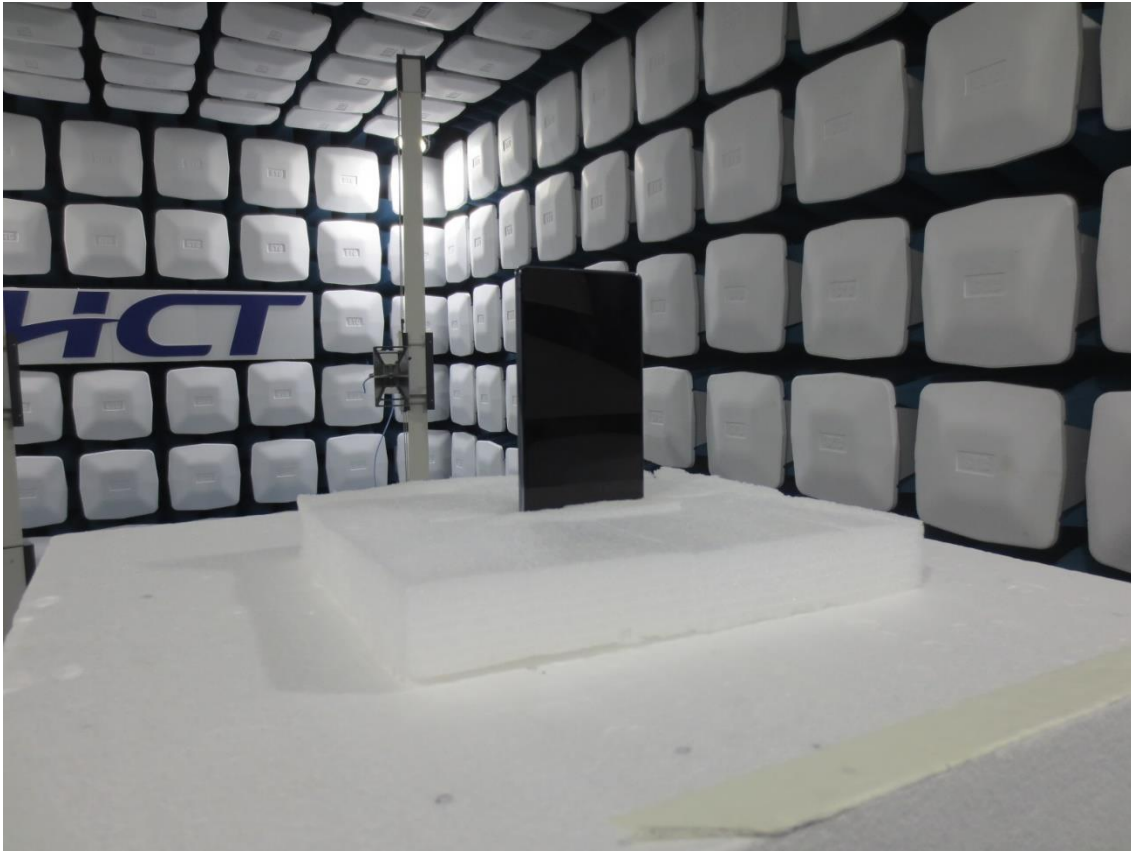


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

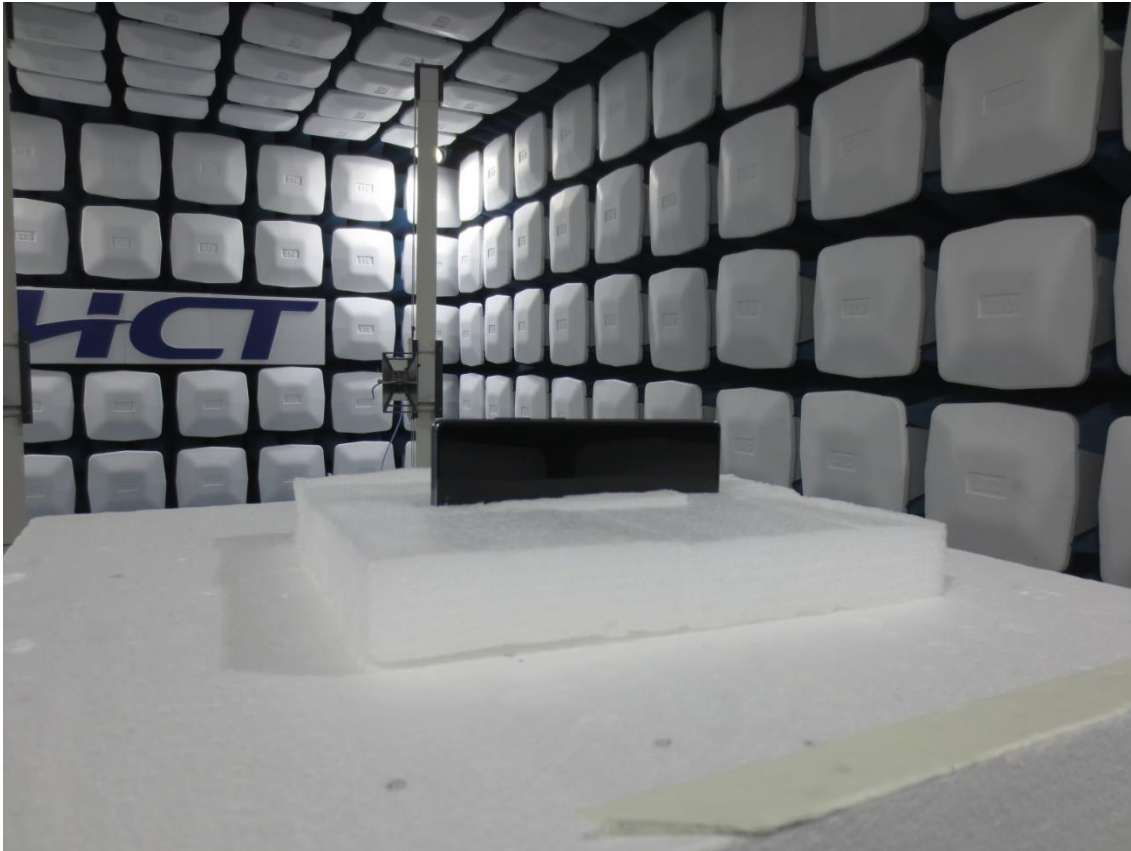


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

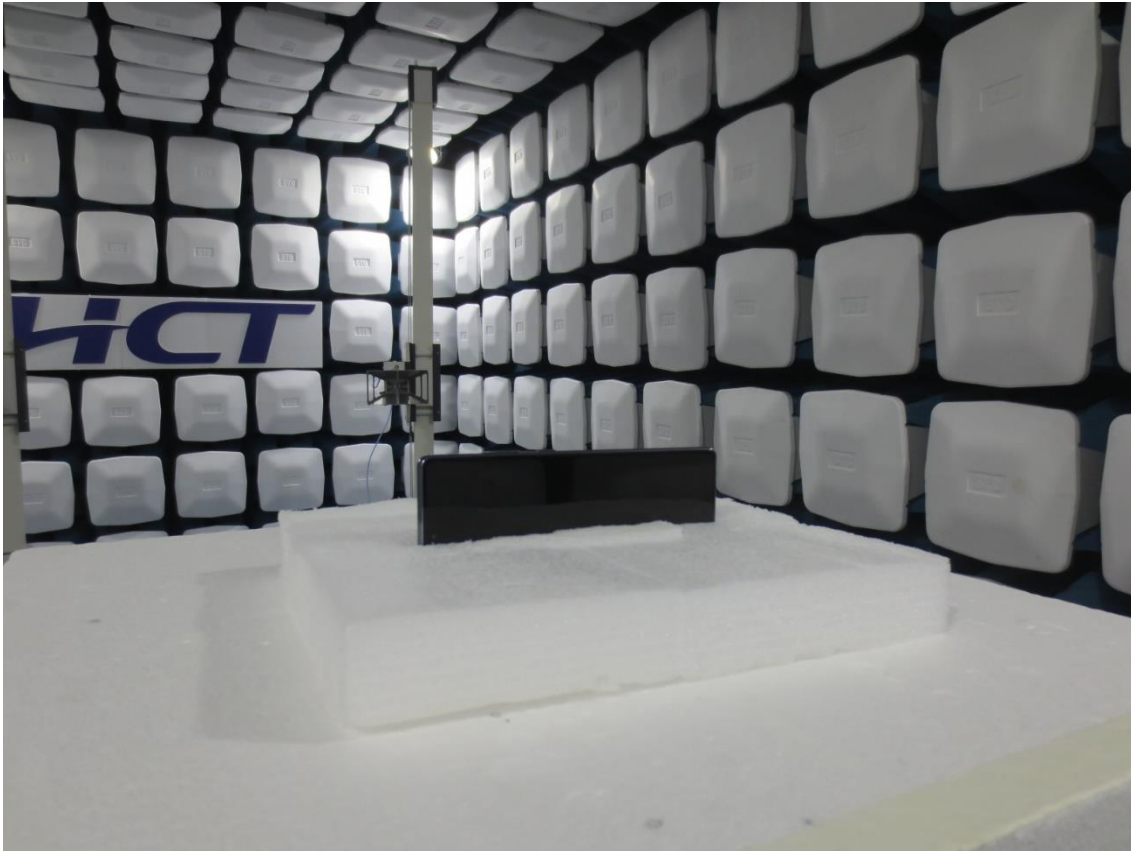

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

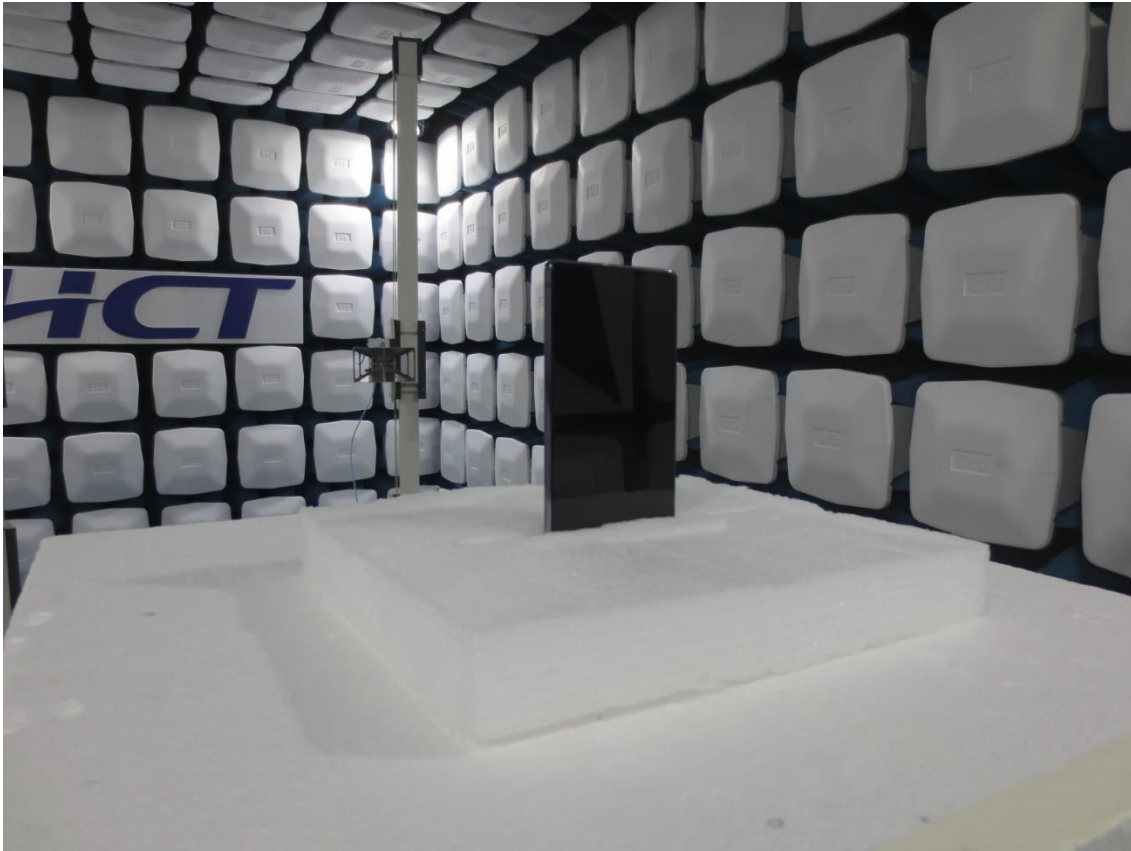


File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

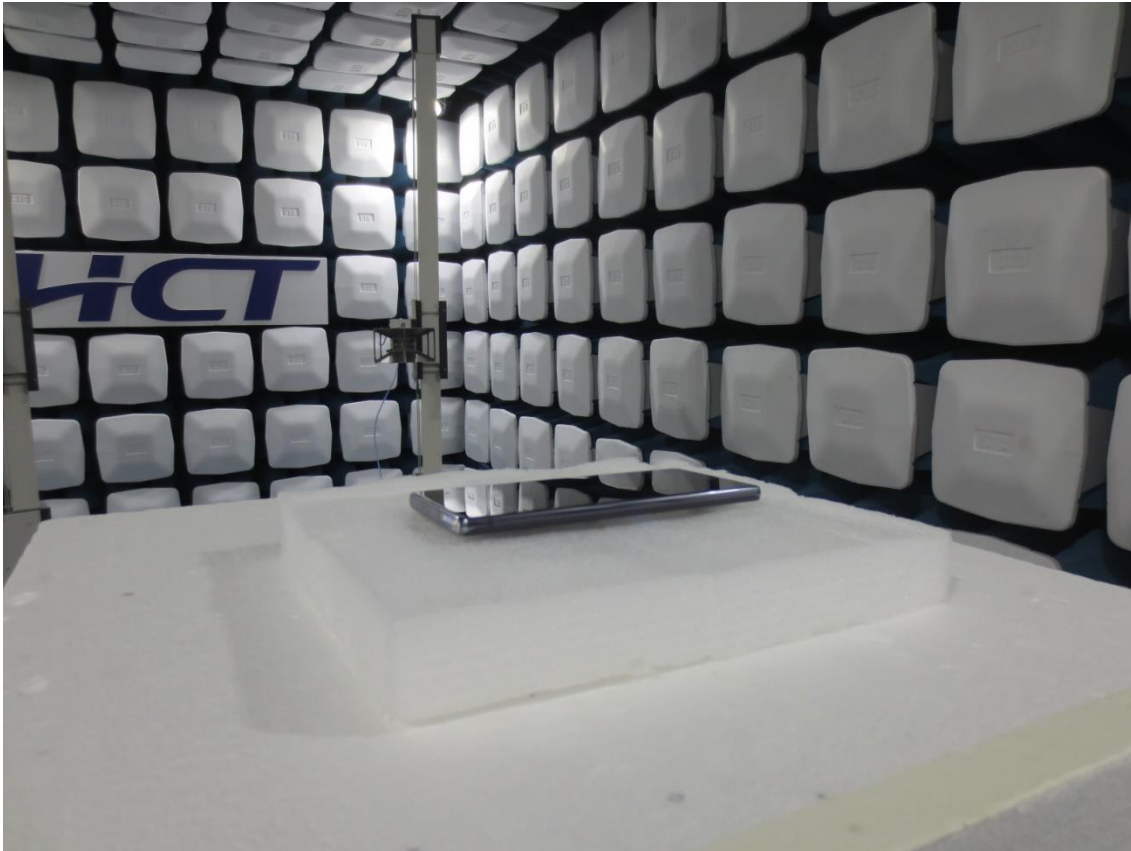

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P

## 2. Conducted Test Setup Photo

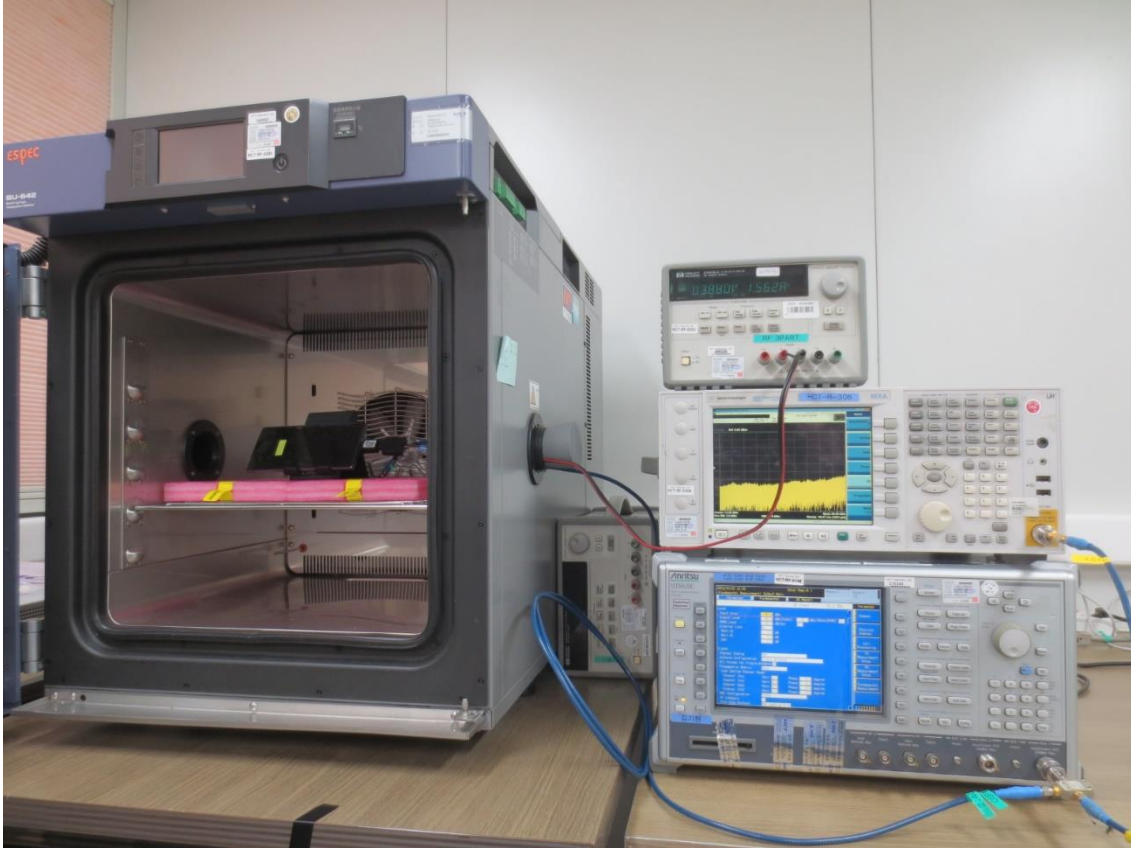

File	HCT-RF-2110-FC038-P	HCT-RF-2110-FC039-P	HCT-RF-2110-FC040-P	HCT-RF-2110-FC041-P	HCT-RF-2110-FC042-P
No.	HCT-RF-2110-FC043-P	HCT-RF-2110-FC044-P	HCT-RF-2110-FC045-P	HCT-RF-2110-FC046-P	HCT-RF-2110-FC047-P