



**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA  
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A:  
Test Setup  
Photo

FCC ID  
A3LSMP625

File No.			
HCT-RF-2402-FC003-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC009-P	
HCT-RF-2402-FC004-P	HCT-RF-2402-FC007-P	HCT-RF-2402-FC010-P	
HCT-RF-2402-FC005-P	HCT-RF-2402-FC008-P		

**REVISION HISTORY**

The revision history for this document is shown in table.

Revision No.	Date of Issue	Description
0	February 16, 2024	Initial Release

File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		


### 1. Radiated Test Setup Photo



File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		



File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		

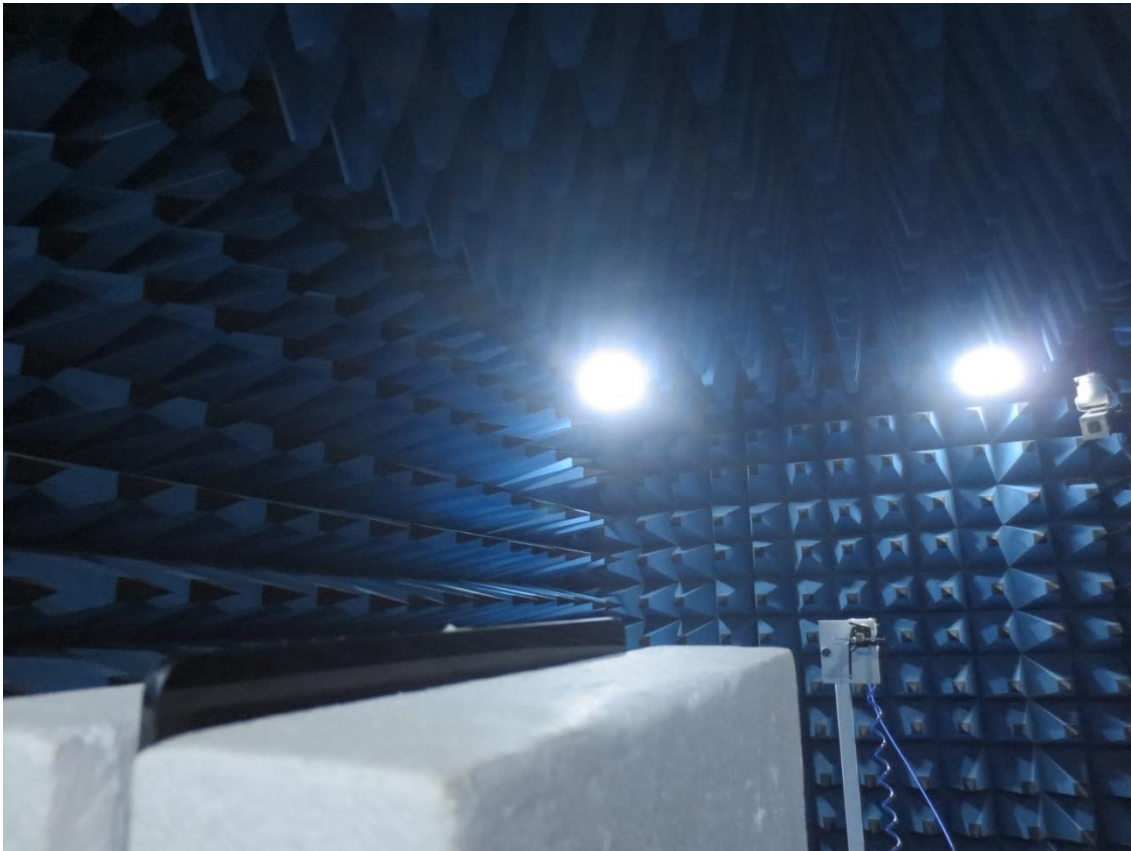


File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		



File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		




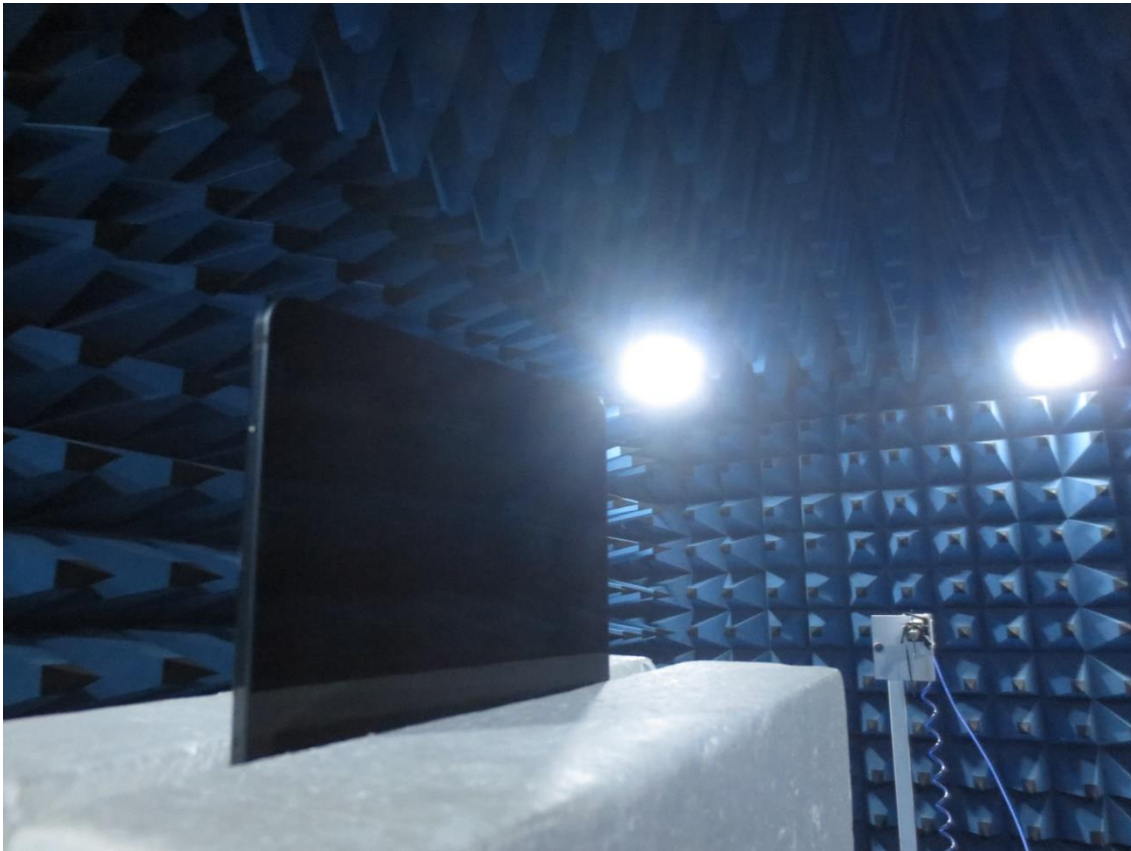

File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		




File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		

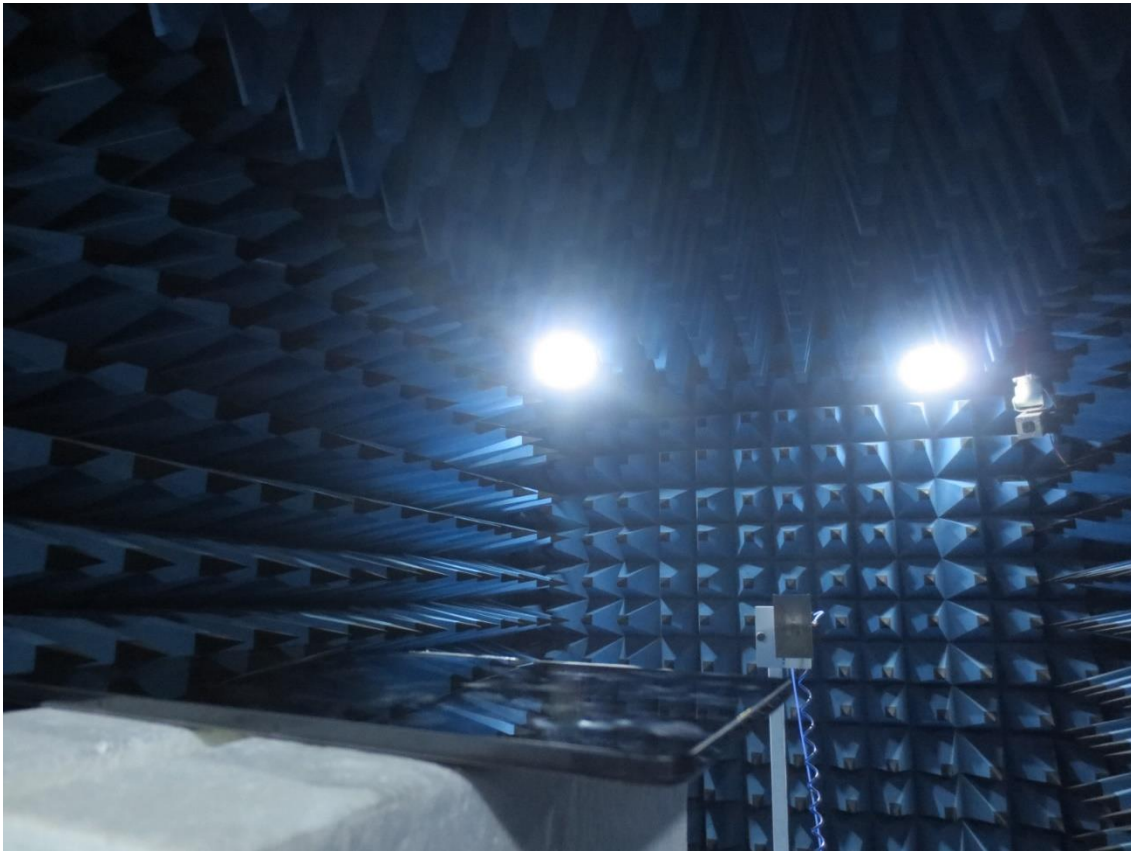


File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		



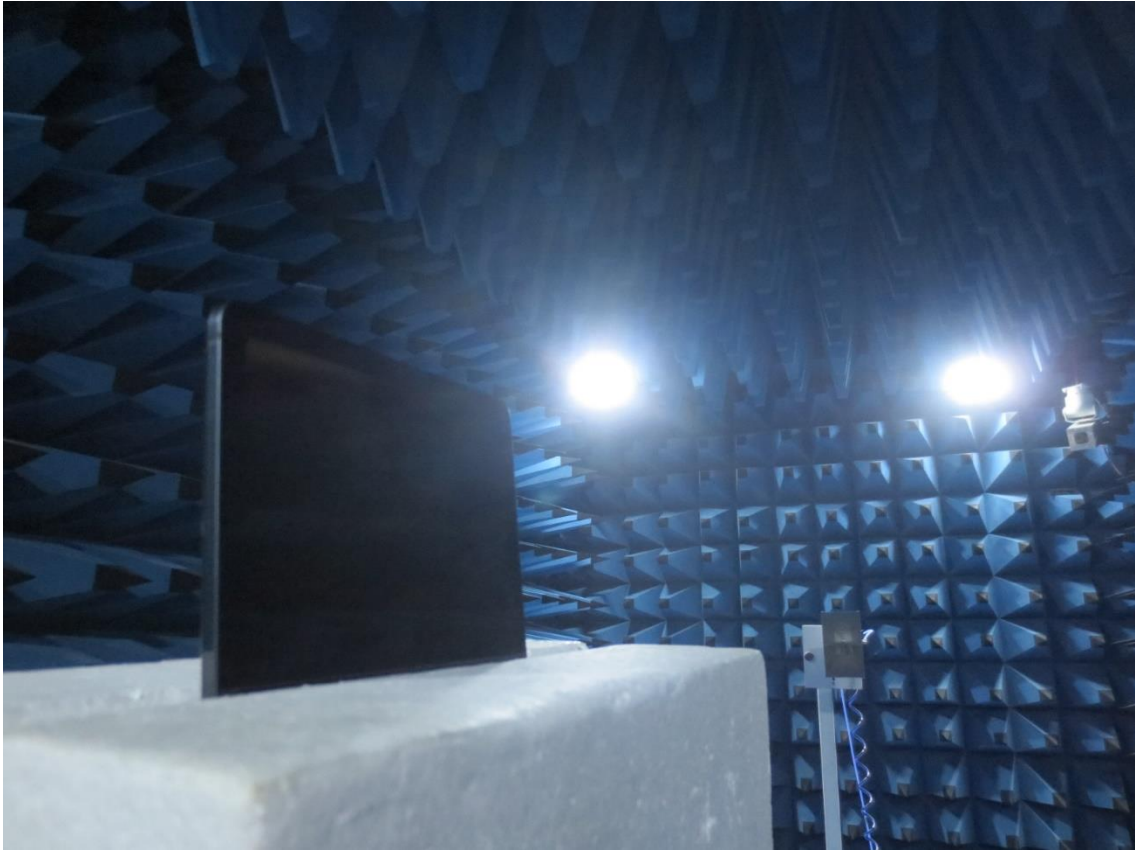


File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		

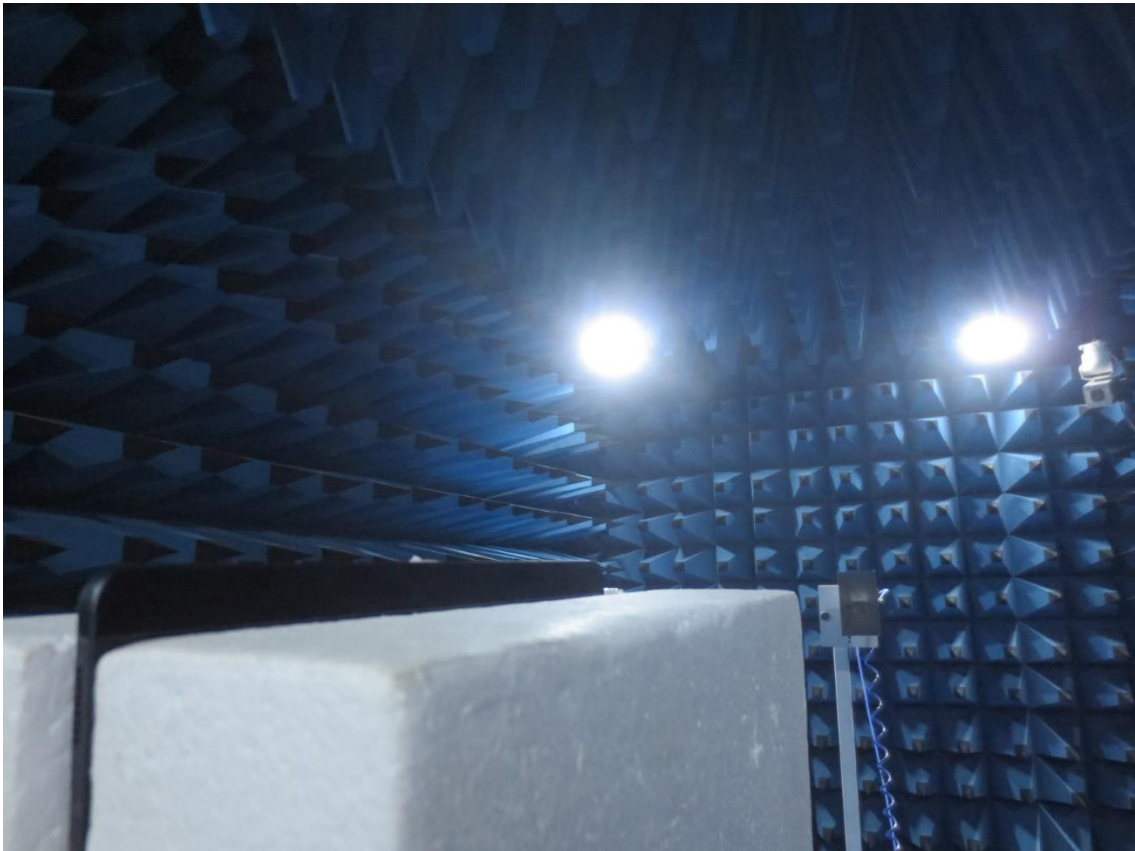


File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		



File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		

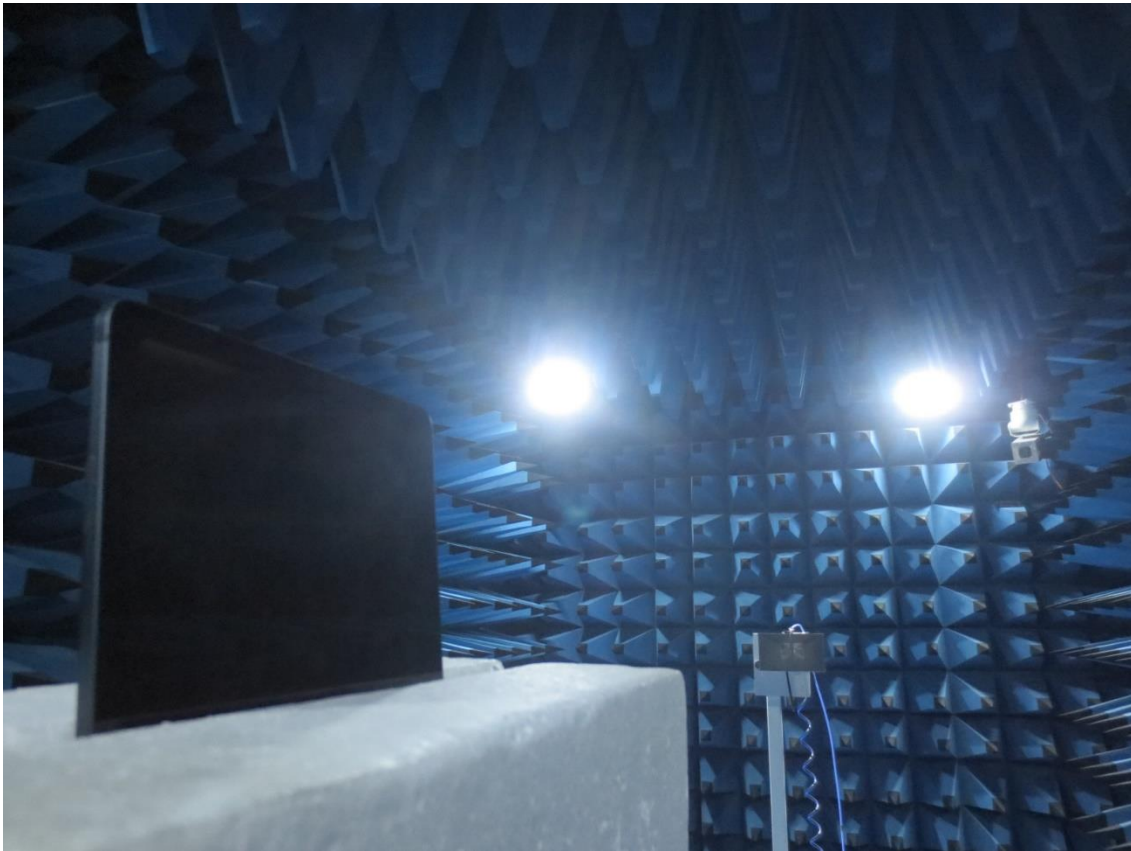


File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		

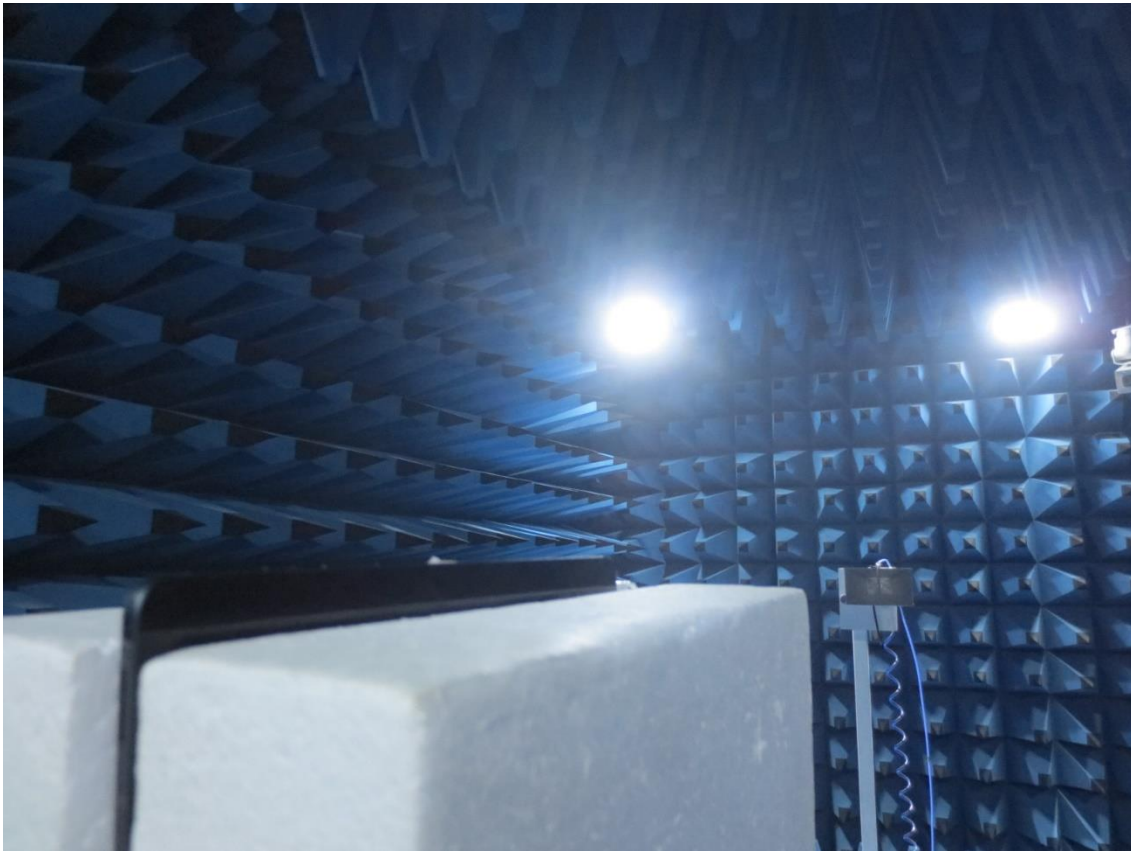

File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		



## 2. Conducted Test Setup Photo

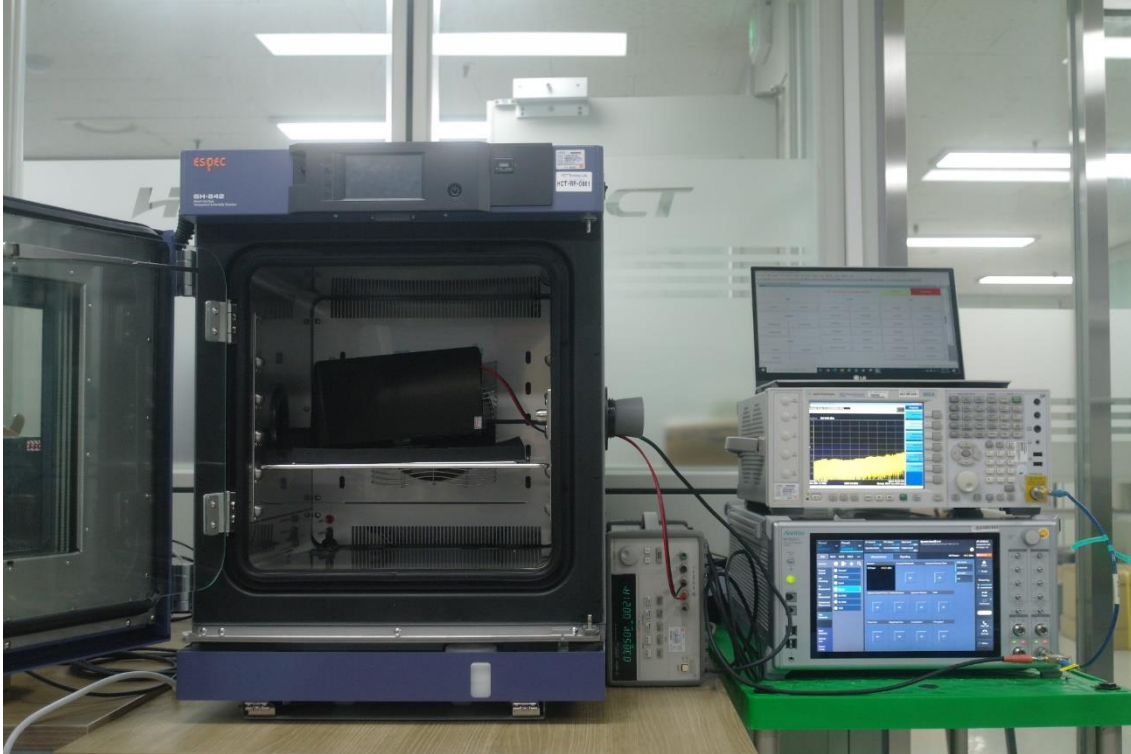

File	HCT-RF-2402-FC003-P	HCT-RF-2402-FC004-P	HCT-RF-2402-FC005-P	HCT-RF-2402-FC006-P	HCT-RF-2402-FC007-P
No.	HCT-RF-2402-FC008-P	HCT-RF-2402-FC009-P	HCT-RF-2402-FC010-P		