

**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A: Test Setup Photo

FCC ID.

A3LSMT725U

File No.

HCT-RF-1906-FC001-P
HCT-RF-1906-FC014-P
HCT-RF-1906-FC015-P
HCT-RF-1906-FC016-P
HCT-RF-1906-FC017-P
HCT-RF-1906-FC018-P
HCT-RF-1906-FC019-P

REVISION HISTORY

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	June 10, 2019	Initial Release

File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			


1. Radiated Test Setup Photo




File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

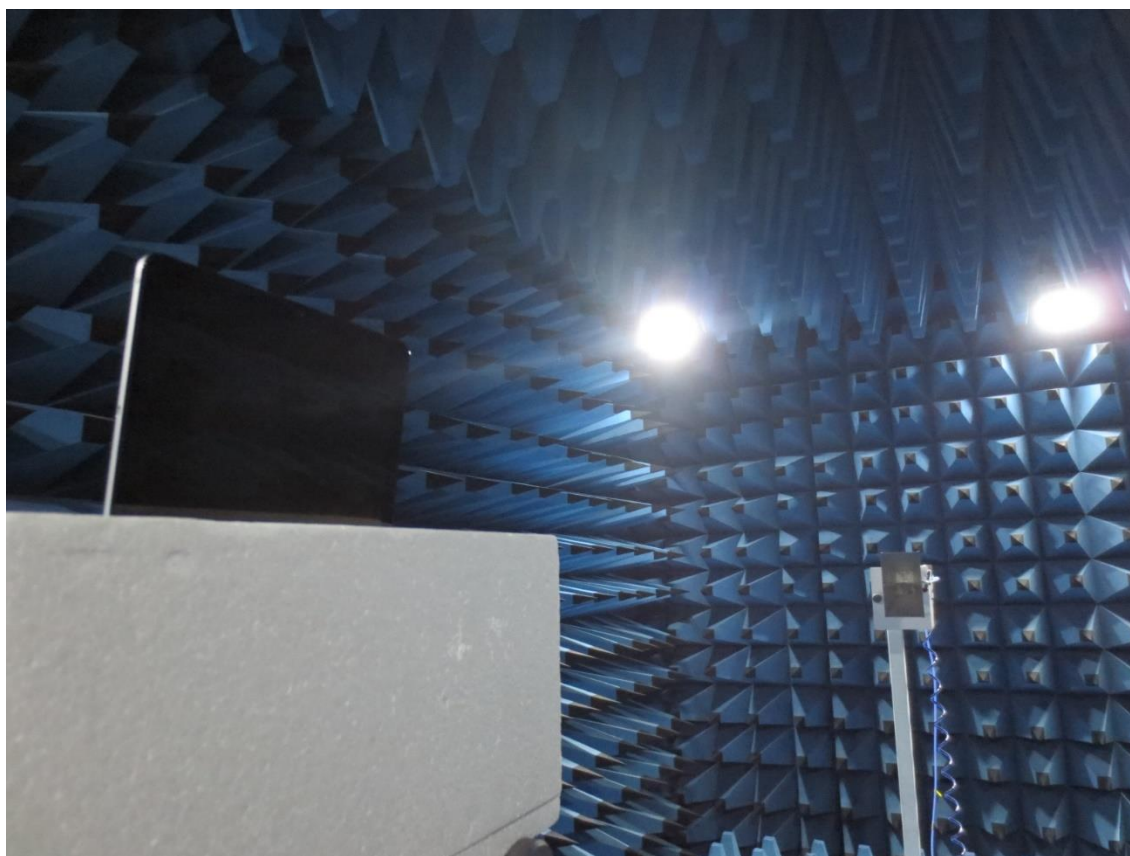


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

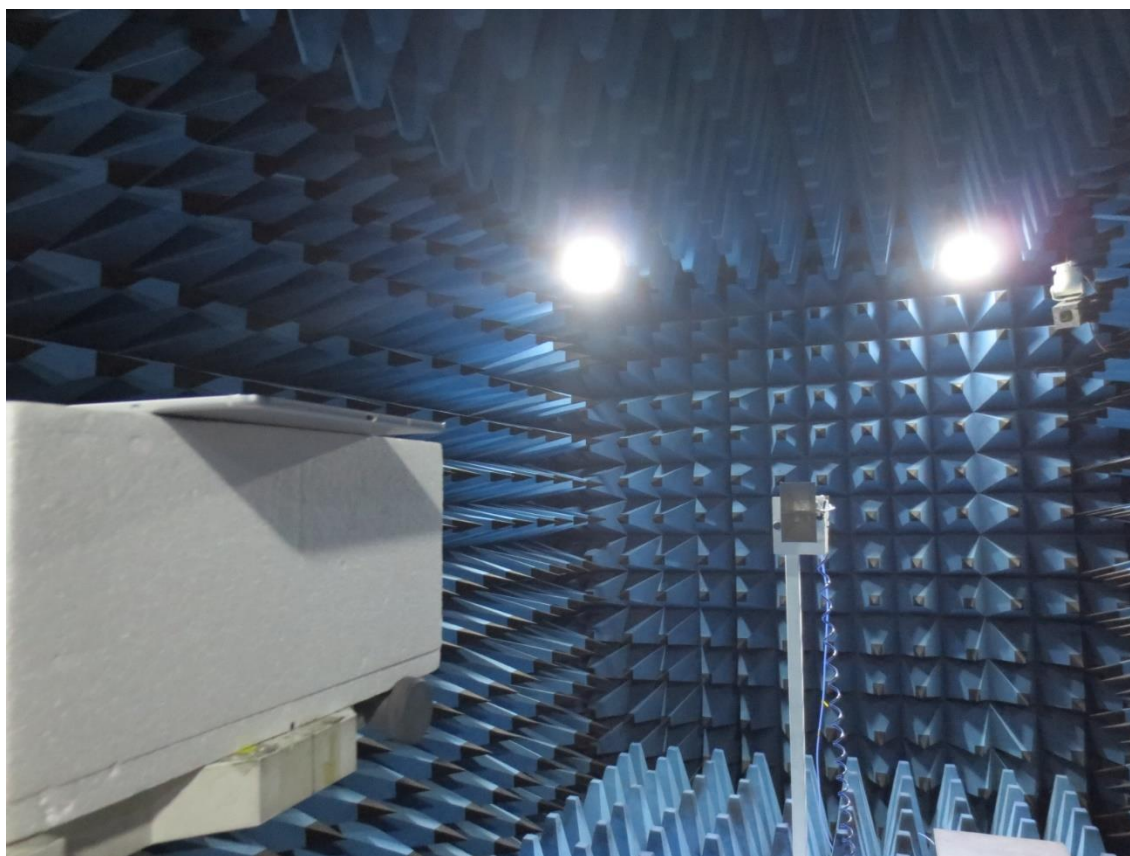


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

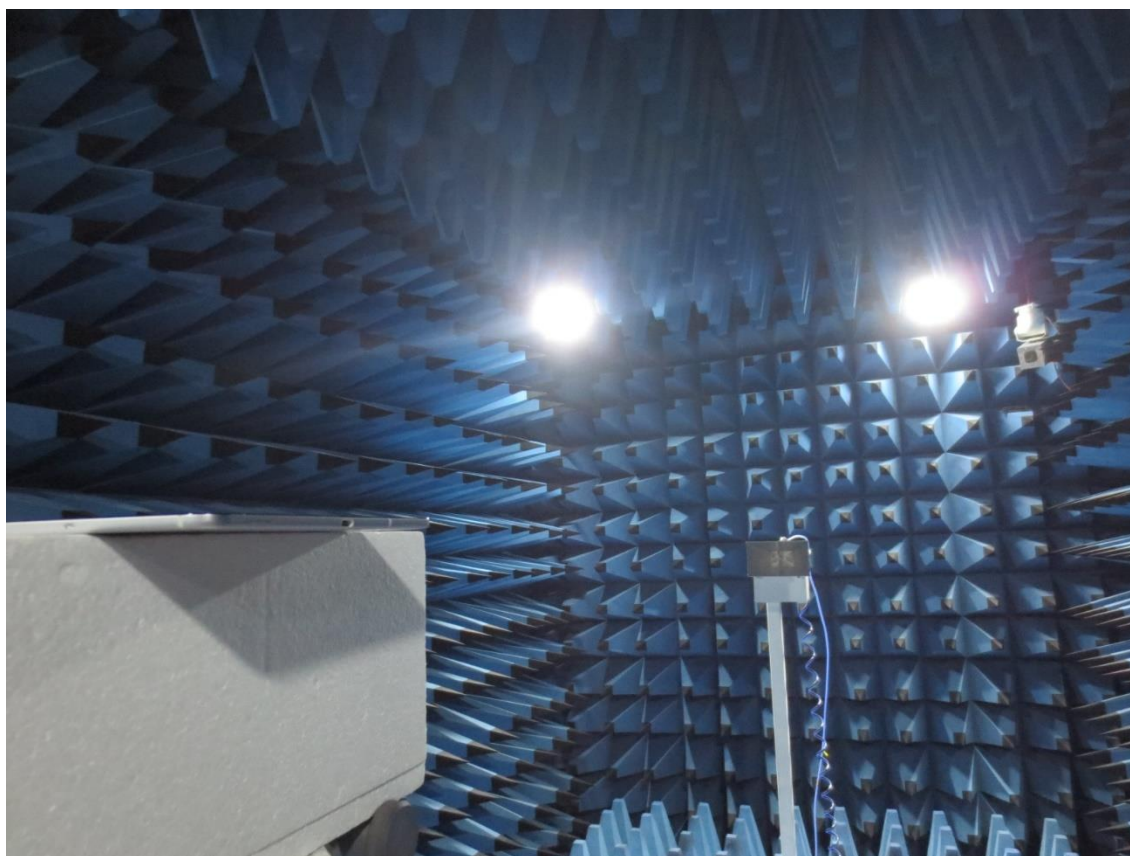


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

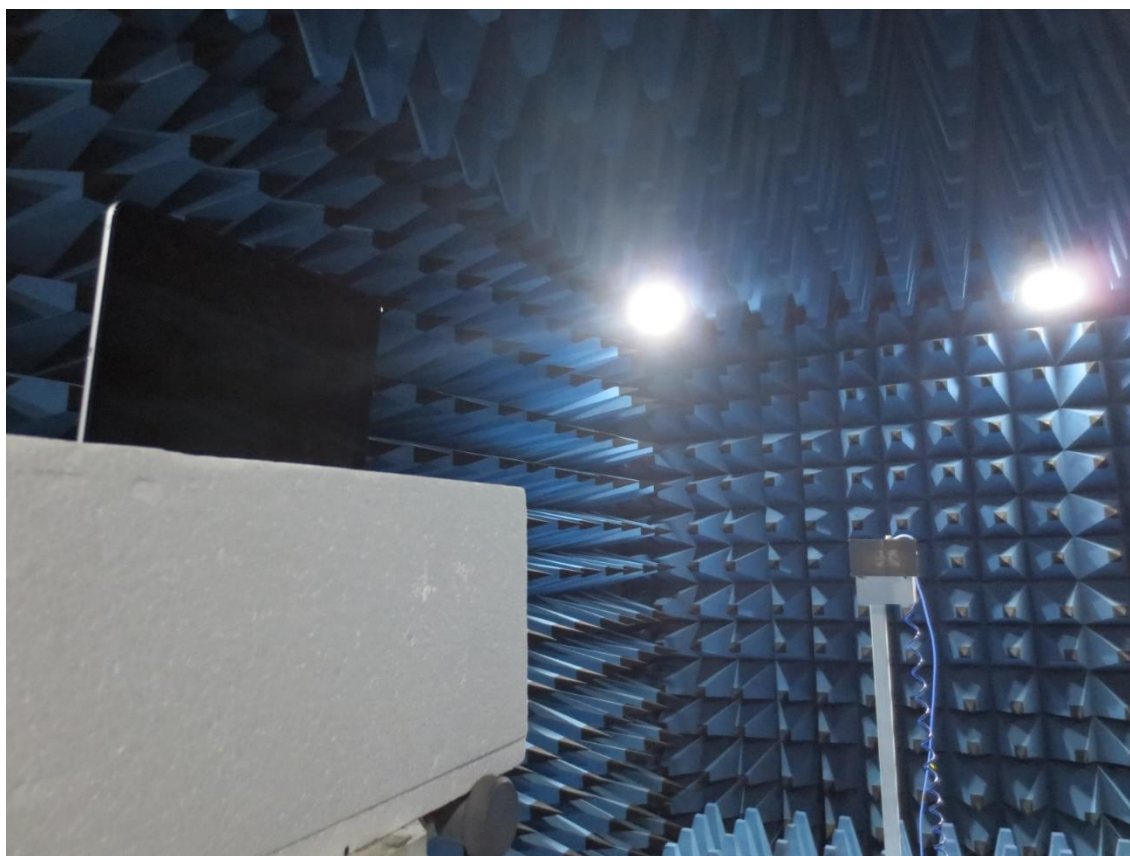


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

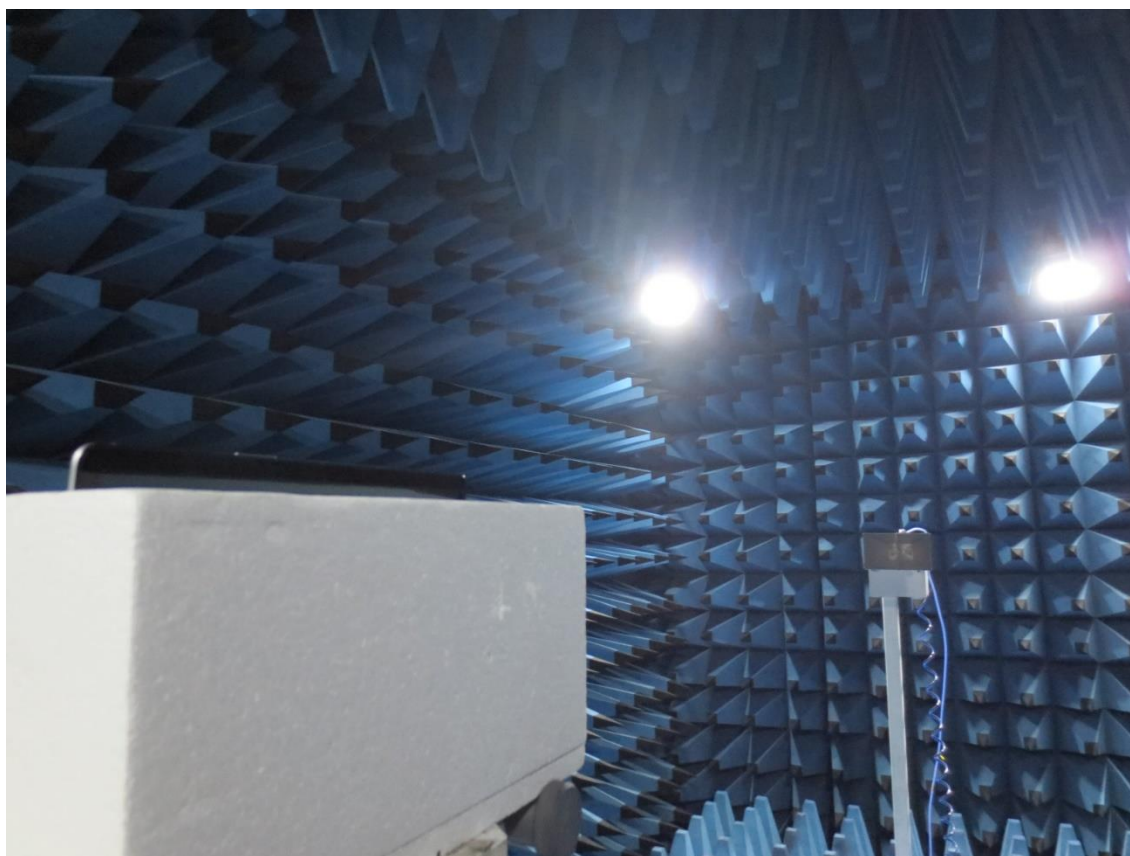

File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

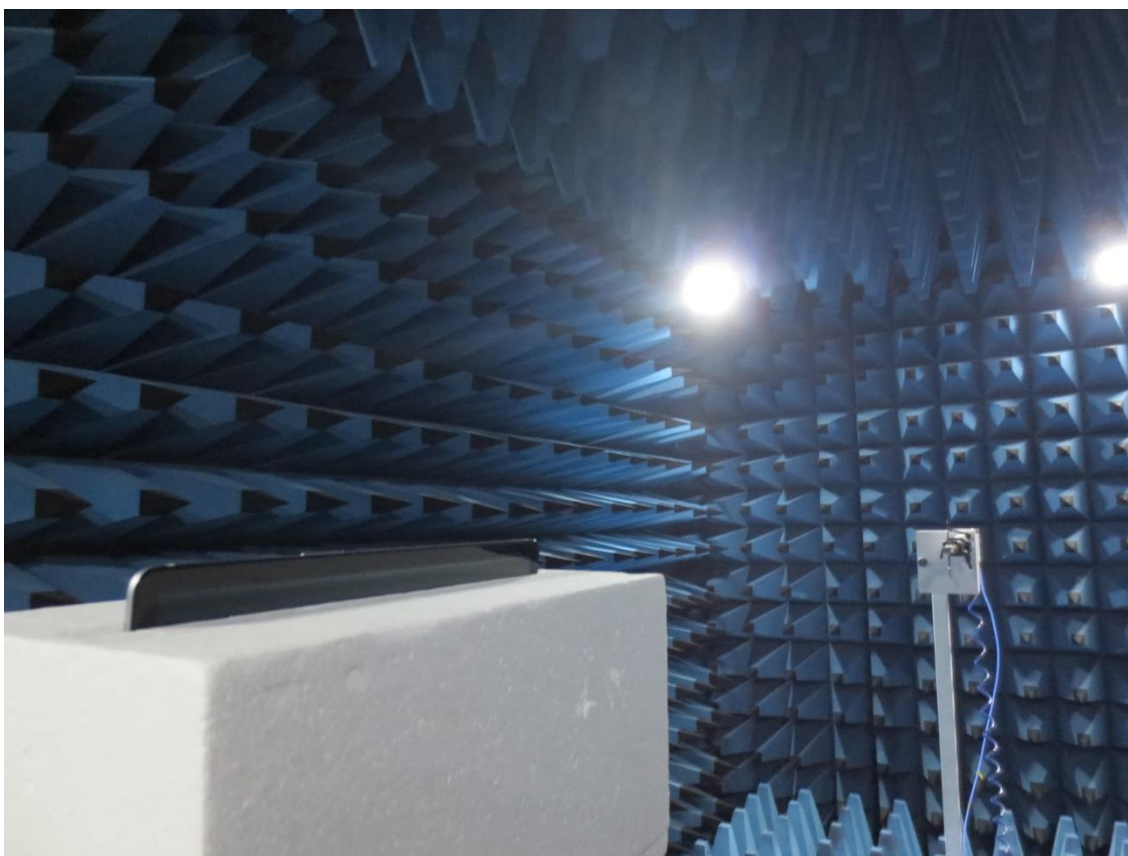


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

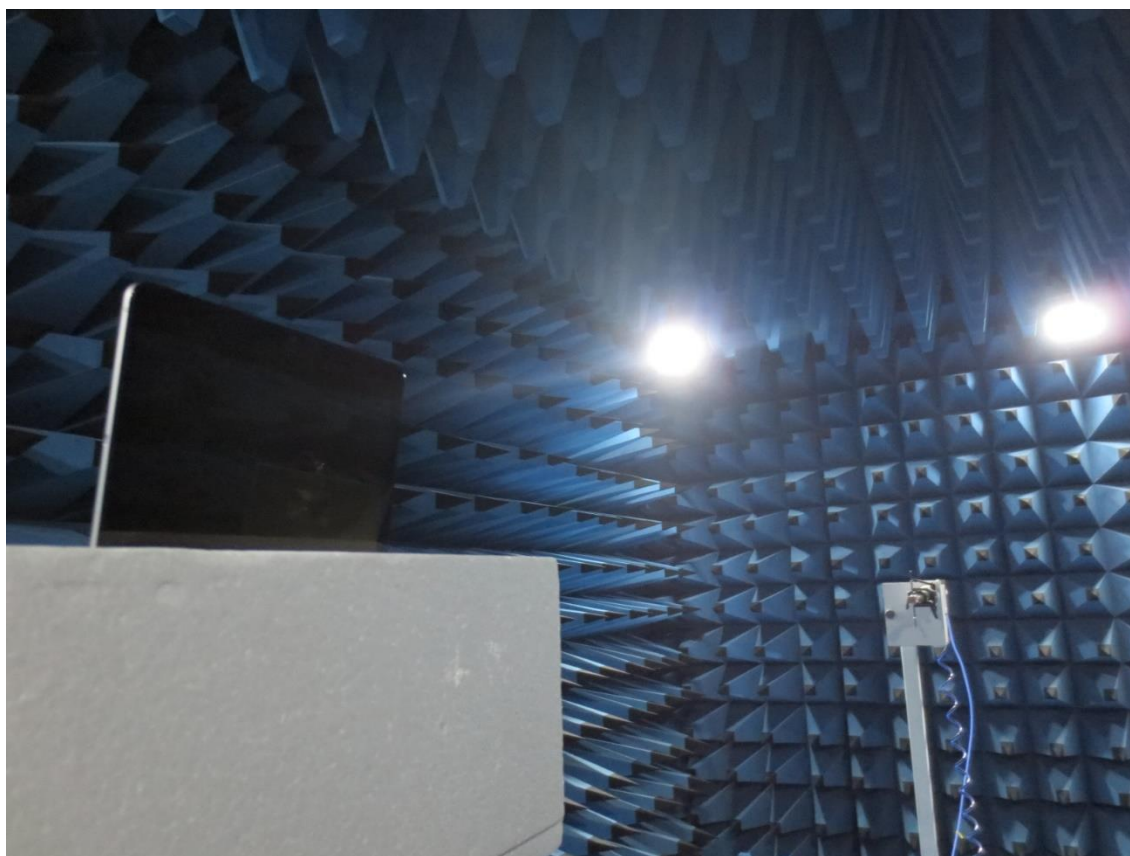


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			



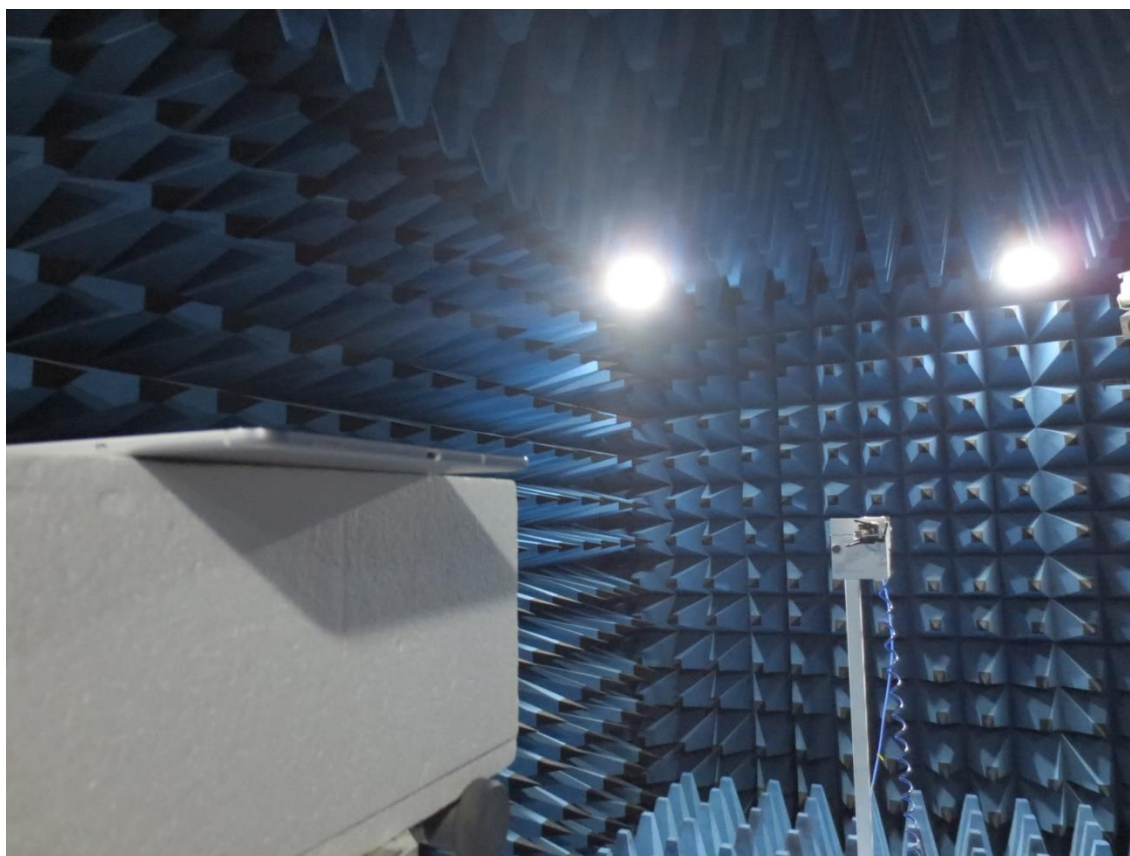


File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			

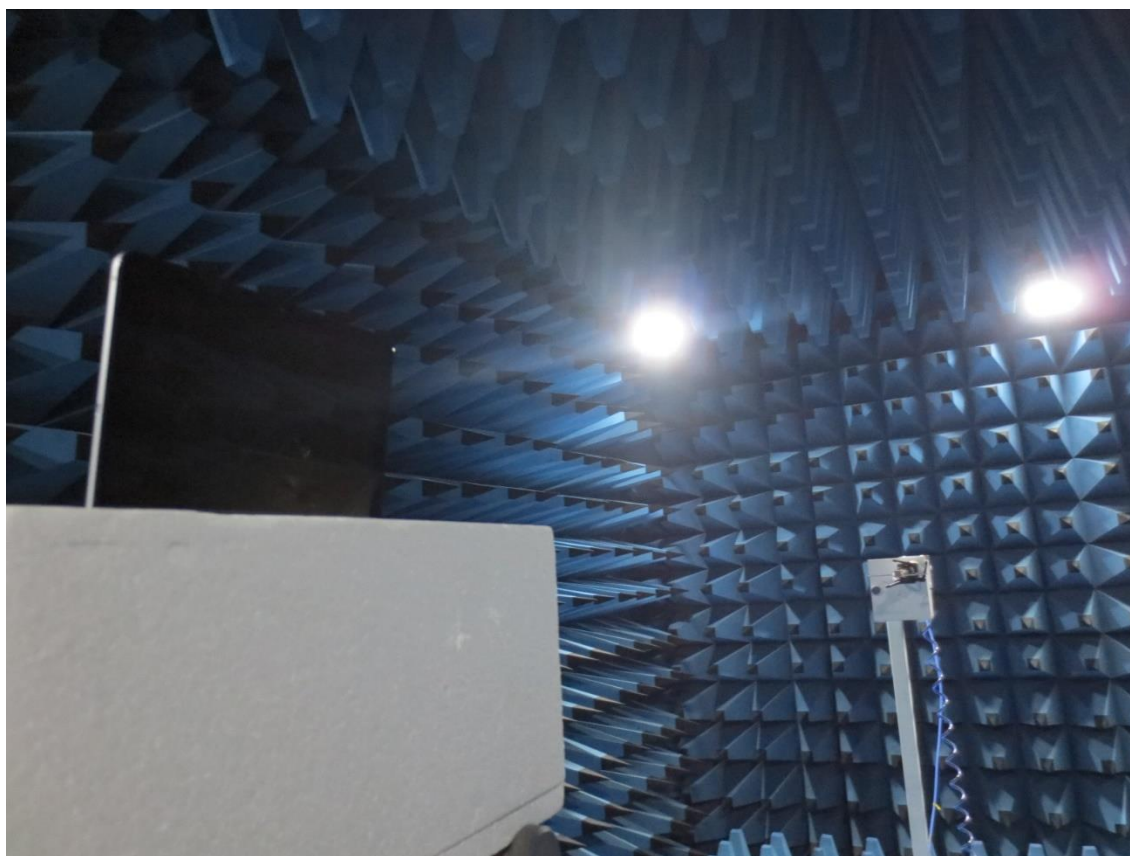



2. Conducted Test Setup Photo

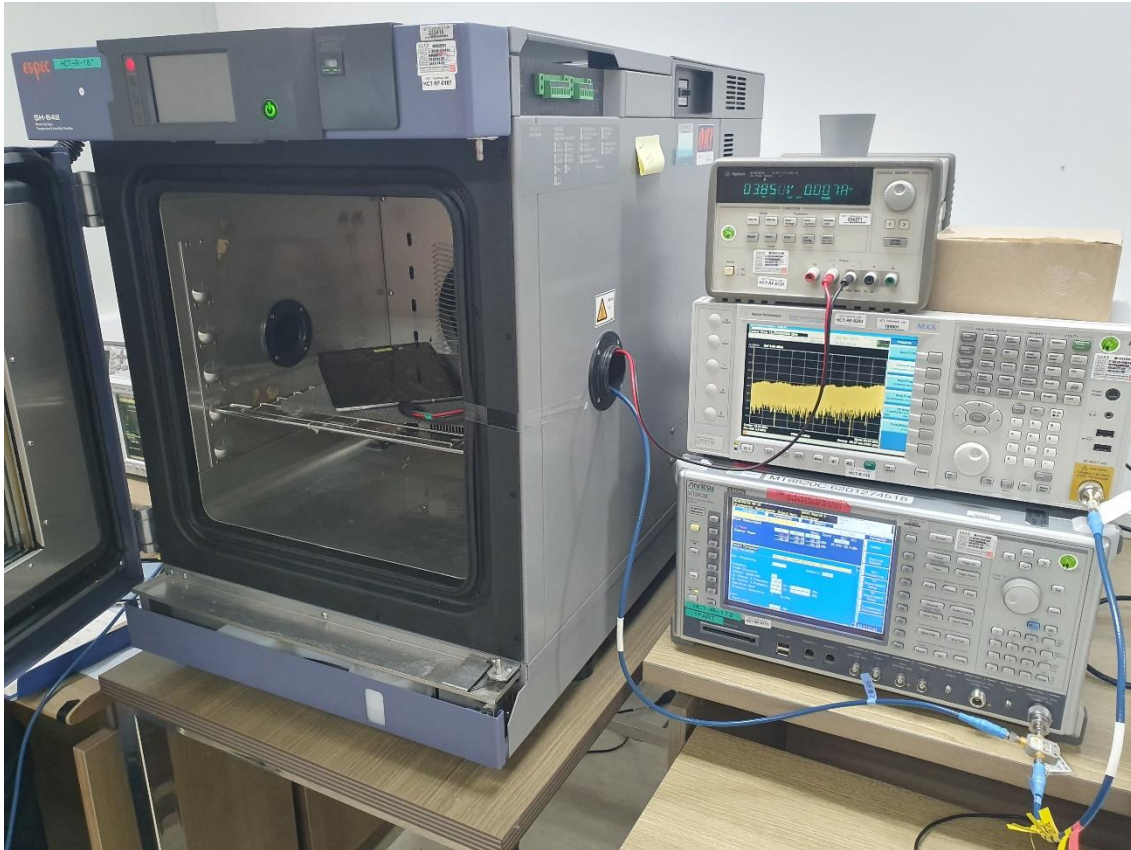

File No.	HCT-RF-1906-FC001 -P	HCT-RF-1906-FC014 -P	HCT-RF-1906-FC015	HCT-RF-1906-FC016 -P	HCT-RF-1906-FC017-P
	HCT-RF-1906-FC018 -P	HCT-RF-1906-FC019-P			