


Label and Label Location

Label sample

38 mm	 <p>CAUTION RISK OF ELECTRIC SHOCK DO NOT OPEN</p> <p>CAUTION: TO REDUCE THE RISK OF ELECTRIC SHOCK. DO NOT REMOVE COVER(OR BACK). NO USER SERVICEABLE PARTS INSIDE. REFER SERVICING TO QUALIFIED SERVICE PERSONNEL.</p> <p>WARNING TO PREVENT ELECTRIC SHOCK DO NOT REMOVE BACK COVER NO USER SERVICEABLE PARTS INSIDE.</p> <p>▲ WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov. For more information go to www.CrosleyBrands.com/Compliance/Prop65</p> <p>CROSLEY® Model : CR6019E-SMK Replacement Needle: NP-6</p> <p>POWER SUPPLY: AC adapter(DC 5V 1A) POWER CONSUMPTION: 9W This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) This device must accept any interference received. Including interference that may cause undesired operation. California 93120 compliant for formaldehyde FCC ID: AUSCR6019E MADE IN CHINA</p> <p>S/N: 573150721</p>
	90 mm

Location

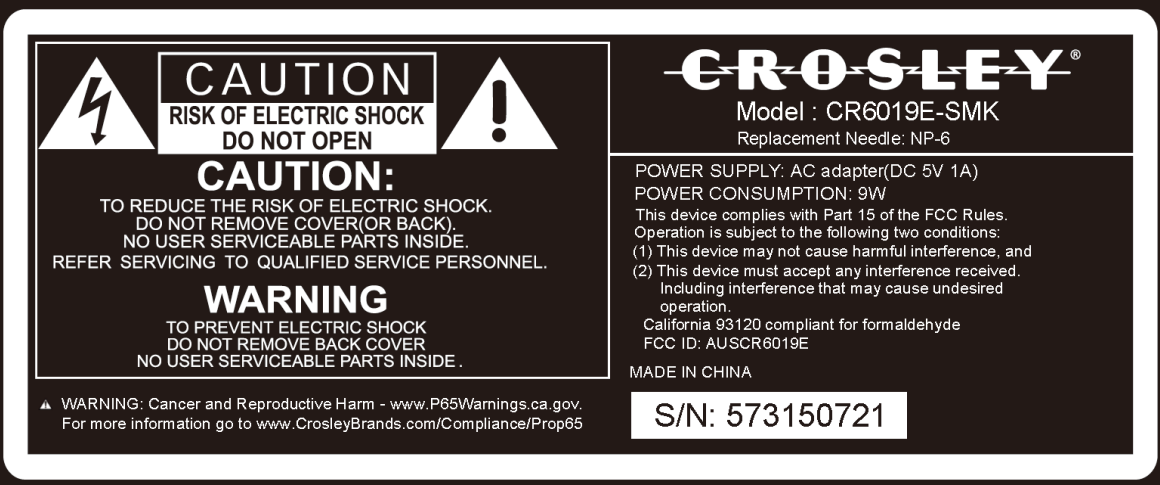