

File name: J49245C1.RES
Date: 13. Jan 06 10:14




Scan Settings (2 Ranges)

Frequencies			Receiver Settings					
Start	Stop	Step	IF BW	Detector	M-Time	Atten	Preamp	
150k	1M	5k	9k	QP+AV	20ms	AUTO LN	OFF	
1M	30M	10k	9k	QP+AV	20ms	AUTO LN	OFF	

Transducer No.	Start	Stop	Name
12	9k	30M	T_CONDCF

Final Measurement: x QP / + AV
Meas Time: 1 s
Subranges: 16
Acc Margin: 30dB

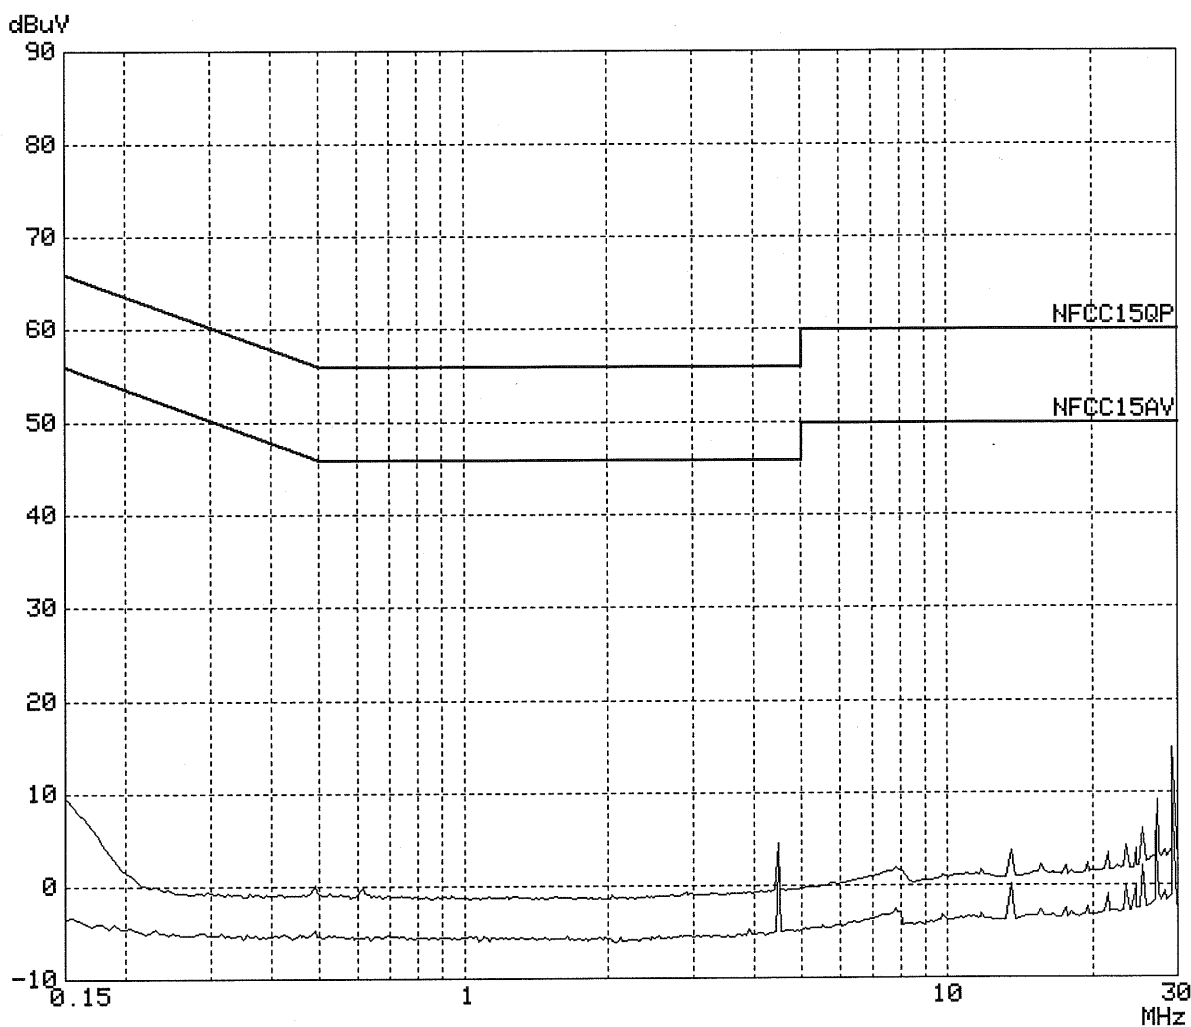

File name: J49245C1.RES
Date: 13. Jan 06 10:14



Final Measurement Results:

no Results