


ATTACHMENT A.
ID LABEL INFORMATION AND LOCATION PHOTOS

1.1 ID Label Information

According to the requirement section 2.925 and 2.926,the sample label shown below shall be Permanently affixed at a conspicuous location on the device supplied to the user and be readily visible to the purchaser at the time purchase

Figure PRODUCT LABEL
Both the FCC ID and compliance statement are included in the product label

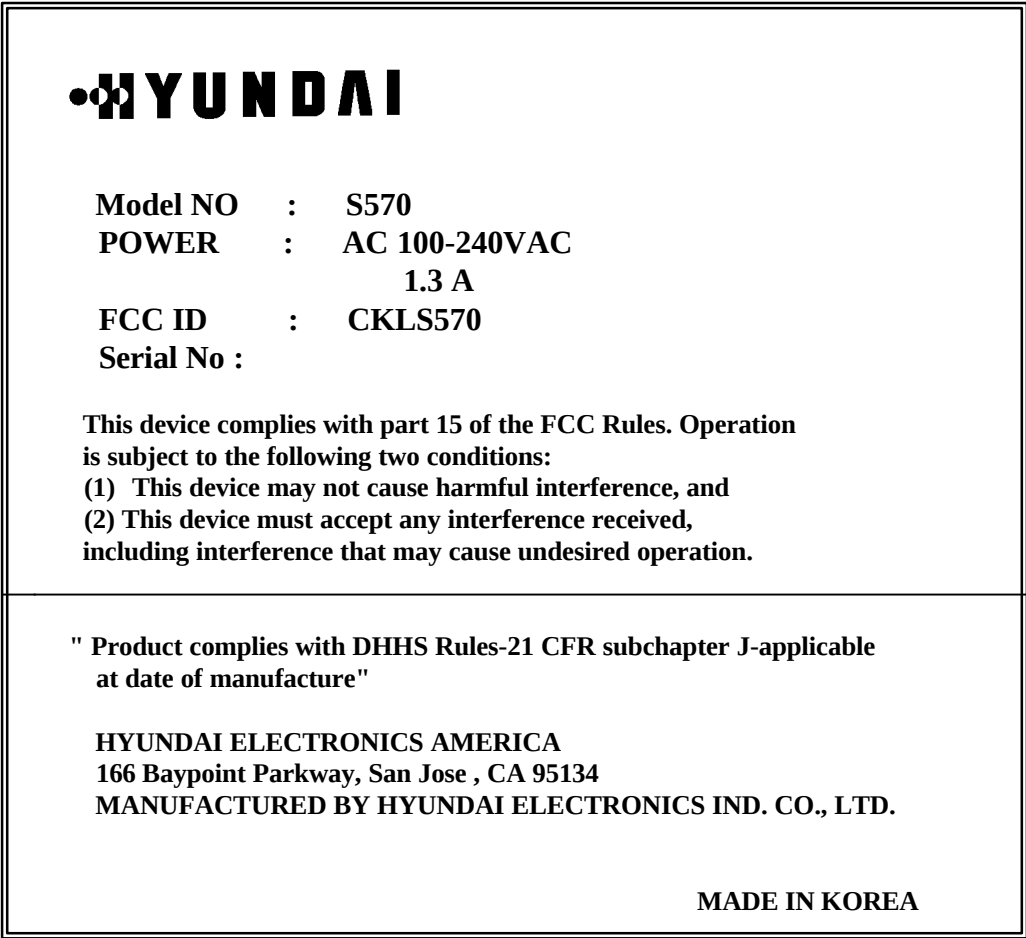

HYUNDAI

See installation instructions before connecting to the supply.

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions:
 (1) this device may not cause harmful interference, and
 (2) this device must accept any interference received, including interference that may cause undesired operation.

"Product complies with DHHS Rules-21 CFR subchapter j-applicable at date of manufacture"

WARNING: Vor Ihnen des Gerätes Netzstecker ziehen.
Disconnect power before opening.

HYUNDAI ELECTRONICS AMERICA
 3101 North 1st Street, San Jose, CA 95134
 MANUFACTURED BY
HYUNDAI ELECTRONICS IND. CO., LTD.
 631 6345 200

MADE IN KOREA


 E142408
 LISTED
 I.T.E.
 6K83


 LF 65701


 ISO
 9241-3


 GS


 N


 S


 D


 FI



Die in diesem Gerät enthaltene Röntgenstrahlung ist durch eine eigensichere Kathodenstrahlröhre nach Anlage III Röntgenverordnung ausreichend abgeschirmt.
 Beschleunigungsspannung: Max. 27,5kV

This Class B digital apparatus meets all requirements of the Canadian Interference-Causing Equipment Regulations. Cet appareil numérique de la classe B respecte toutes les exigences du Règlement sur le matériel brouilleur du Canada.

Apparaten skall anslutas till jordat nätuttag.
 Connect only to a properly grounded outlet.

Model No. : S570
 POWER : 100-240V ~
 1.3A 60/50Hz
 FCC ID : CKLS570
 Serial No. : 2
 Manufactured : MARCH 1999

1.2 Label Location Photos

The label shown shall be permanently affixed at a conspicuous location on the device and be readily visible to the user at the time purchase.(Labeling requirements per 2.925)



