
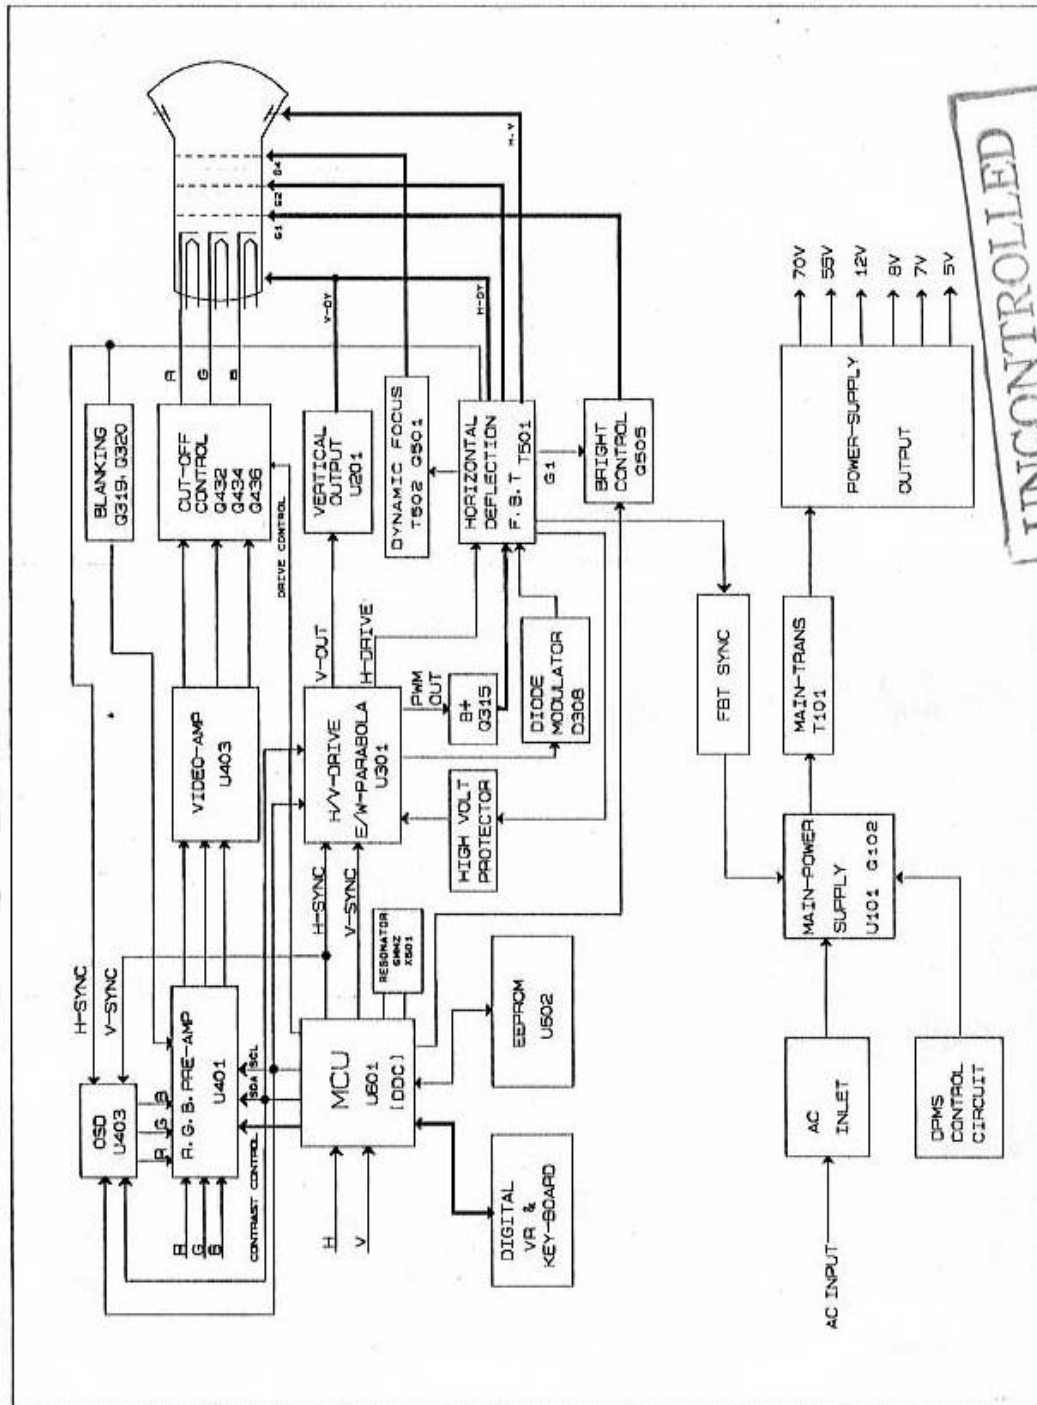


ATTACHMENT B.SCHEMATIC(BLOCK DIAGRAM)

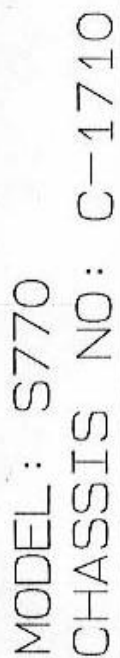

UNCONTROLLED

MONITOR DIV, DOCUMENT 1

98 12 4