





Engineering Test Services

Attachment A – Powerline Conducted emissions


# L1 - 240VAC

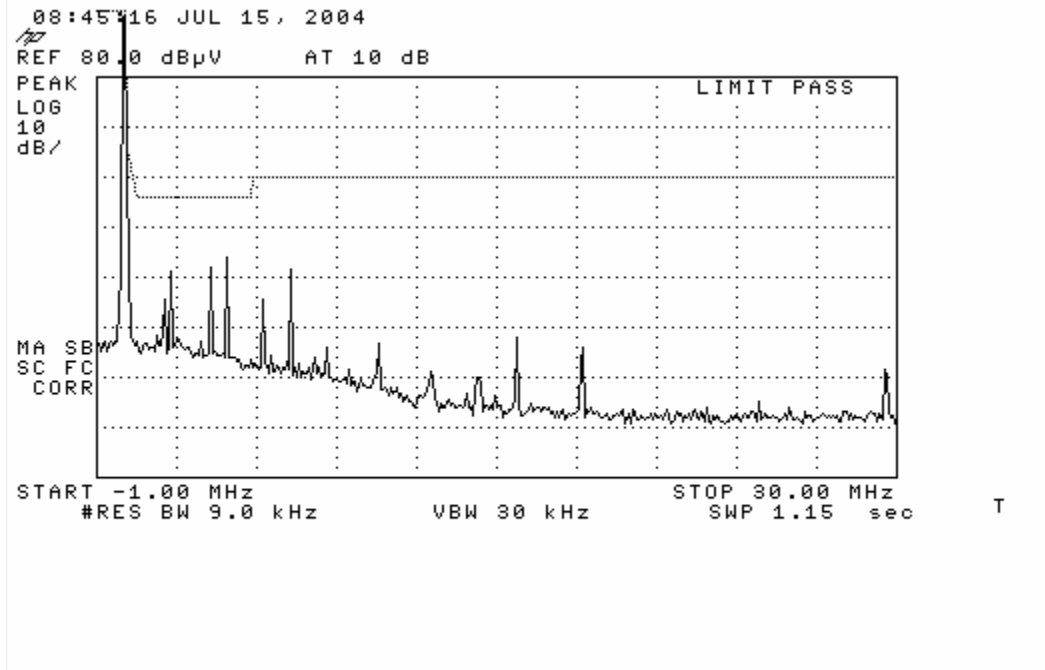


# L2 - 240VAC

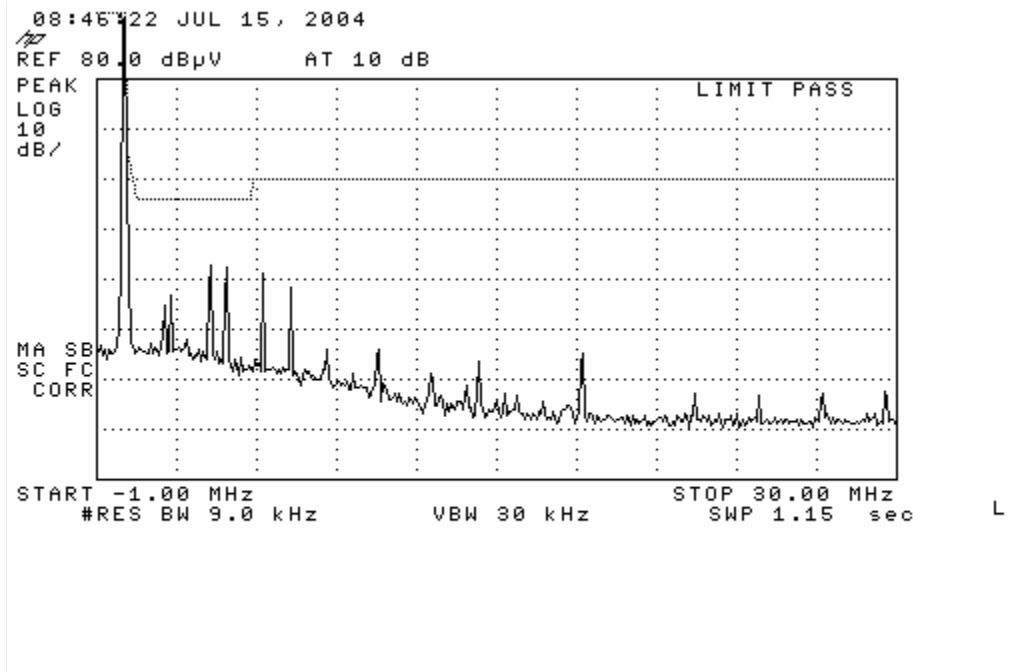


# L1 - 240VAC

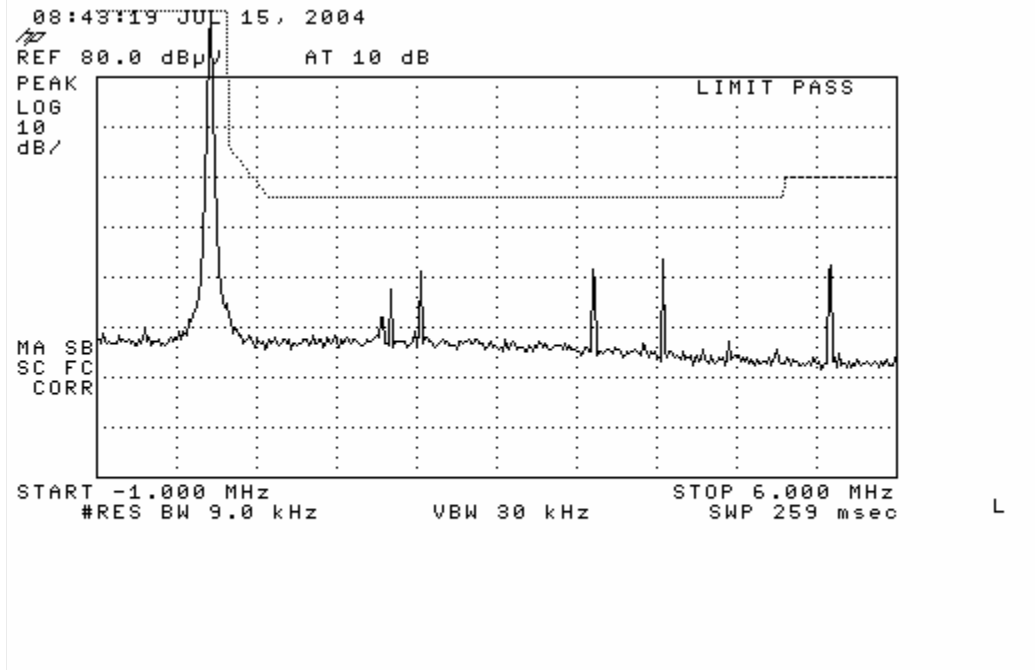


# L2 - 240VAC

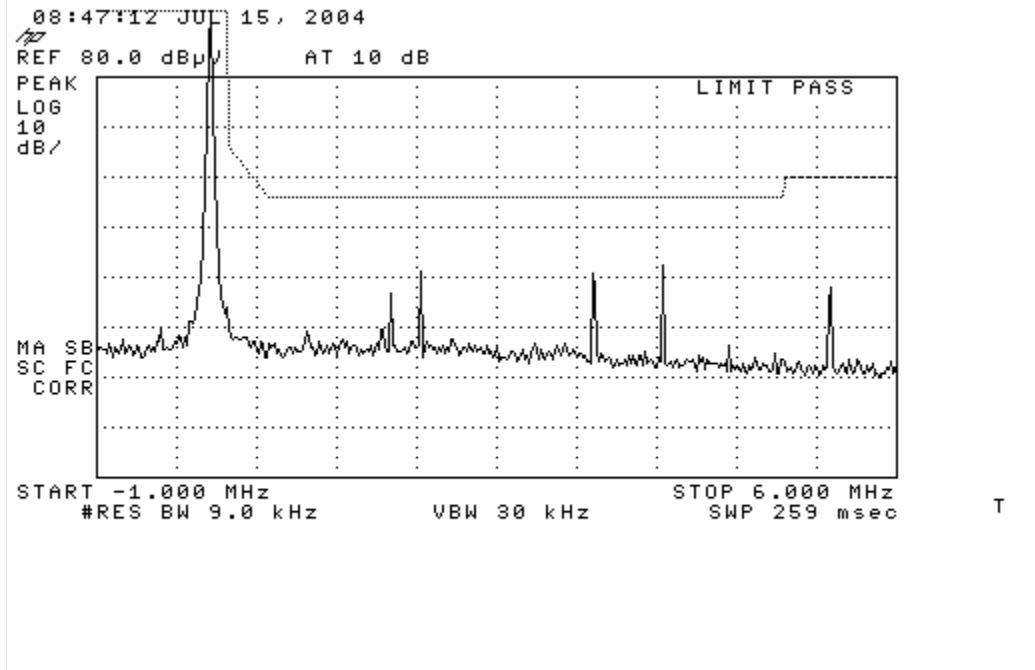


# L1 - 120VAC

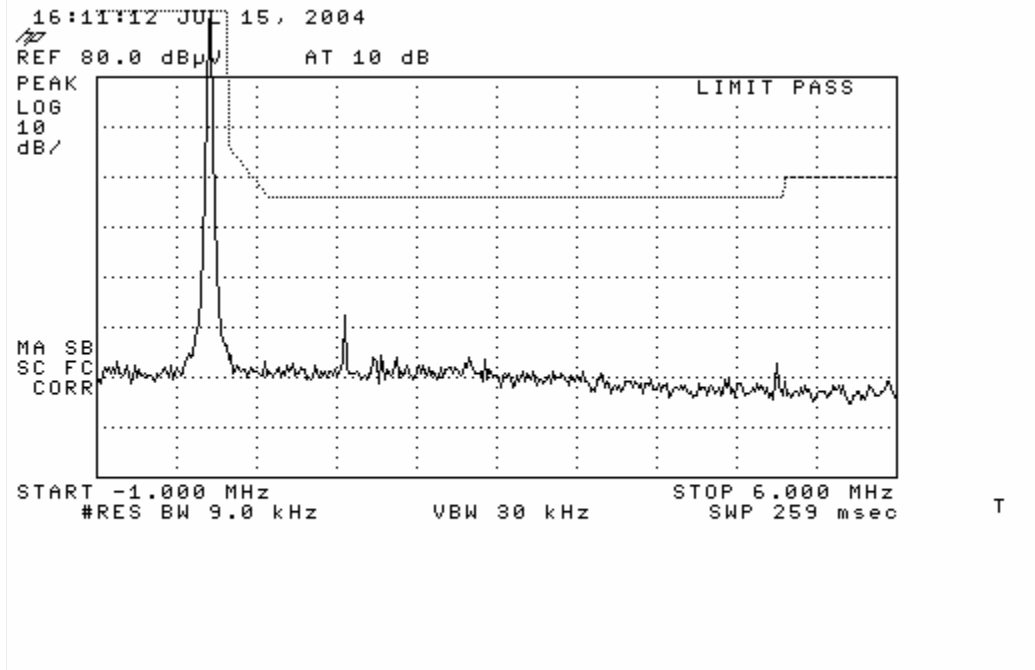

# L2 - 120VAC

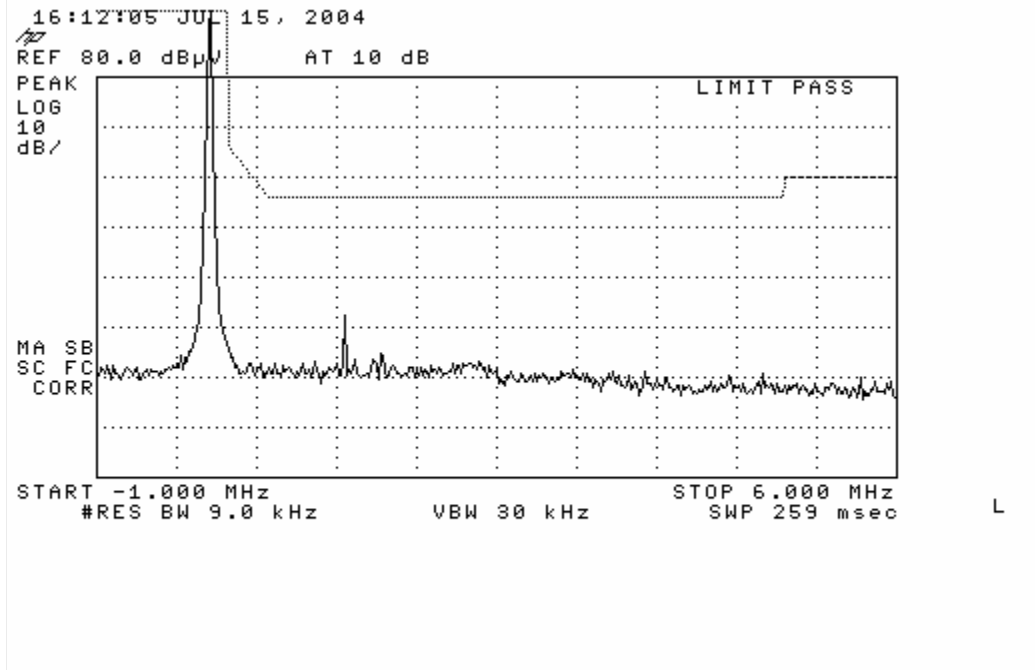

# L1 - 120VAC

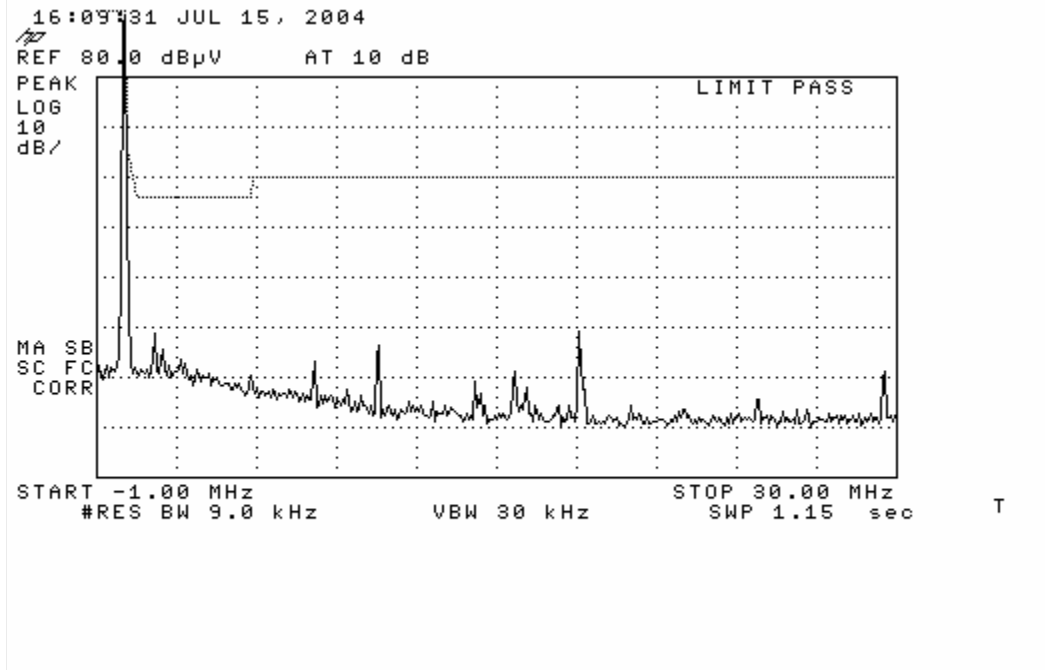



# L2 - 120VAC

