

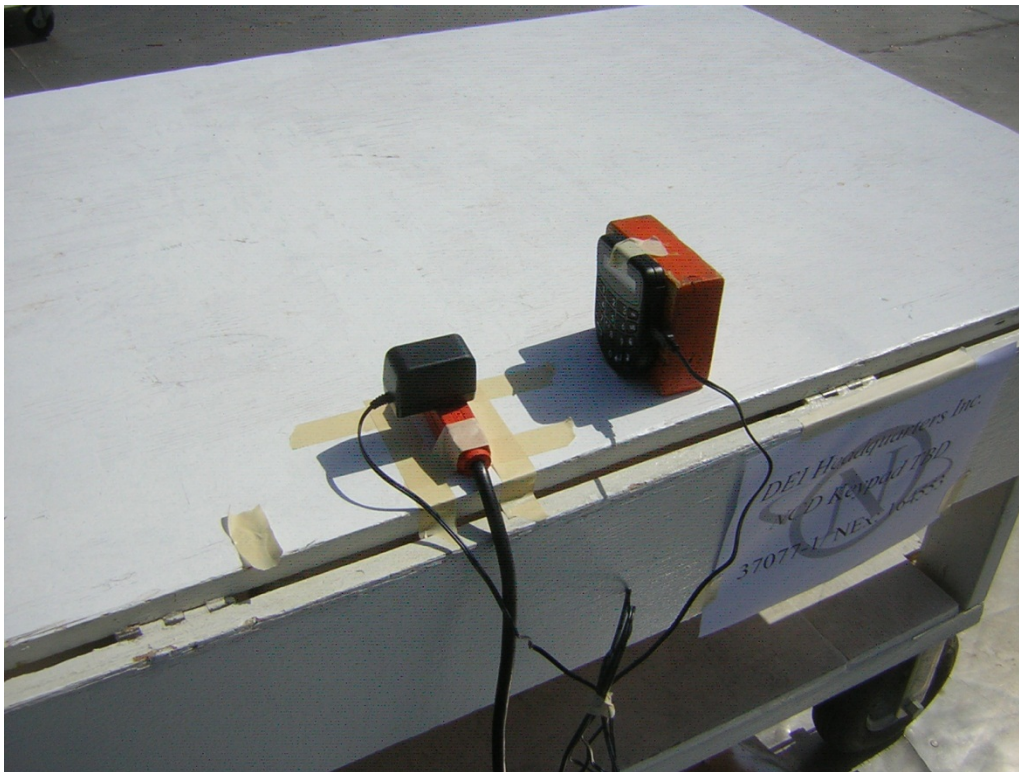



MODEL 7703A (remote) radiated emissions

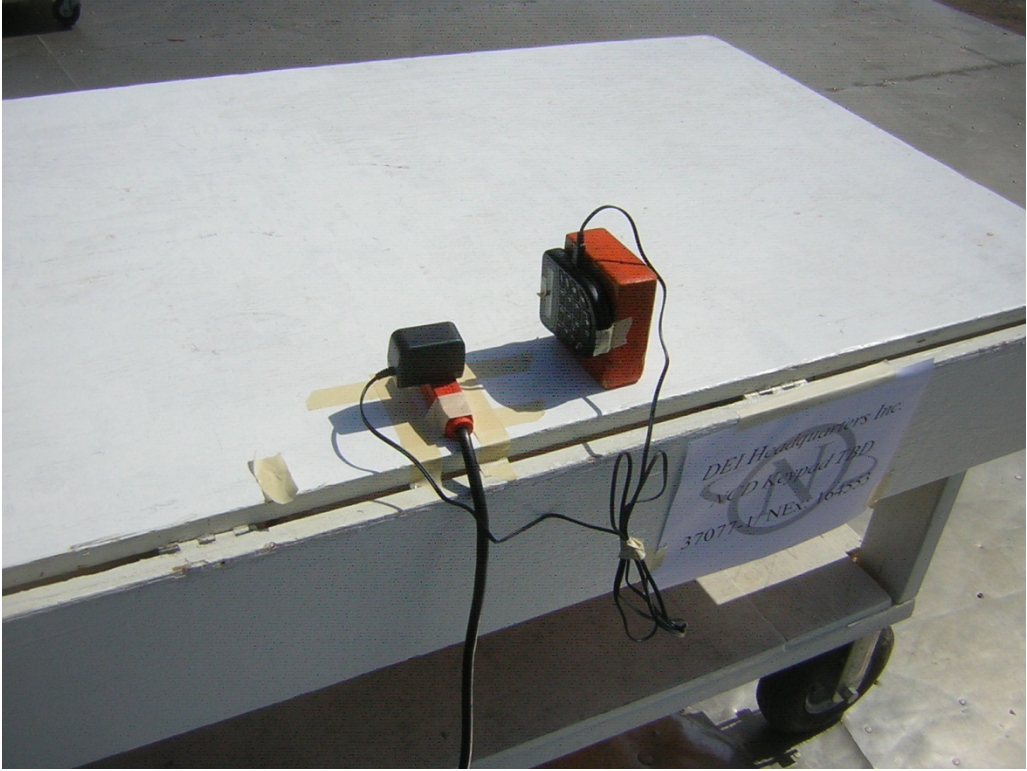


MODEL 7703A (remote) radiated emissions

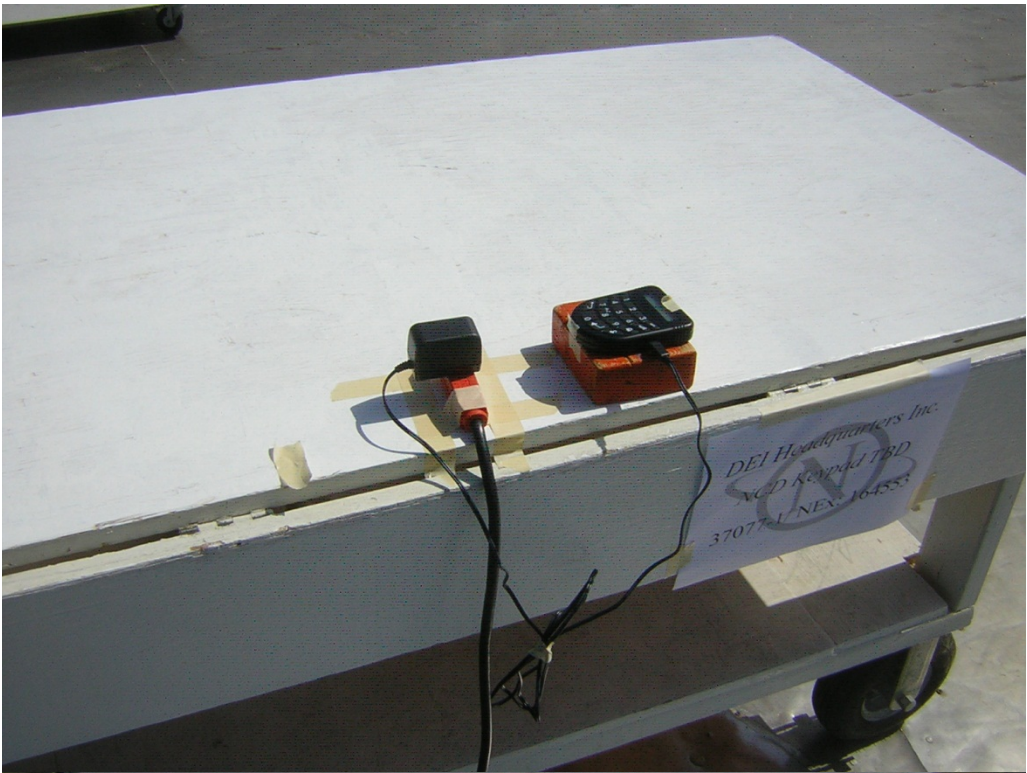

MODEL 6703A (HUB), keypad required for changing frequencies, test mode. radiated emissions

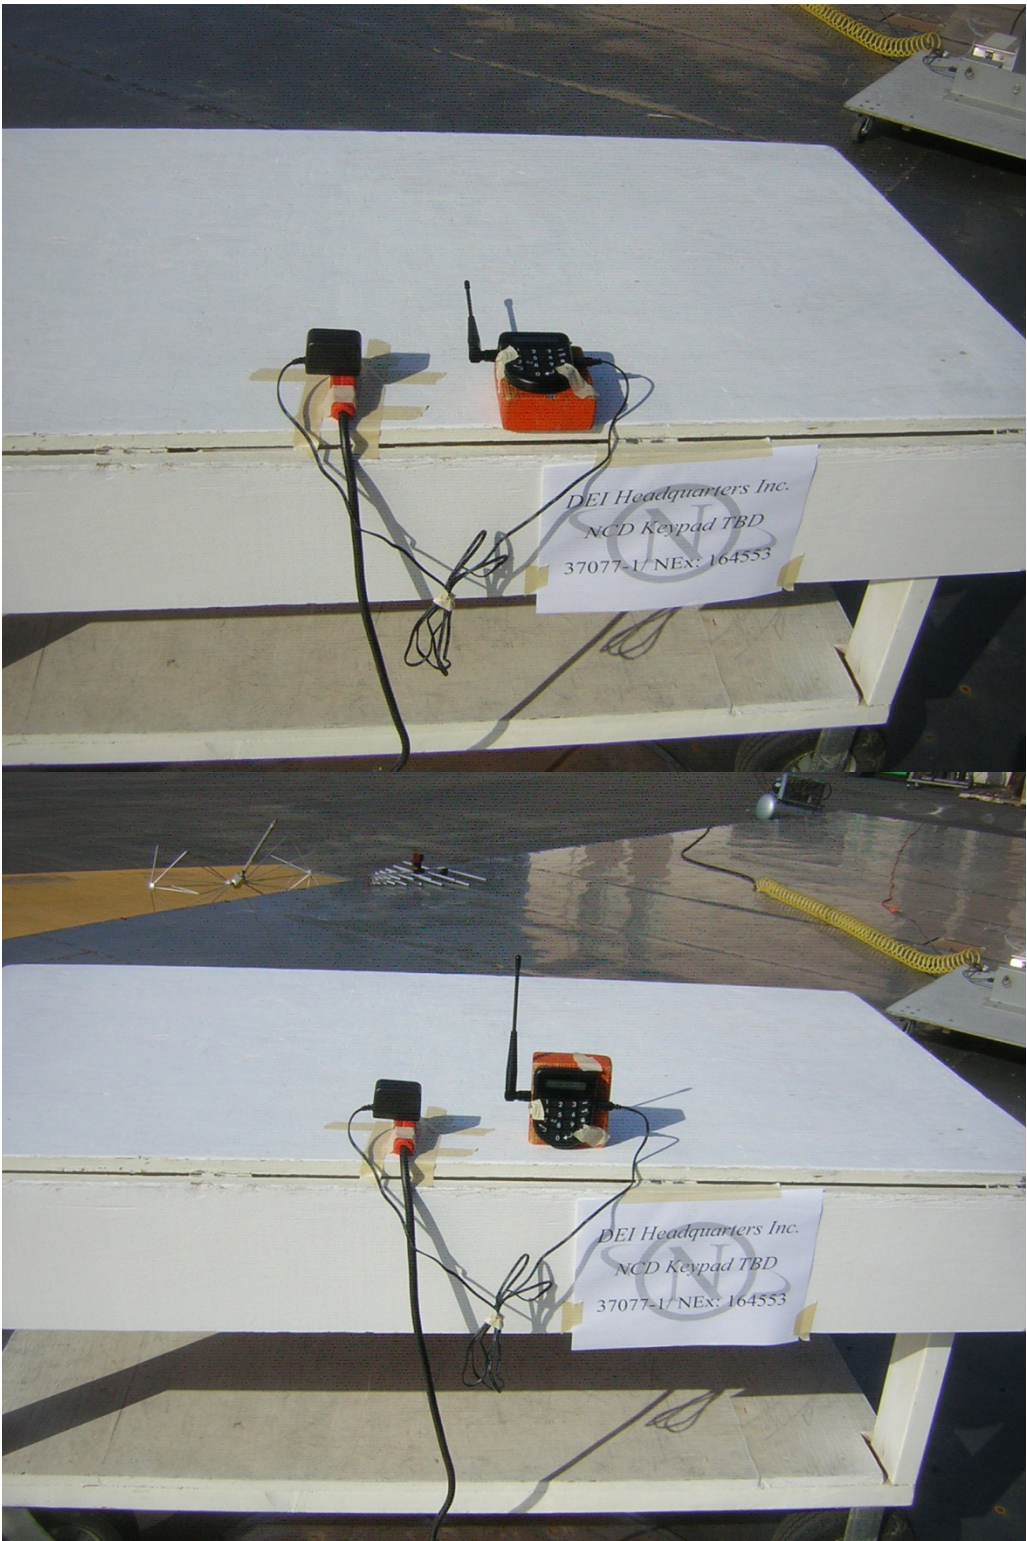


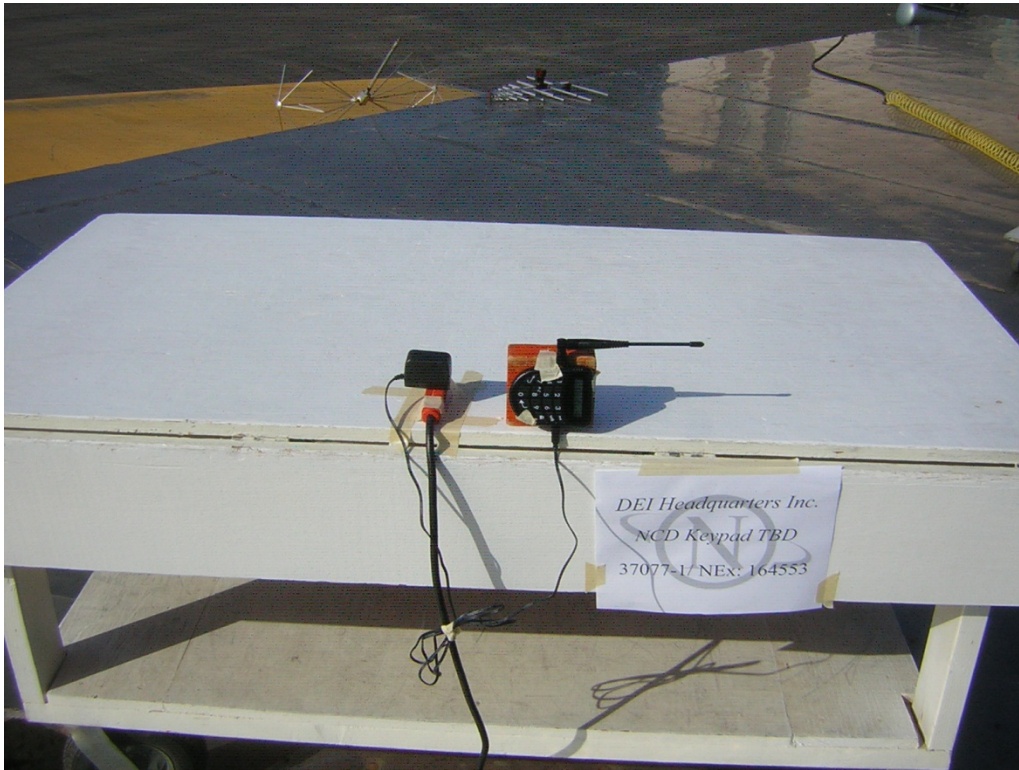

MODEL 6703A (HUB), keypad required for changing frequencies, test mode. radiated emissions



AC power line conducted emissions, **MODEL 6703A, no enclosure**

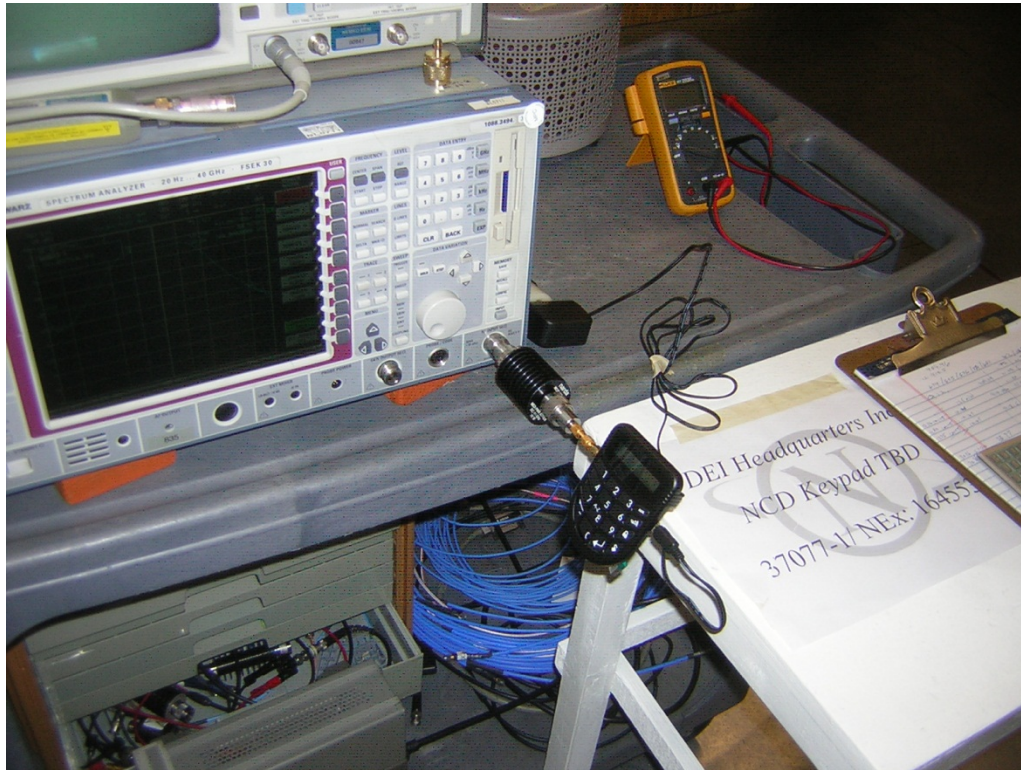

MODEL 6703A (HUB), keypad required for changing frequencies, test mode.

Additional setups – Carlsbad

Model 7703A (KEY PAD)



MODEL 6703A (HUB)