LOCAL ALARI
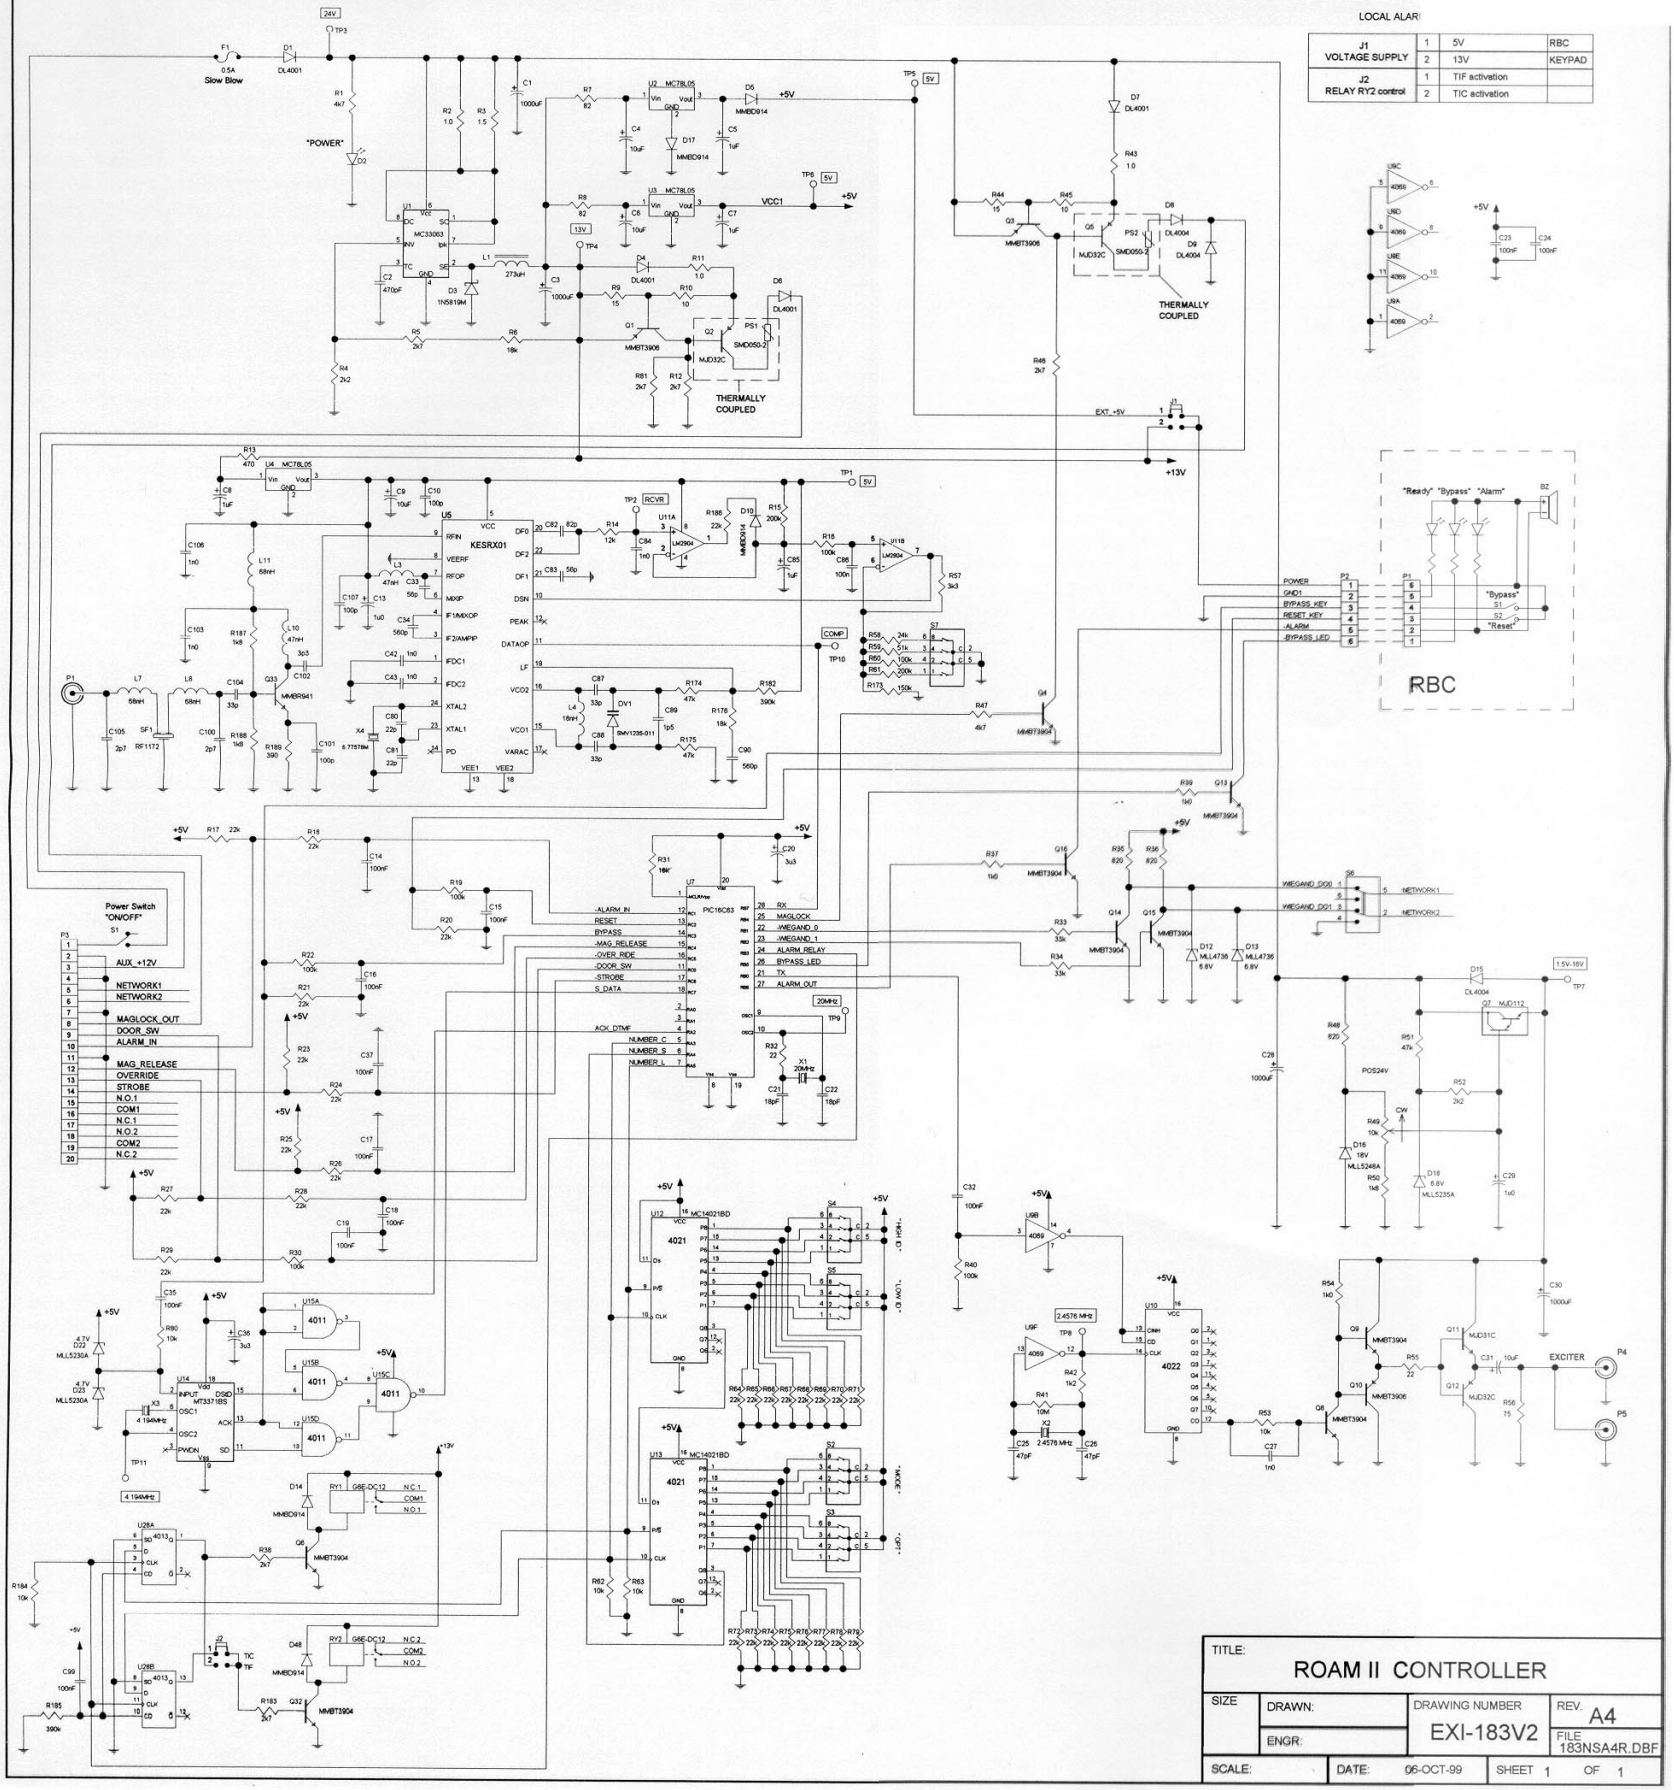
J1 VOLTAGE SUPPLY	1	5V	RBC
	2	13V	KEYPAD
J2 RELAY RY2 control	1	TIF activation	
	2	TIC activation