



#### n78L, 100MHz Bandwidth, DFT-s-256QAM (PAPR)






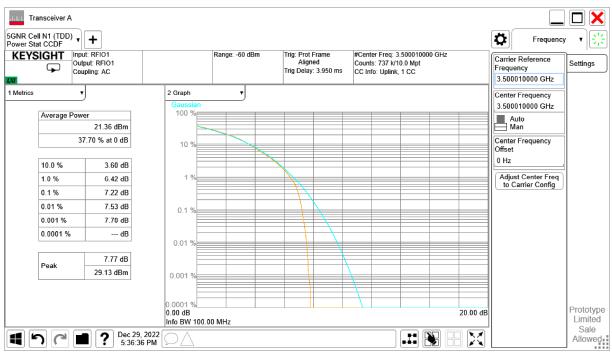

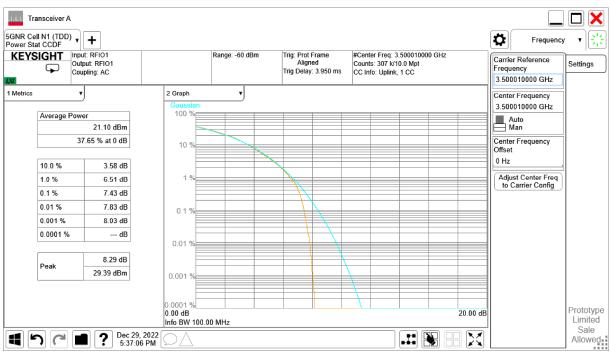


#### n78L, 100MHz Bandwidth, CP-16QAM (PAPR)



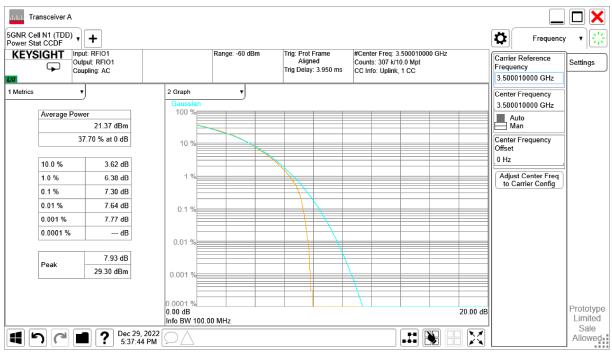



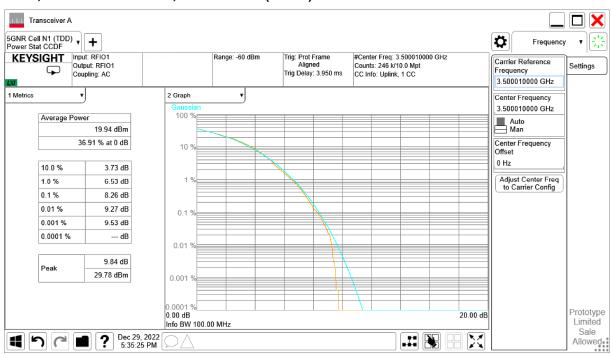


#### n78L, 100MHz Bandwidth, CP-256QAM (PAPR)




#### n78H,100MHz

Frequency (MHz)	PAPR (dB)								
	DFT-s-pi/2 BPSK	DFT-s-QPSK	DFT-s-16QAM	DFT-s-64QAM	DFT-s-256QAM	CP-QPSK	CP-16QAM	CP-64QAM	CP-256QAM
3750	4.40	5.66	6.29	6.56	6.59	7.37	7.42	7.47	8.33


#### n78H, 100MHz Bandwidth, DFT-s-pi/2 BPSK (PAPR)

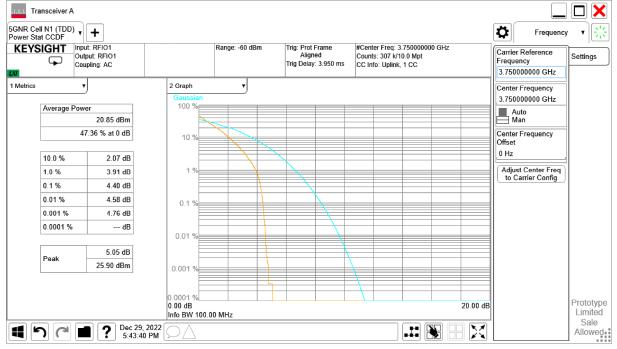

n78H, 100MHz Bandwidth, DFT-s-QPSK (PAPR)

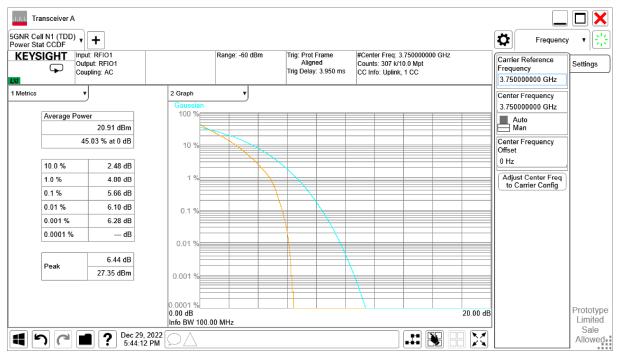




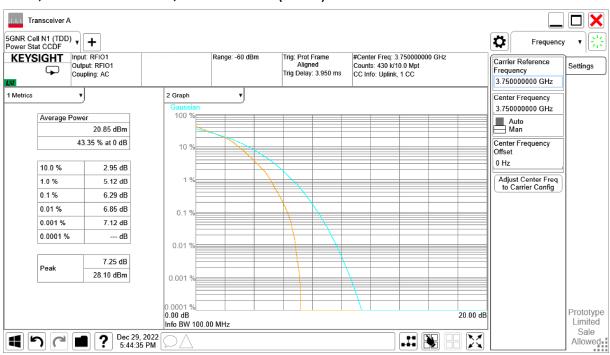


#### n78H, 100MHz Bandwidth, DFT-s-16QAM (PAPR)



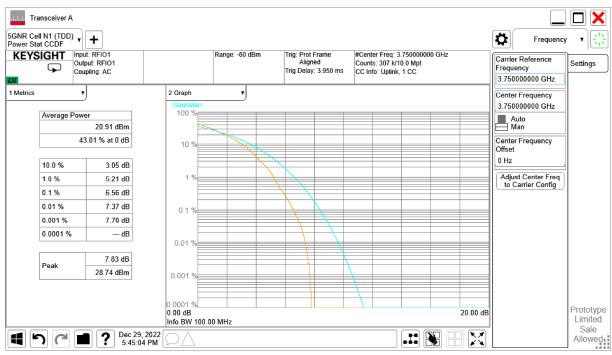




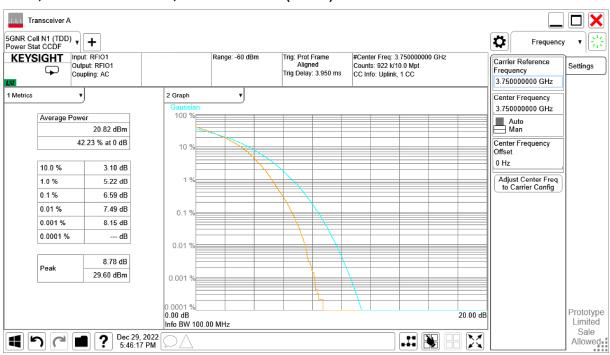


#### n78H, 100MHz Bandwidth, DFT-s-256QAM (PAPR)



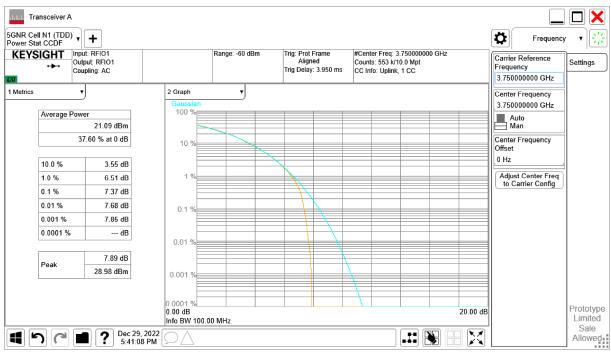




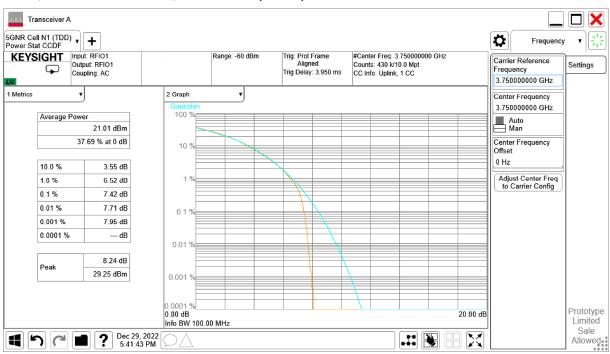


#### n78H, 100MHz Bandwidth, CP-16QAM (PAPR)



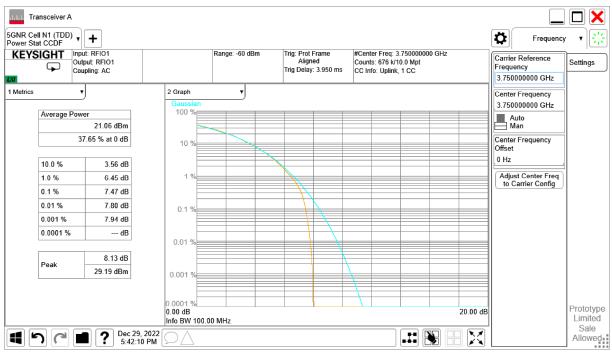



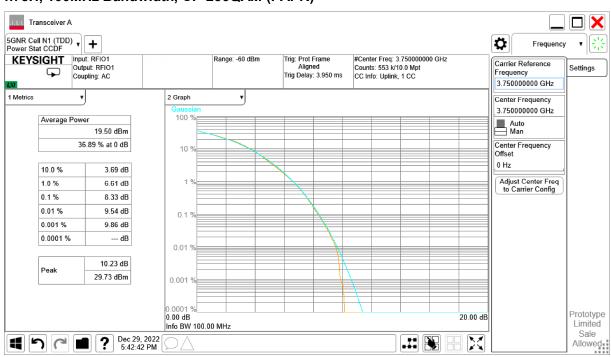

#### n78H, 100MHz Bandwidth, CP-256QAM (PAPR)

Note: Expanded measurement uncertainty is U = 0.48, k = 2



### **ANNEX B ccreditation Certificate**



# **Accredited Laboratory**

A2LA has accredited

## SHENZHEN ACADEMY OF INFORMATION AND COMMUNICATIONS TECHNOLOGY

Shenzhen, People's Republic of China

for technical competence in the field of

## **Electrical Testing**

This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017 General requirements for the competence of testing and calibration laboratories. This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality management system (refer to joint ISO-ILAC-IAF Communiqué dated April 2017).



Presented this 23<sup>rd</sup> day of November 2021.

Vice President, Accreditation Services For the Accreditation Council Certificate Number 4353.01 Valid to November 30, 2023

For the tests to which this accreditation applies, please refer to the laboratory's Electrical Scope of Accreditation.



### **ANNEX C Certificate of Brand Authorization**



\*\*\*END OF REPORT\*\*\*