
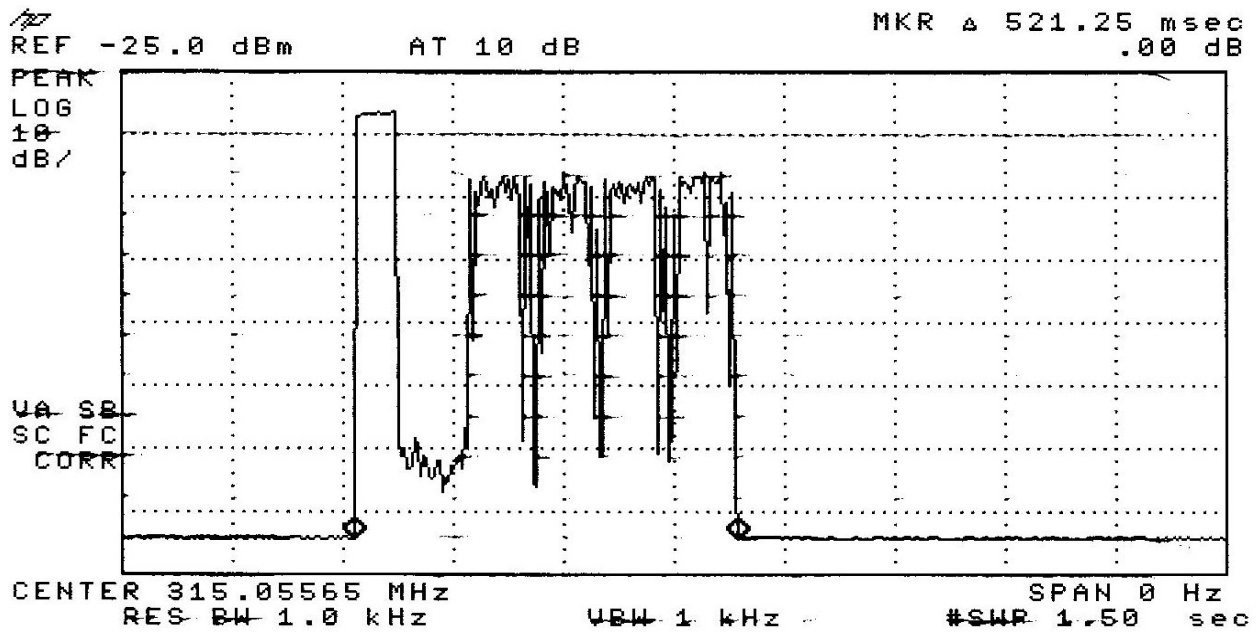


Periodic operation characteristics
Manually operated transmitter deactivation
Key: DC_02

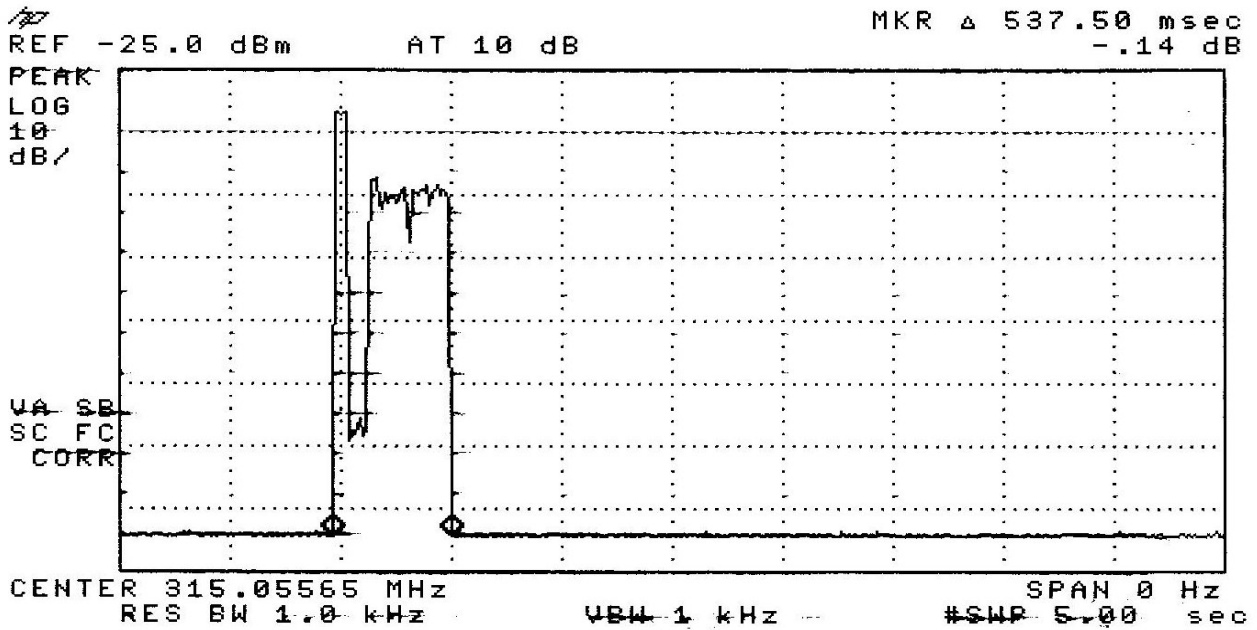

15.231 (a1) A manually operated transmitter shall employ a switch that will automatically deactivate the transmitter within not more than 5 seconds of being released