



HDU – 200 EMS Part Number 1541-A-3000

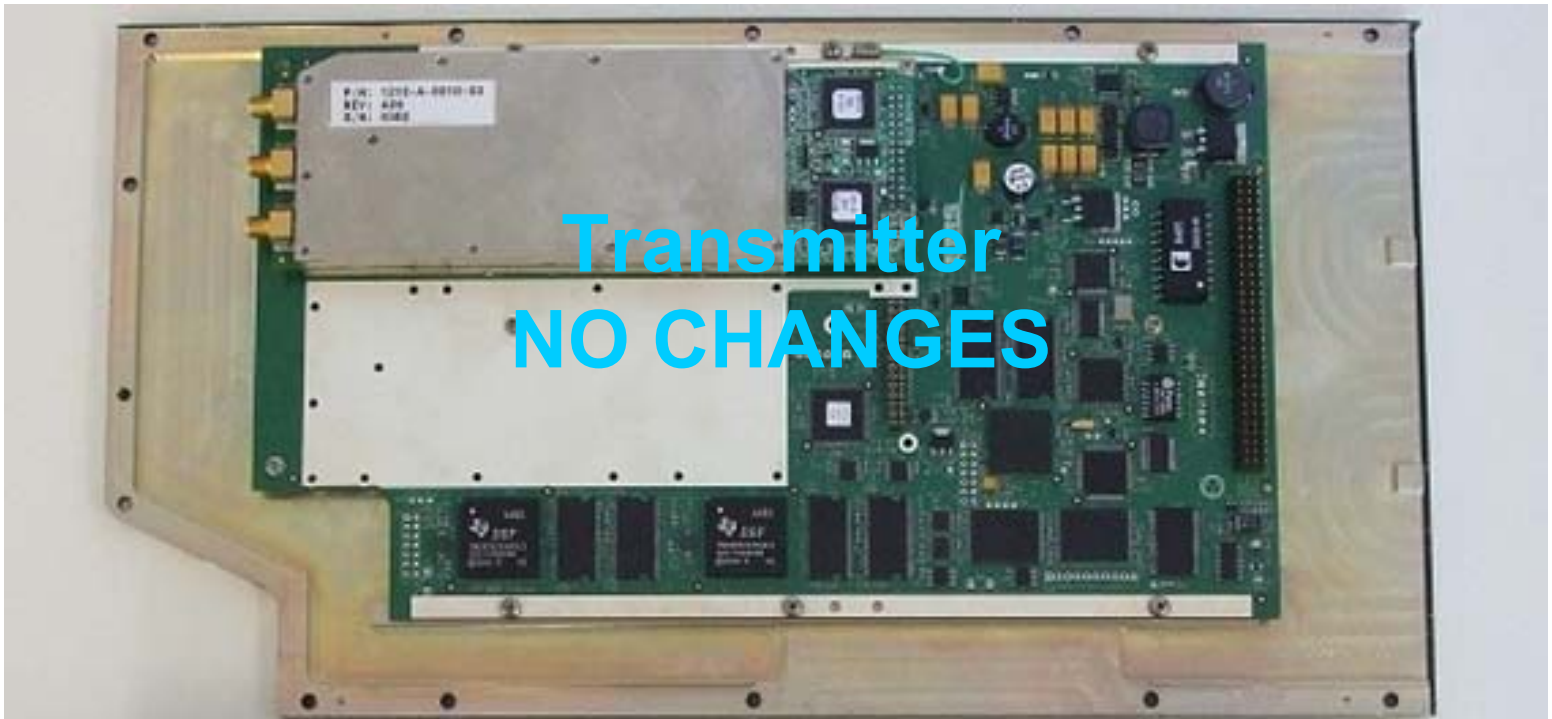

**Transmitter
NO CHANGES**

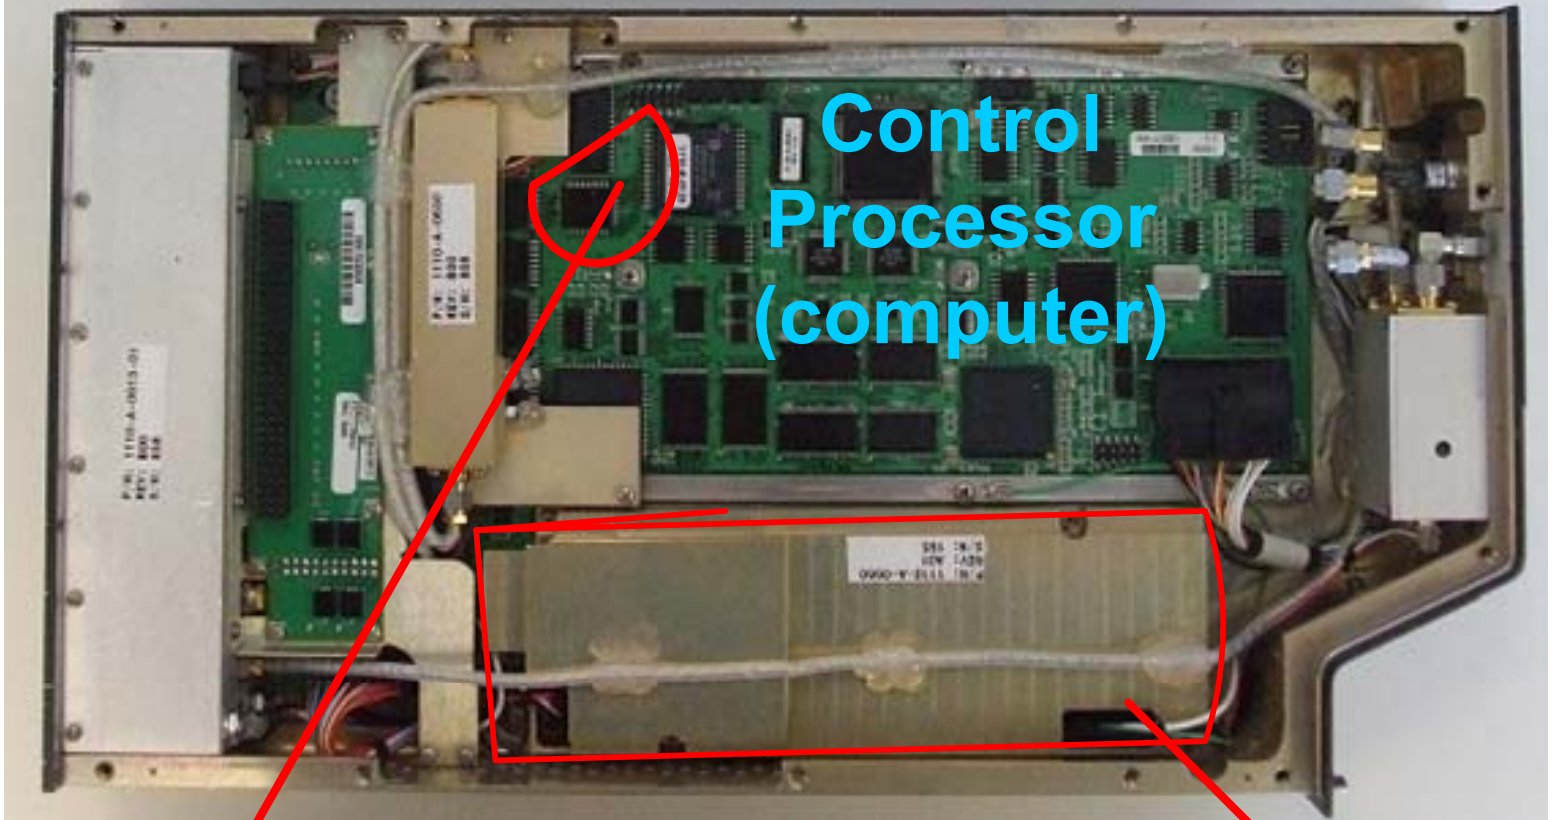

**Control
Processor
(computer)**

Memory for processor has been added in this section of the Control Processor (computer)

Power Supply Input has changed from 115Vac to +28VdC input. All internal voltages to the cards remain the same.