




Ref Lvl	Delta 1 [T1]	RBW	20 kHz	RF Att	10 dB
102 dBV	-0.48 dB	VBW	100 kHz	Unit	dBV
	69.138277 ms	SWT	150 ms		

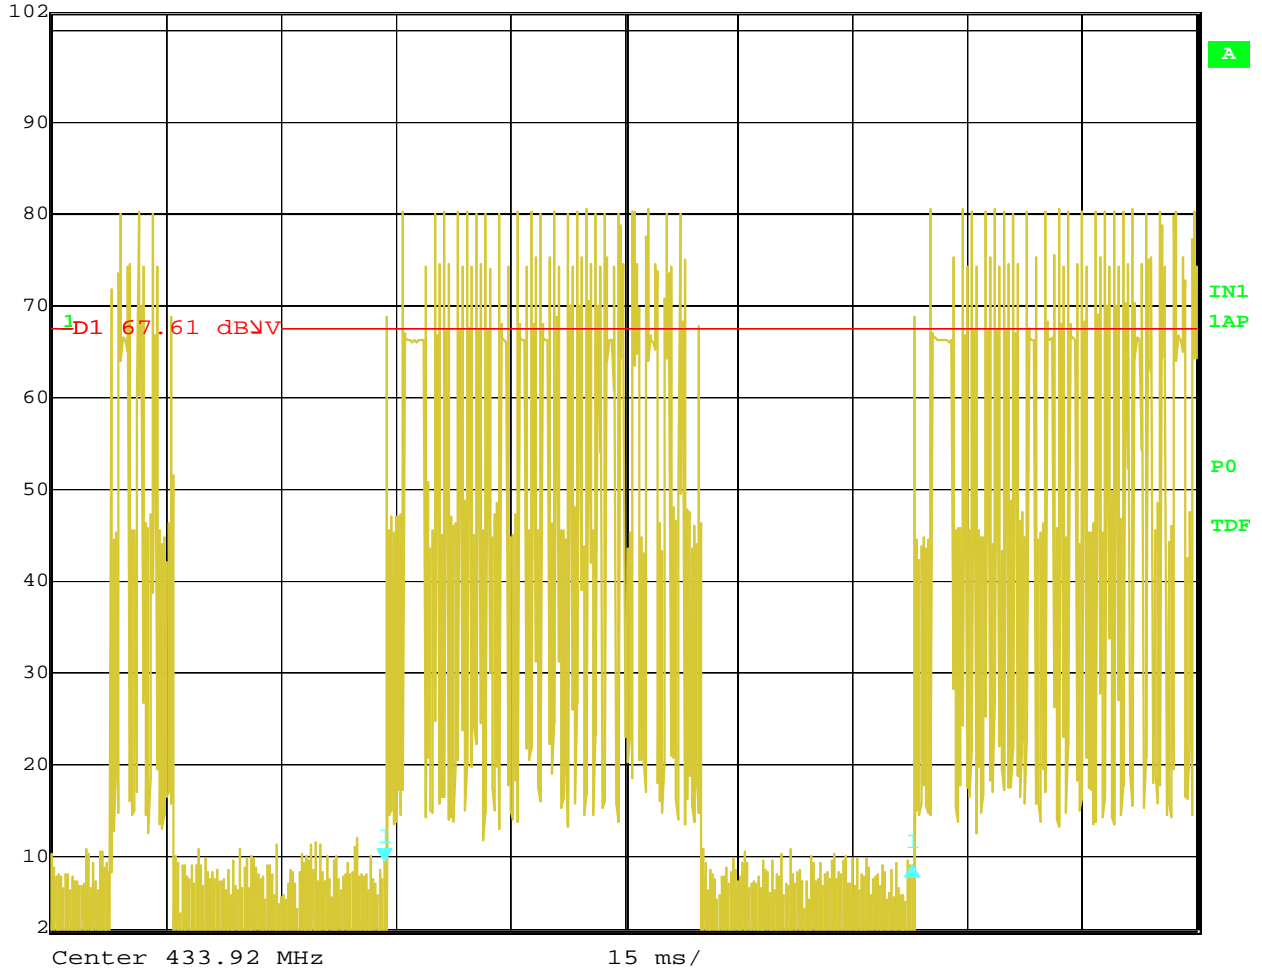


Date: 20.JUL.2010 09:50:16

Time of Pulse with Blanking Interval = 69.138277 mS



Ref Lvl	Delta 1 [T1]	RBW	30 kHz	RF Att	10 dB
102 dBμV	4.44 dB	VBW	100 kHz	Unit	dBμV
	41.282565 ms	SWT	50 ms		

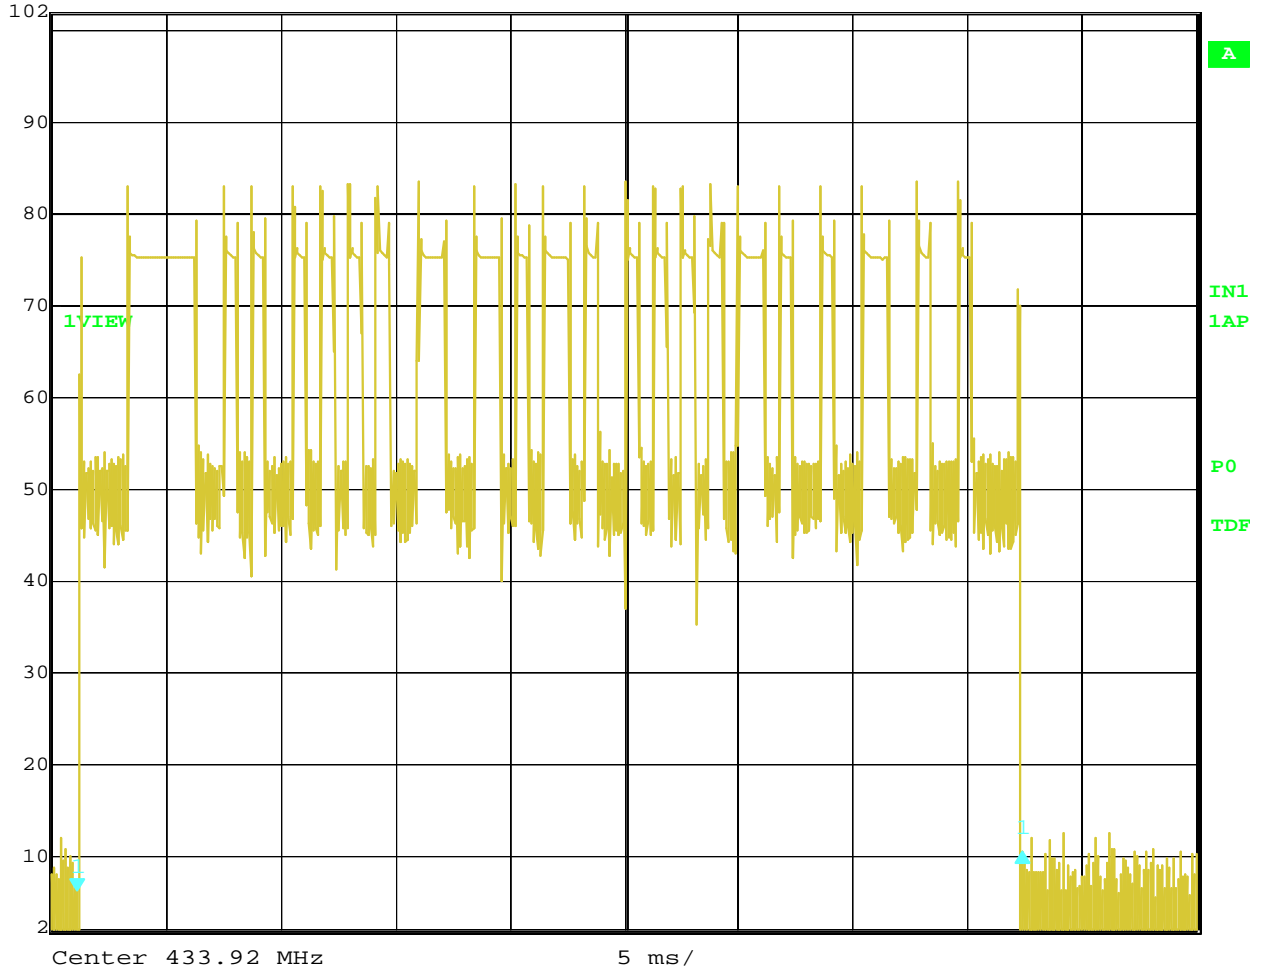


Date: 20.JUL.2010 10:47:37

Time of One Pulse Train = 41.282565 mS



Delta 1 [T1] RBW 30 kHz RF Att 10 dB
Ref Lvl 46.61 dB VBW 100 kHz
102 dB μ V 100.200401 μ s SWT 10 ms Unit dB μ V

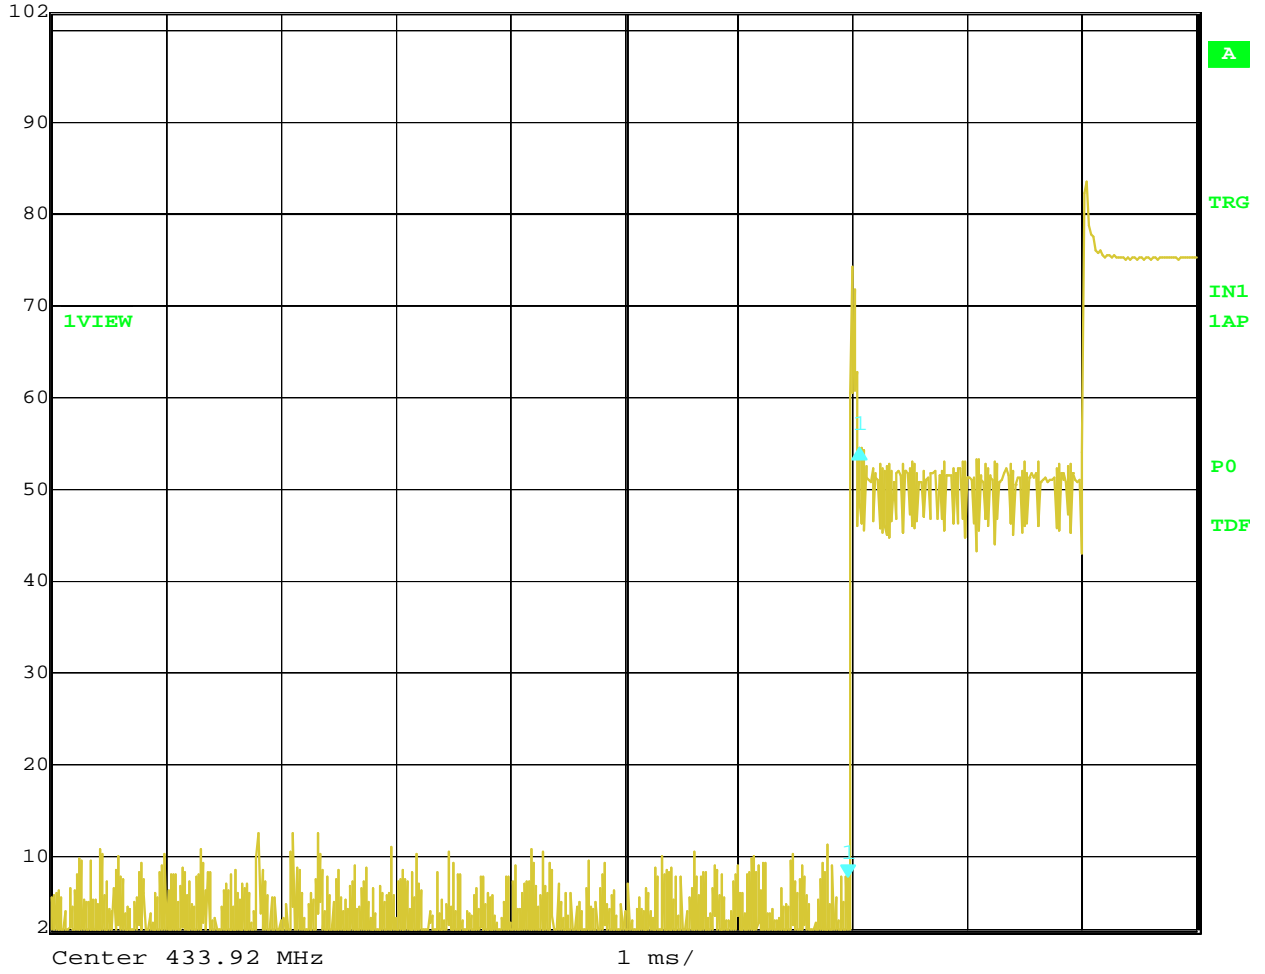


Date: 20.JUL.2010 10:34:52

Time of First Pulse = 100.200401 μ s



Ref Lvl	Delta 1 [T1]	RBW	30 kHz	RF Att	10 dB
102 dBV	1.73 dB	VBW	100 kHz	Unit	dBV
	3.086172 ms	SWT	10 ms		

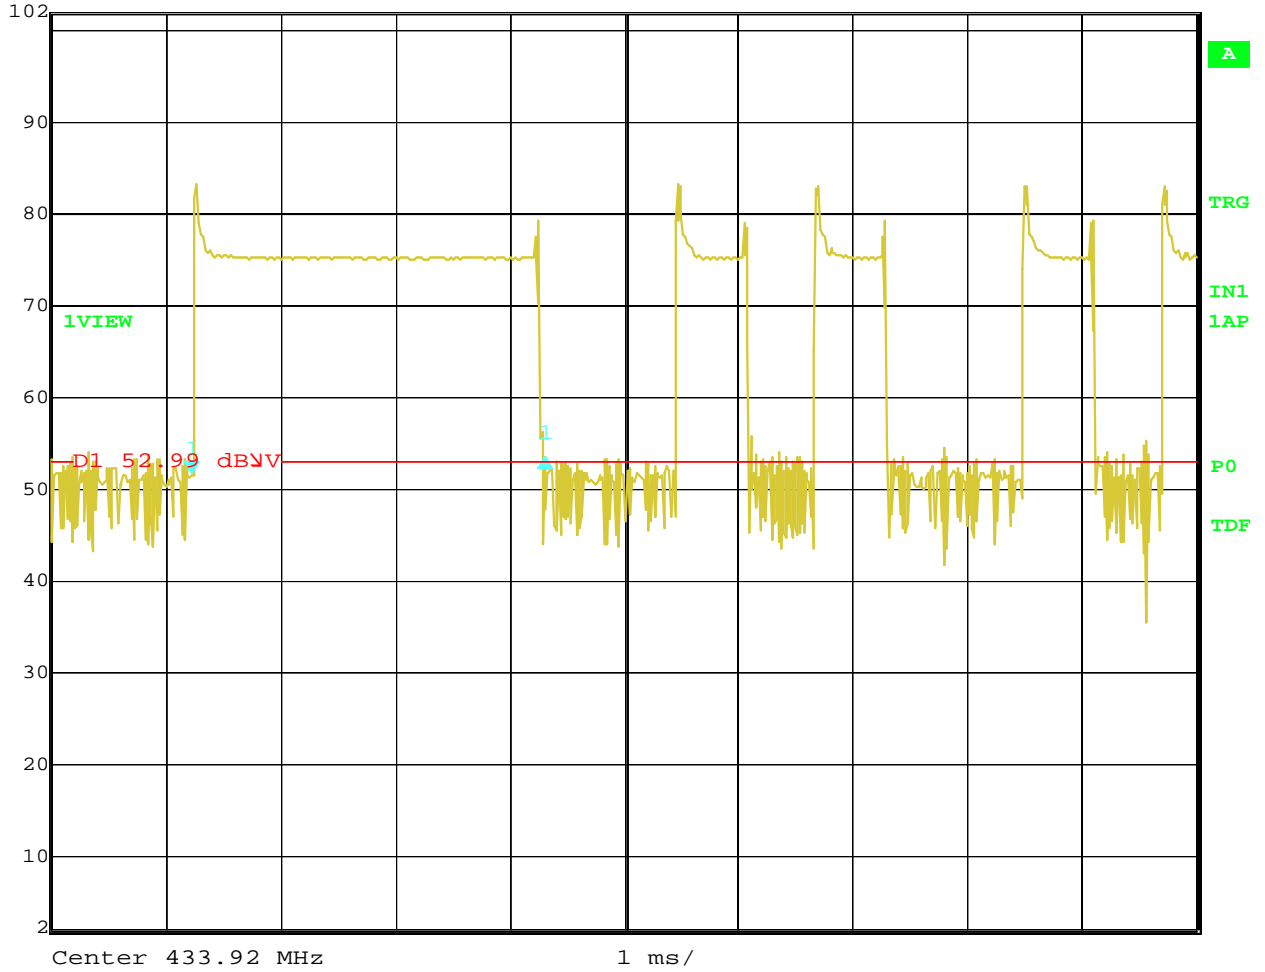


Date: 20.JUL.2010 10:36:35

Time of The Large Pulse = 3.086172 mS



Delta 1 [T1] RBW 30 kHz RF Att 10 dB
Ref Lvl 1.11 dB VBW 100 kHz
102 dBV 1.302605 ms SWT 10 ms Unit dBV

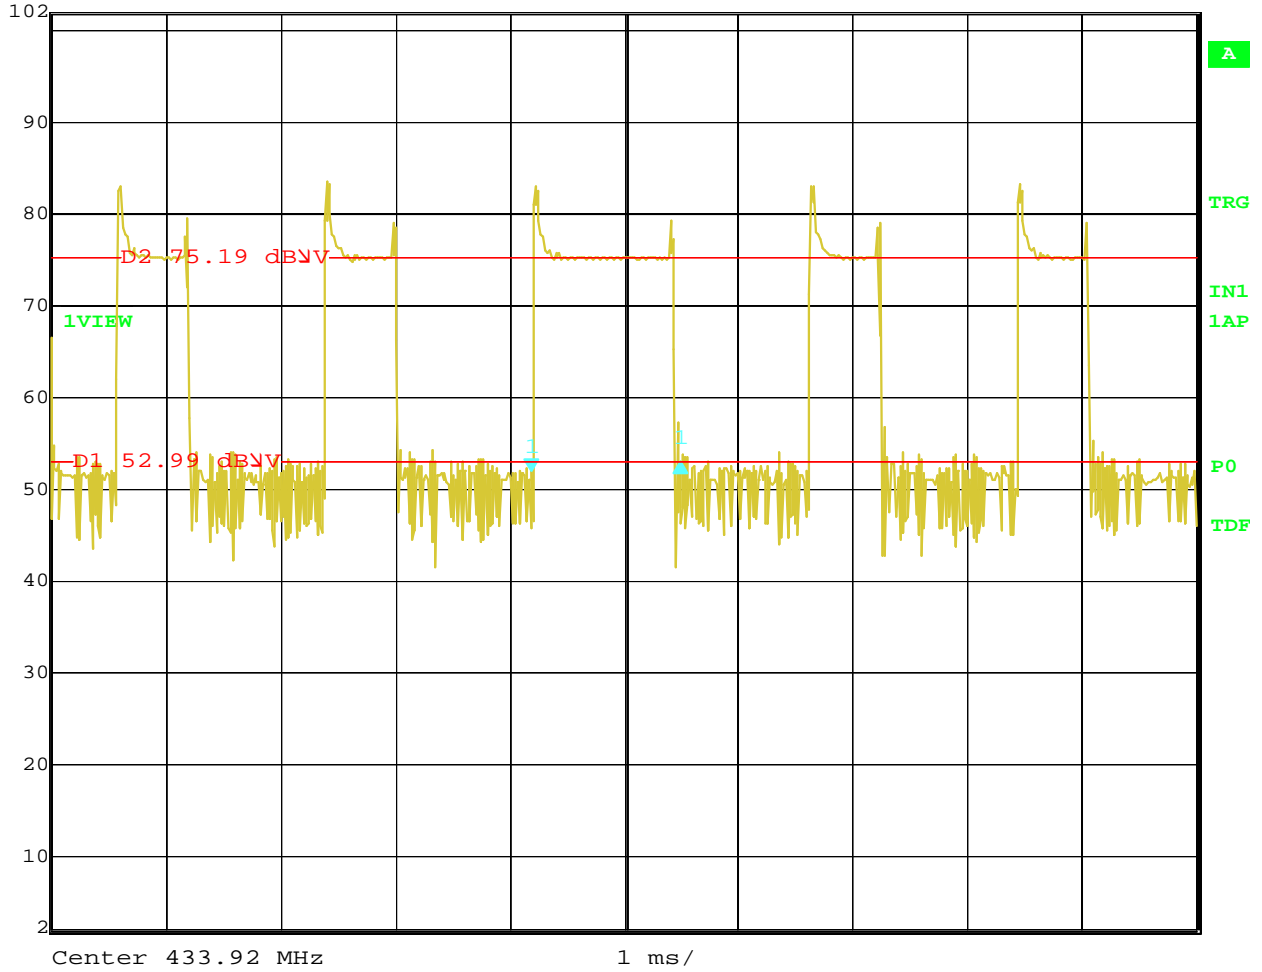


Date: 20.JUL.2010 10:38:40

Time of Medium Pulse = 1.302605 mS



Delta 1 [T1] RBW 30 kHz RF Att 10 dB
Ref Lvl 3.72 dB VBW 100 kHz
102 dBV 681.362725 μ s SWT 10 ms Unit dBV

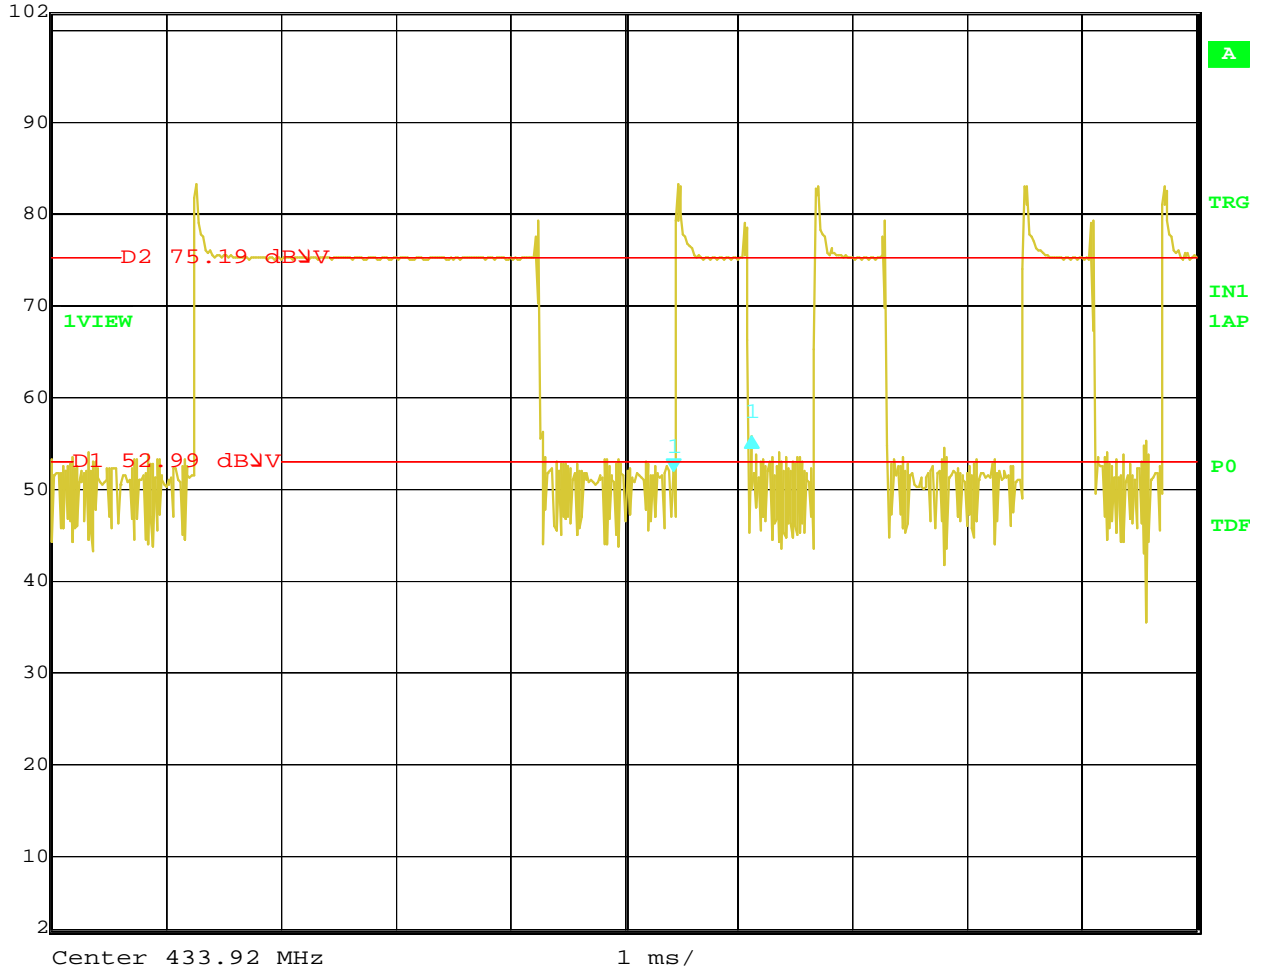


Date: 20.JUL.2010 10:37:19

Time of Small Pulse = 681.362725 μ s



Ref Lvl	Delta 1 [T1]	RBW	30 kHz	RF Att	10 dB
102 dBV	-15.51 dB	VBW	100 kHz		
	120.240481 μ s	SWT	20 ms	Unit	dBV

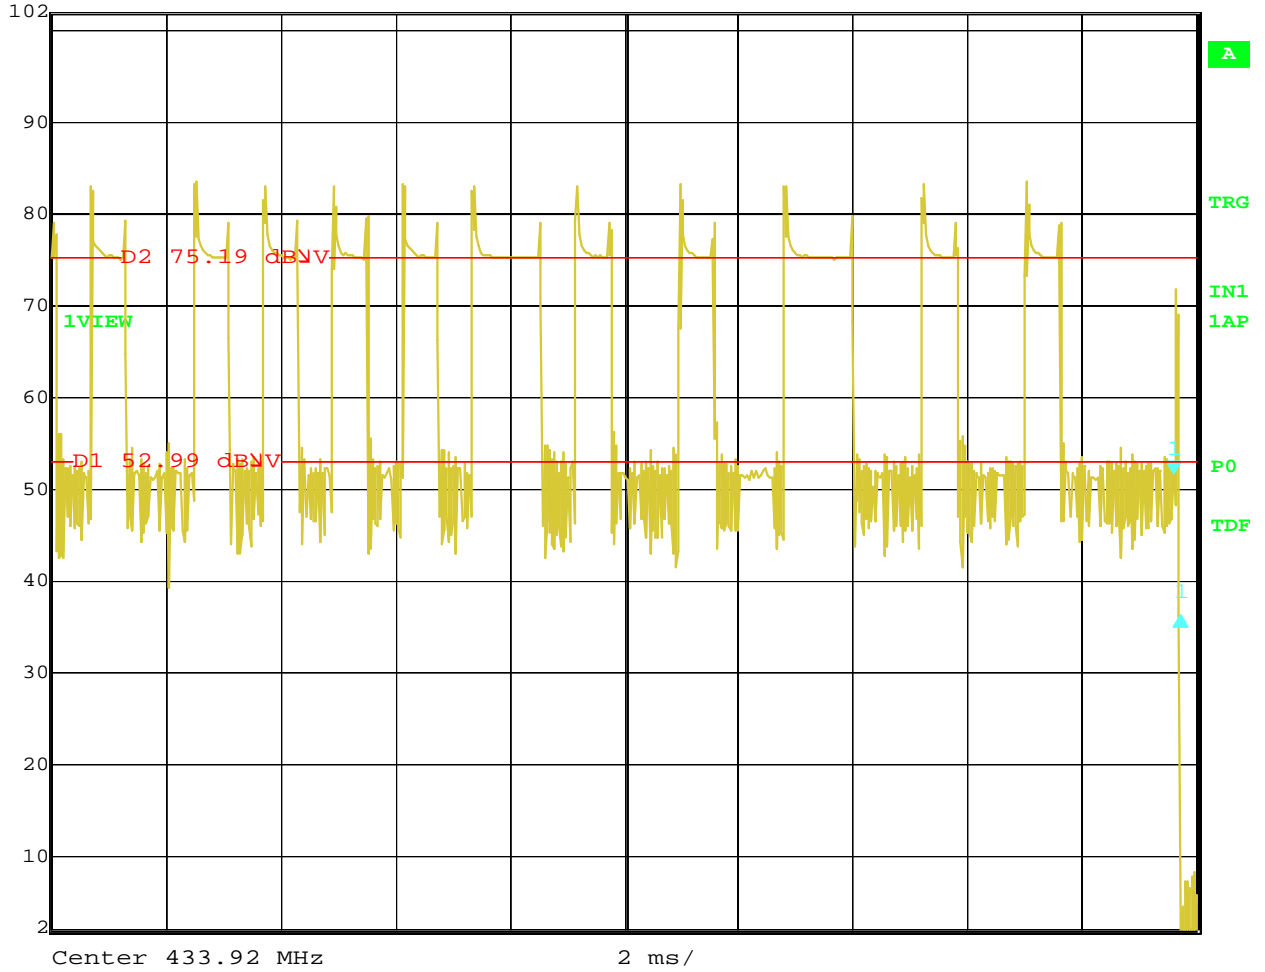


Date: 20.JUL.2010 10:40:51

Time of Last Pulse = 120.240481 μ s



Marker 1 [T1] RBW 30 kHz RF Att 10 dB
Ref Lvl 52.99 dBuV VBW 100 kHz
102 dBuV 7.975952 ms SWT 10 ms Unit dBuV

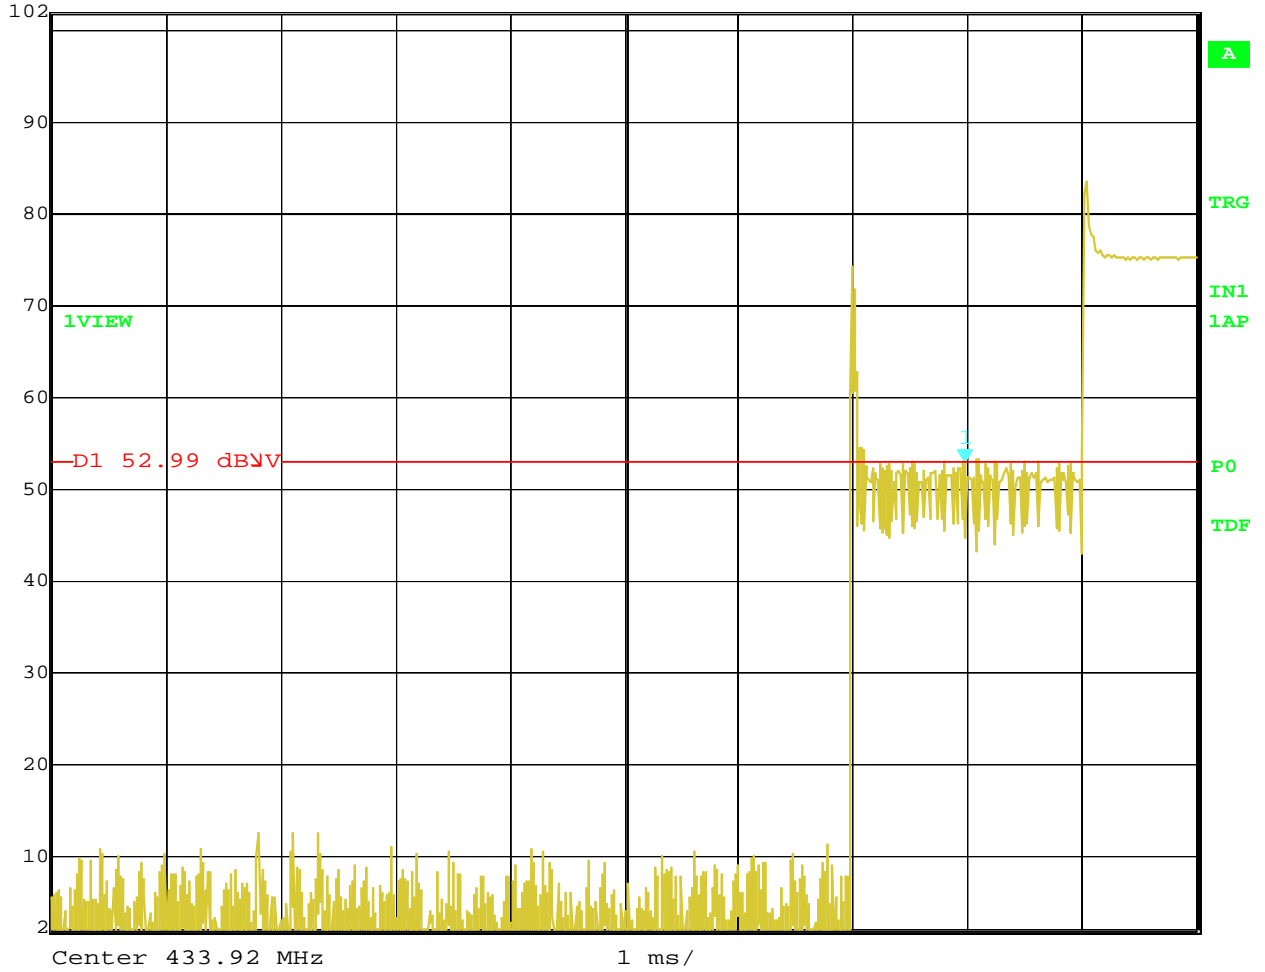


Date: 20.JUL.2010 10:35:31

Minimum Level for On Time = 52.99 dBuV



Marker 1 [T1] RBW 30 kHz RF Att 10 dB
Ref Lvl 75.04 dBuV VBW 100 kHz
102 dBuV 105.410822 ms SWT 50 ms Unit dBuV

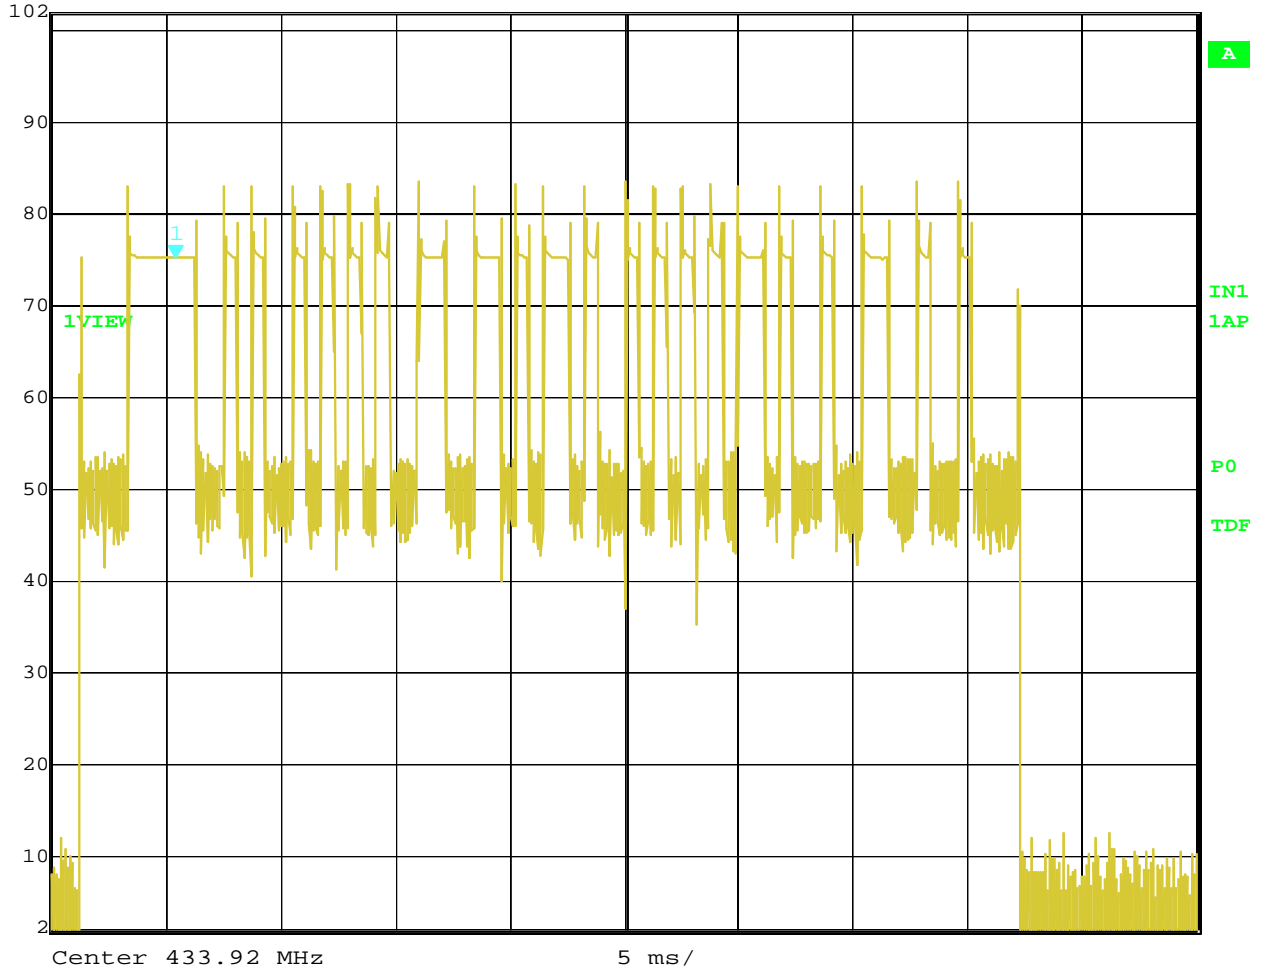


Date: 20.JUL.2010 11:06:57

Maximum Level for On Time = 75.04 dBuV



Ref Lvl
102 dBμV

RBW 30 kHz RF Att 10 dB
VBW 100 kHz
SWT 50 ms Unit dBμV

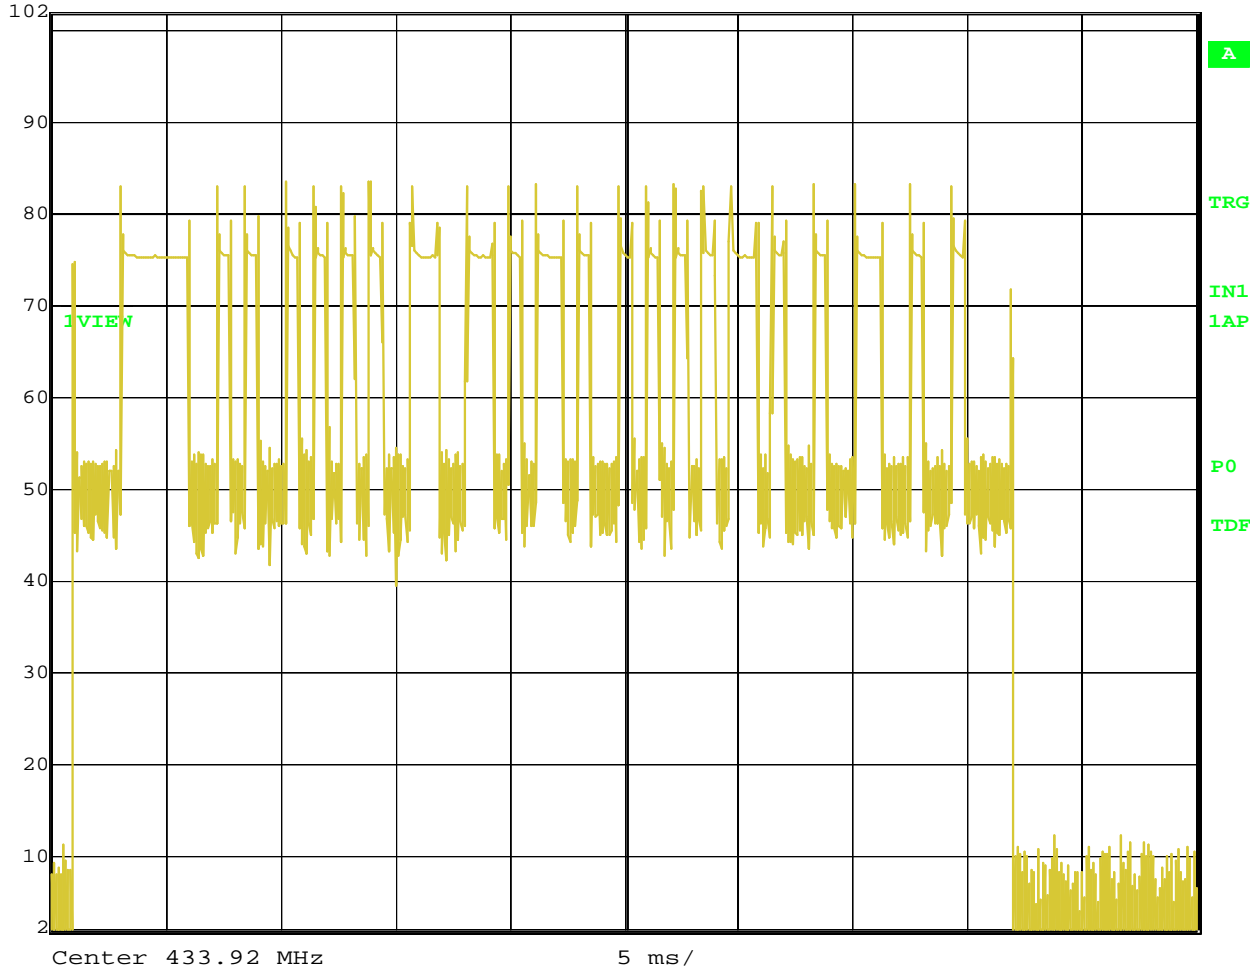

Date: 20.JUL.2010 10:08:12

First Pulse = 1 * 100.200401 uS = 0.100200401 mS
 Number of Large Pulses = 1 * 3.086172 mS = 3.086172 mS
 Number of Medium Pulses = 5 * 1.302605 mS = 6.513025 mS
 Number of Small Pulses = 16 * 681.362725 uS = 10.9018036 mS
 Last Pulse = 1 * 120.240481 uS = 0.120240481 mS

Total Time at 100% Amplitude = 20.721441482 mS
 Total Time of Minimum Amplitude = 20.561123518 mS
 Amplitude Difference between 100% and Minimum Amplitude = 22.05 dB
 Effective On Time of Minimum Amplitude Portion = 1.62385 mS
 Total Duty Cycle = 22.345291482 mS / 69.138277 mS = 32.32%
 Peak to Average Ratio = -9.81 dB