




DRAWN: EFFIE	DATED: 90CT06	COMPANY: ARTCOM
CHECKED:	DATED:	TITLE: AC420 (US) NURSERY UNIT MAIN
QUALITY CONTROL:	DATED:	SCALE: SIZE: A3 REV: 0
RELEASED:	DATED:	CODE: DRAWING NO: SHEET: 1 OF 1

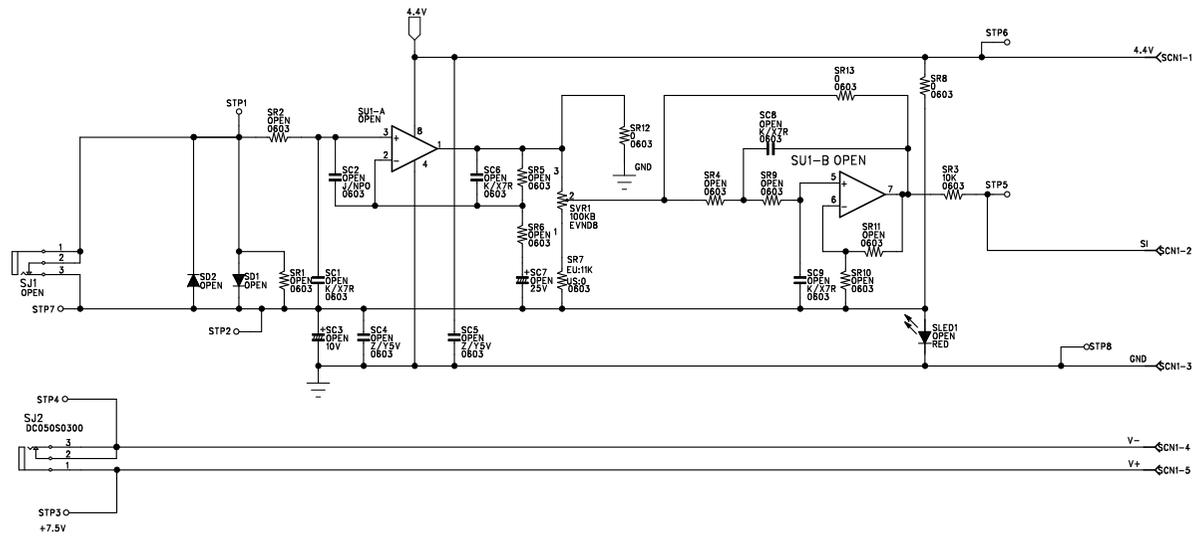

DRAWN: EFFIE	DATED: 100CT06	COMPANY: ARTCOM	
CHECKED:	DATED:	TITLE: AC420 NURSERY DC JACK/VR	
QUALITY CONTROL:	DATED:	SCALE: A3	REV: 0
RELEASED:	DATED:	CODE:	DRAWING NO: SHEET: 1 OF 1

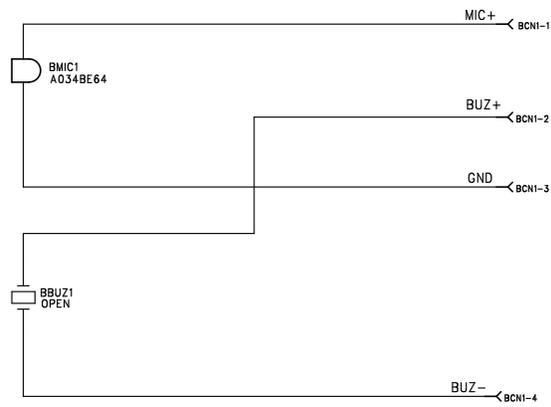

DRAWN: EFFIE	DATED: 10OCT06	COMPANY: ARTCOM
CHECKED:	DATED:	TITLE: AC420
QUALITY CONTROL:	DATED:	NURSERY UNIT(MIC)
RELEASED:	DATED:	SCALE: SIZE: A3 REV: 0
		CODE: DRAWING NO: SHEET: 1 OF 1

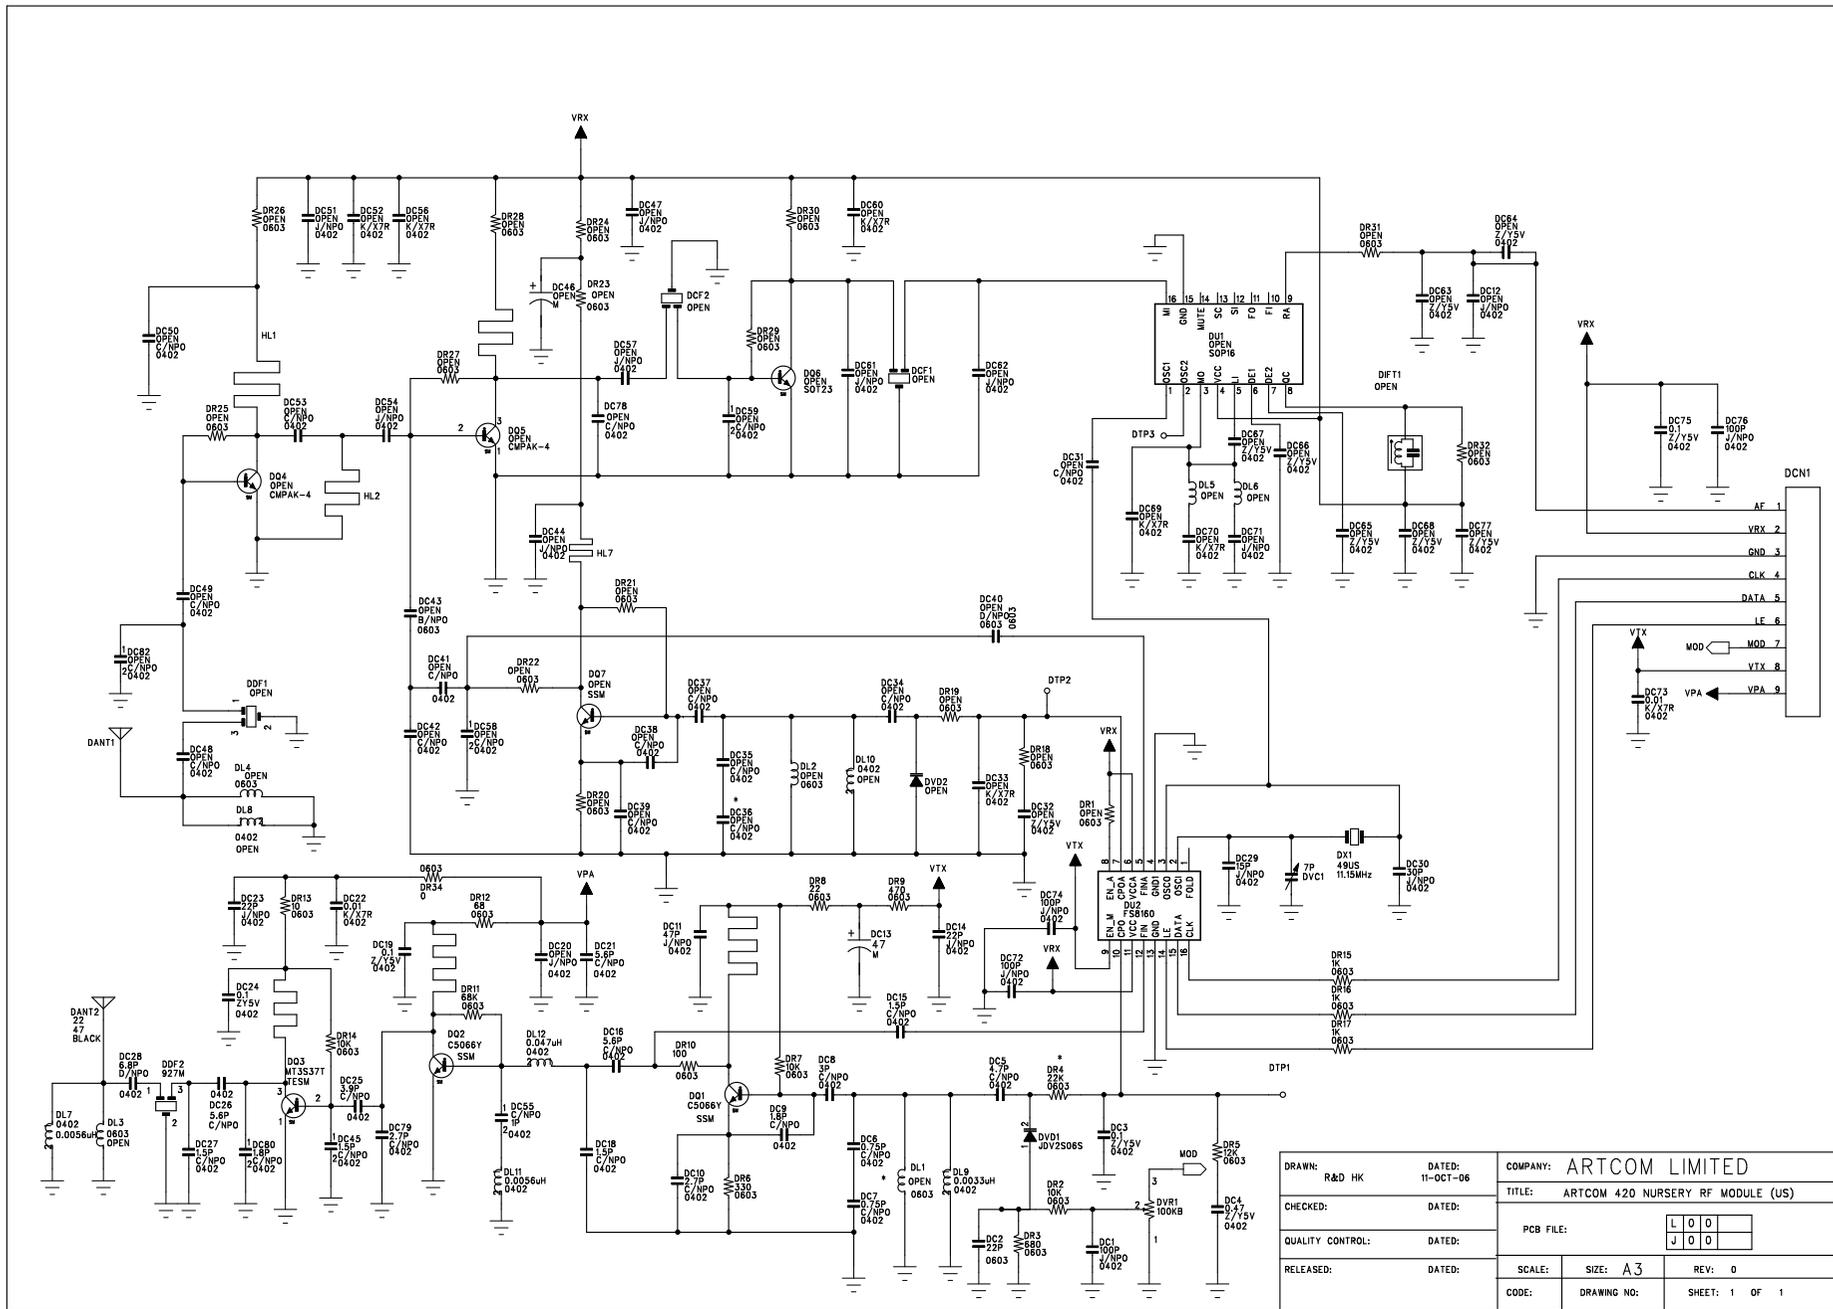

DRAWN: R&D HK	DATED: 11-OCT-06	COMPANY: ARTCOM LIMITED
CHECKED:	DATED:	TITLE: ARTCOM 420 NURSERY RF MODULE (US)
QUALITY CONTROL:	DATED:	PCB FILE: L 0 0 J 0 0
RELEASED:	DATED:	SCALE: SIZE: A3 REV: 0
CODE:	DRAWING NO:	SHEET: 1 OF 1