


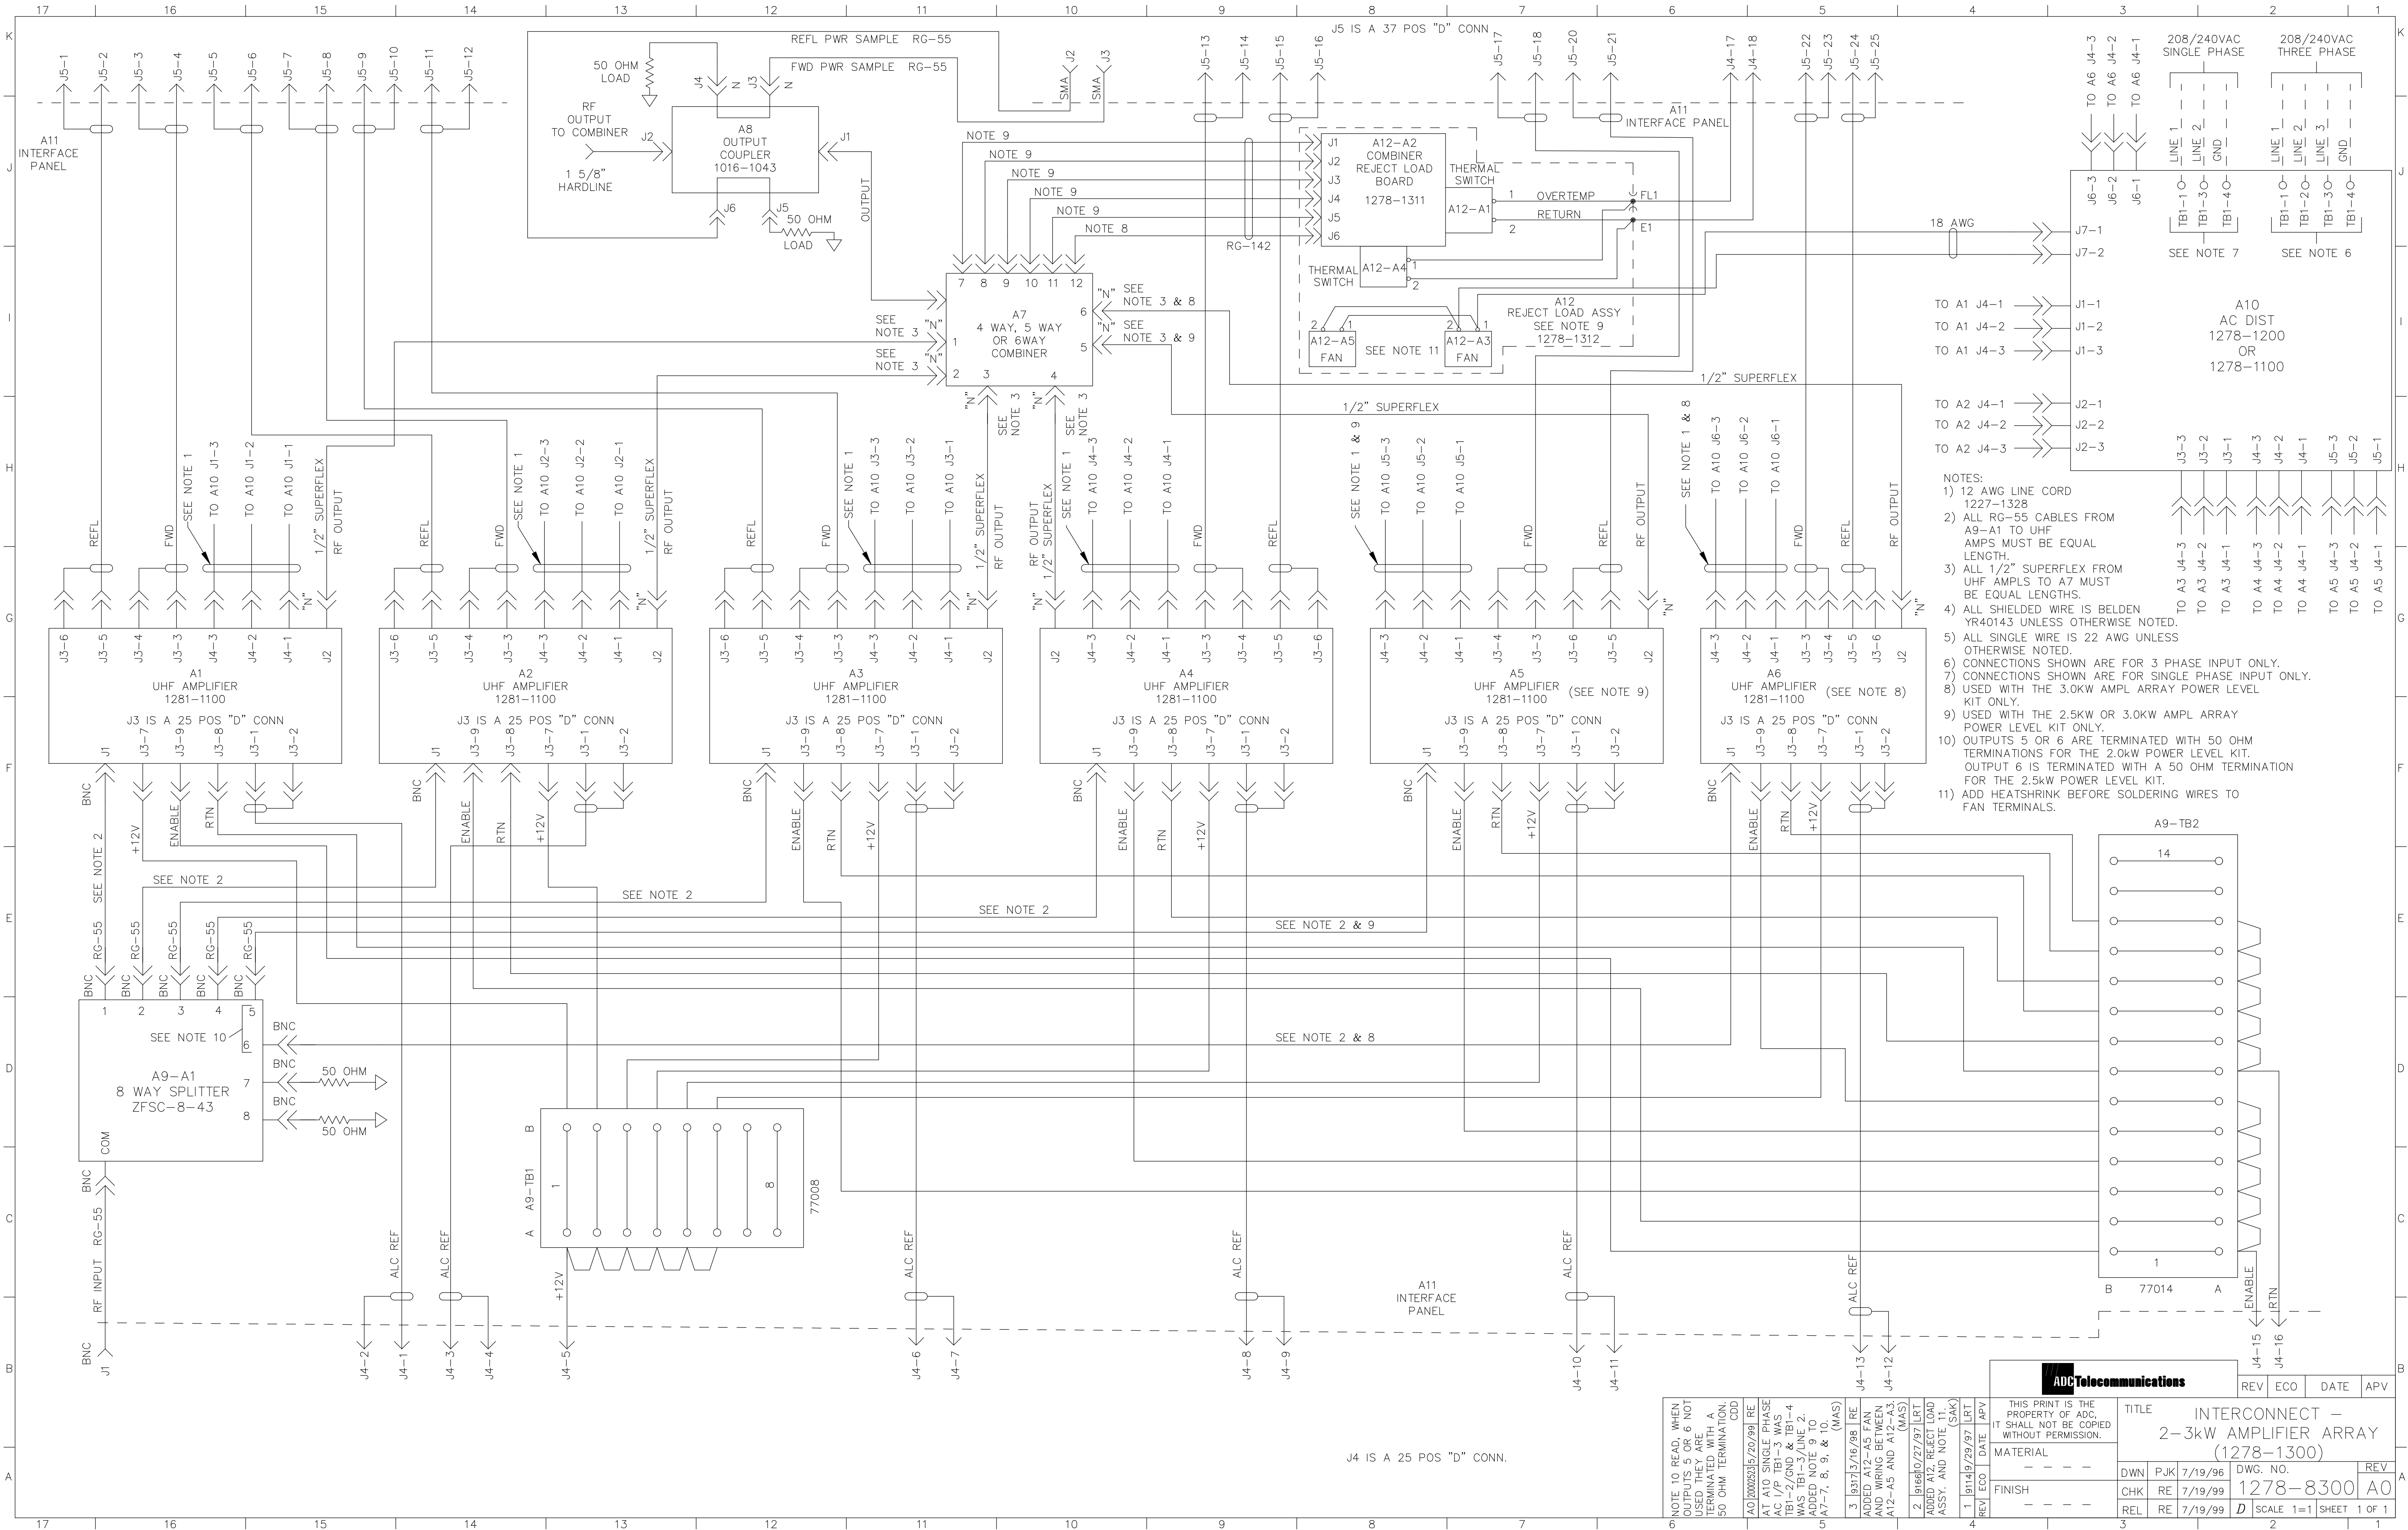

NOTE 10 READ, WHEN OUTPUTS 5 OR 6 NOT USED THEY ARE TERMINATED WITH A 50 OHM TERMINATION.

AO 20020315/20/99 RE
AT A10 SINGLE PHASE AC I/P TBI-3 WAS TBI-2/GND & TBI-4 WAS TBI-3/LINE 2. ADDED NOTE 9 TO A7-7, 8, 9, & (MAS)

3 193713/16/98 RE
ADDED A12-A5 FAN AND WIRING BETWEEN A12-A5 AND A12-A3 (MAS)

2 196610/27/97 LRT
ADDED A12 REJECT LOAD ASSY: AND NOTE 11

1 191419/23/97 LRT
ADDED NOTE 9 TO A7-7, 8, 9, & (MAS)

REV ECO DATE APV

THIS PRINT IS THE PROPERTY OF ADC, IT SHALL NOT BE COPIED WITHOUT PERMISSION.

MATERIAL
FINISH
- - - -

ADC Telecommunications

REV ECO DATE APV

TITLE
INTERCONNECT -
2-3kW AMPLIFIER ARRAY
(1278-1300)

DWN PJK 7/19/96
CHK RE 7/19/99
REL RE 7/19/99

DWG. NO.
1278-8300

SCALE 1=1

REV
A0

SHEET 1 OF 1