




Dallas Headquarters:
802 N. Kealy
Lewisville, TX 75057
Tel: (972) 436-9600
Fax: (972) 436-2667

Nemko Dallas, Inc.

Data Plot

POWERLINE CONDUCTED EMISSIONS

Page 2 of 2
Job No.: 1L0617R Date: 9/6/2002
Specification: 15.2 Temperature(°C): 24
Tested By: David Light Relative Humidity(%) 40
E.U.T.: 2.4 GHz BTS
Configuration: TX FULL POWER AT 8 PORTS - POWERED WITH HP DC POWER SUPPLY

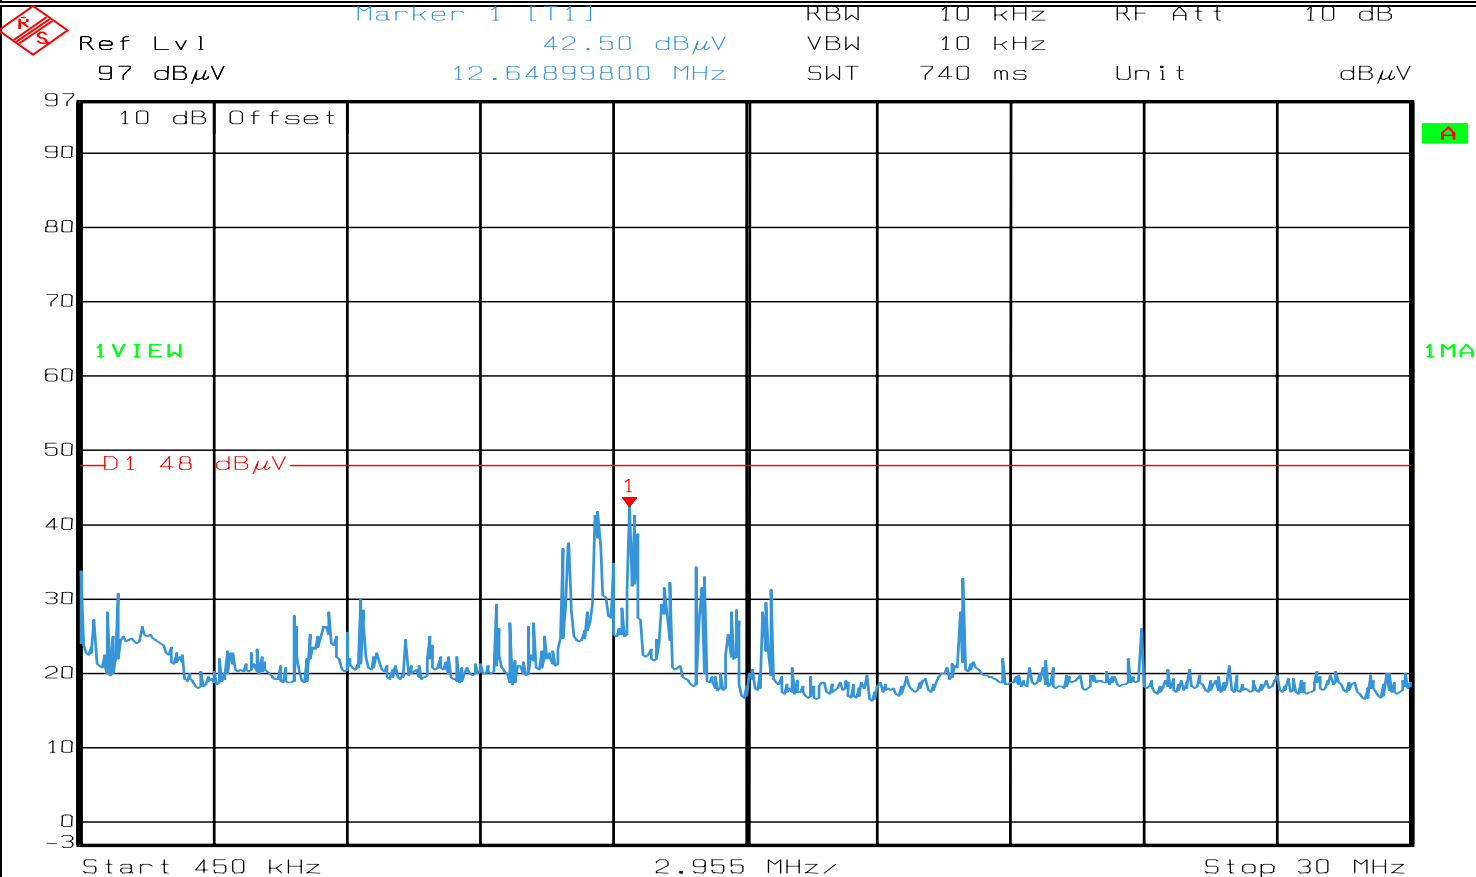

Date: 06.SEP.2002 16:06:28

Notes: L2
Peak measurement meets QP limit of 48 dBuV