Report No.: ZR/2019/A000308

Appendix D

Photographs

1. SAR	measurement	System
--------	-------------	--------


- 2. Photographs of Tissue Simulate Liquid
- 3. Photographs of EUT test position
- 4. EUT Constructional Details
- 5. Serial Number of EUT



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2019/A000308


1. SAR measurement System

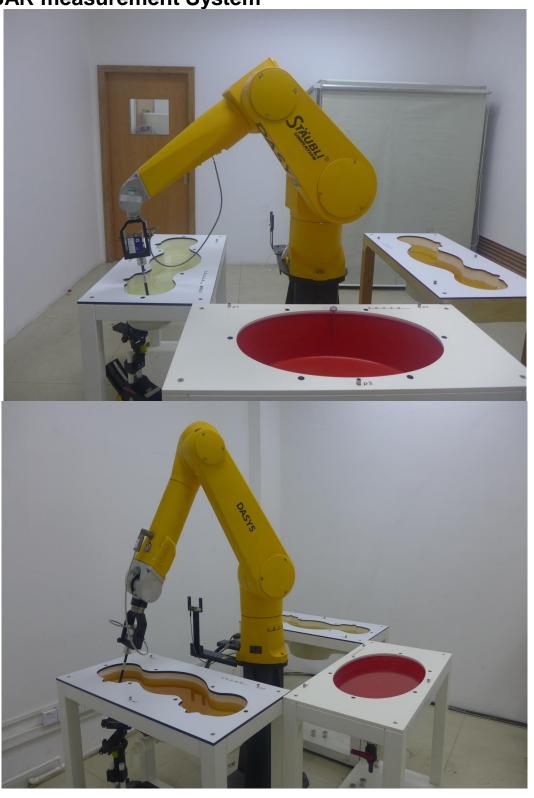



SGS-CSTC Standards Technical Services Co., Ltd. **Shenzhen Branch**

Report No.: ZR/2019/A000308

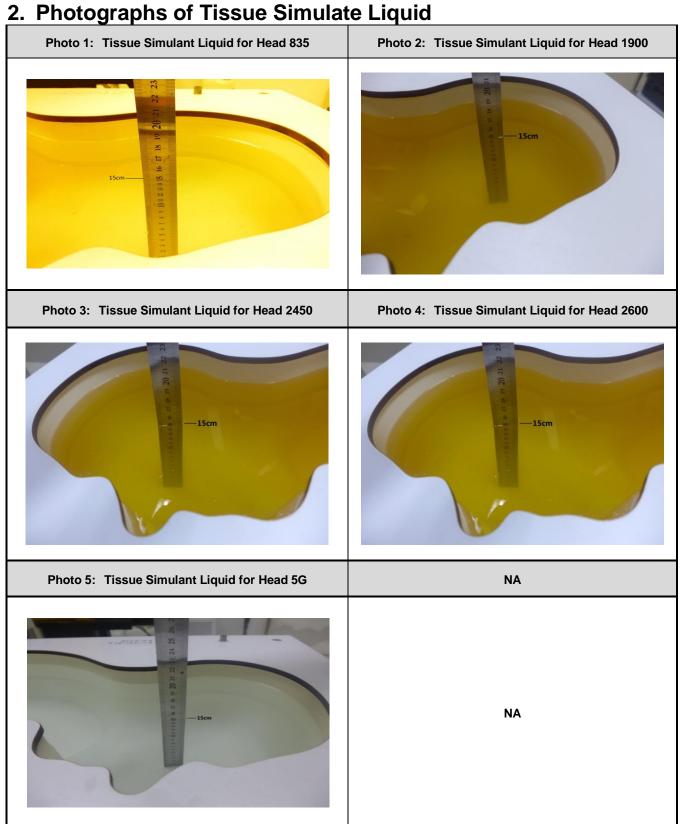



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2019/A000308

3. Photographs of EUT test position

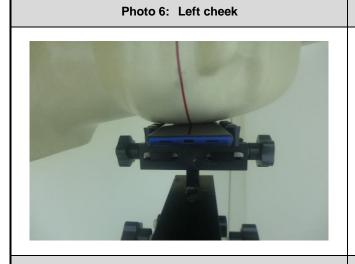
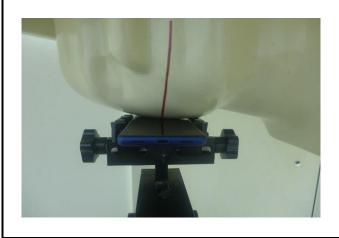


Photo 7: Left tilted

Photo 8: Right cheek

Photo 9: Right tilted



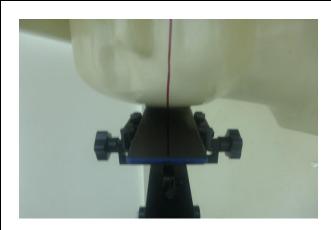


Photo 10: Front side 15mm

Photo 11: Back side 15mm








SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch


Report No.: ZR/2019/A000308

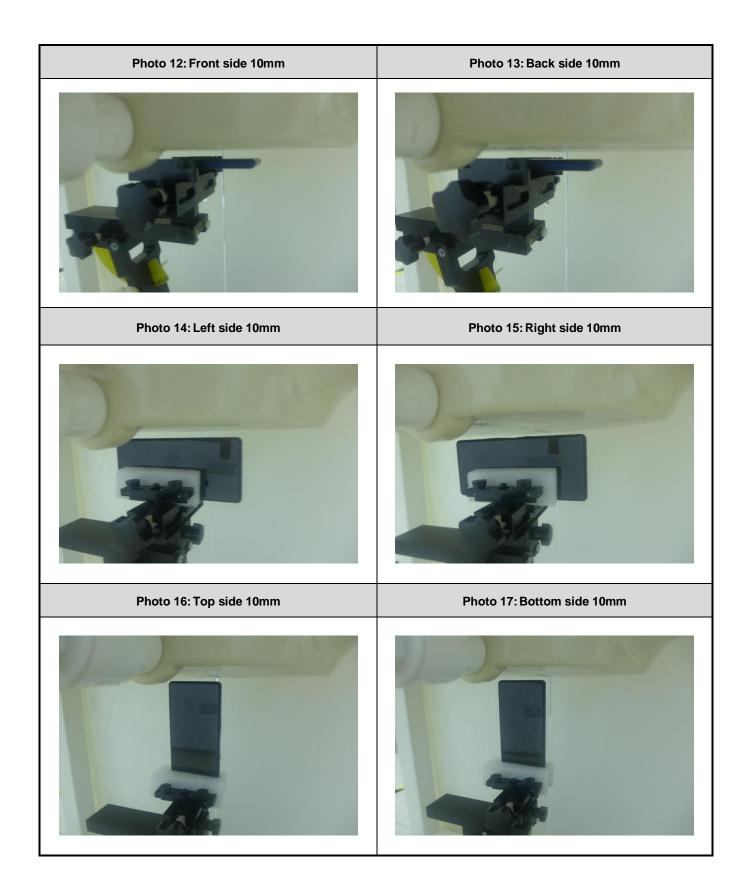



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2019/A000308

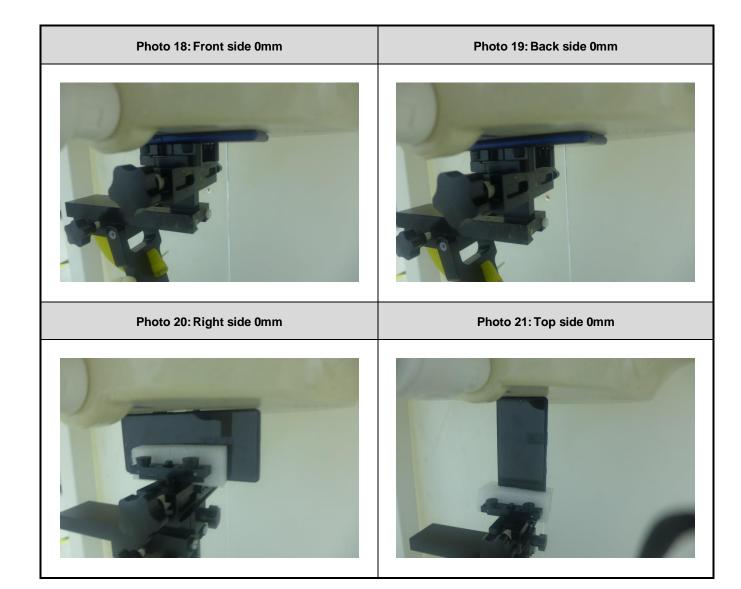



SGS-CSTC Standards Technical Services Co., Ltd. Shenzhen Branch

Report No.: ZR/2019/A000308

4. EUT Constructional Details

