



# **KINGFISHER 40W 1930-1990MHz CDMA SPCA**

## **OPERATING & INSTALLATION MANUAL**

**DOCUMENT #:** **190.0003**  
**DOCUMENT REVISION #:** **01**

### **Unity Wireless Systems Corp.**

7438 Fraser Park Drive  
Burnaby, B.C., Canada V5J 5B9  
Tel: 604-267-2700  
Toll Free: 1-800-337-6642  
Fax: 604-267-2701  
[www.unitywireless.com](http://www.unitywireless.com)

This document is the property of Unity Wireless Systems Corp. Use by or disclosure to anyone other than its authorized employees or agents is strictly forbidden except to the extent permission is elsewhere granted.



## Table of Contents

Regulatory .....	3
Legal .....	3
<b>1.0 Safety Instructions.....</b>	<b>4</b>
<b>2.0 General Information.....</b>	<b>6</b>
2.1 SCPA Overview .....	6
2.2 SCPA Installation .....	7
2.2.1 Mounting.....	7
Fig.2.2-1.....	7
2.2.2 Grounding .....	8
2.2.3 RF Connections.....	8
2.3 SCPA Operation .....	8
2.3.1 Powering the SCPA .....	8
2.3.2 Tune Up Procedure.....	8
2.3.3 Monitoring SCPA .....	8
2.4 SCPA Specifications.....	9



## Regulatory

This device complies with Part 15 of the FCC Rules. Operation of this device is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received including interference that may cause undesired operation.

Where appropriate, the use of the equipment is subject to the following conditions:

**CAUTION!** Unauthorized modifications or changes not expressly approved by UW could void compliance with regulatory rules, and thereby your authority to use this equipment.

**WARNING (EMI)** - United States FCC Information - This equipment has been tested and found to comply with the limits pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in an appropriate installation. This equipment, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communication. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment OFF and ON, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician

## Legal

The equipment, materials and documentation are provided "as is" without any express or implied warranty of any kind. In no event shall Unity Wireless Systems Corporation be held responsible for any damages or personal injury whatsoever arising out of the use of equipment or materials, regardless of equipment use, misuse, abuse, neglect or accident. Unity Wireless Systems Corporation does not warranty the accuracy or completeness of information contained in the documentation or instructions supplied for the use, installation and operation of the equipment. Except where noted otherwise, all contents are Copyright © 2005 Unity Wireless Systems Corporation. All rights reserved. No part of the materials in any of the supplied documentation, including but not limited to the text or graphics, may be reproduced or transmitted in any form by any means without Unity Wireless System Corporation's express written permission.



## 1.0 Safety Instructions



### INSTRUCTIONS FOR SAFE OPERATION

#### **BEFORE APPLYING POWER**

Review this manual and become familiar with all safety markings and instructions. Protection provided by the equipment may be impaired if used in a manner not specified by Unity Wireless Systems Corp.

#### **INTENDED PURPOSES**

This equipment is intended for commercial use in a cellular network basestation and is designed to be used in the process of amplifying electromagnetic Radio Frequency (RF) energy. Therefore, the output of the amplifier must be connected to an appropriate load, such as an antenna or a field-generating device. It is the responsibility of the user to assure that the device is operated in a location, which will control the radiated energy such that it will not cause injury and will not violate regulatory levels of electromagnetic interference.

#### **HAZARDOUS RF VOLTAGES**

The RF voltages on the center pin of the RF output connector can be hazardous. The RF output connector should be connected to a load before DC power is applied to the amplifier. Do not come into contact with the center pin of the RF output connector or accessories connected to it. Place the equipment in a non-operating condition before disconnecting or connecting the load to the RF output connector.

#### **PHYSICAL DAMAGE**

The RF amplifier should not be operated if there is physical damage, missing hardware, or missing panels.

#### **MAINTENANCE CAUTION**

Adjustment, maintenance, or repair of the equipment must be performed only by qualified personnel. Hazardous energy may be present while protective covers are removed from the equipment even if disconnected from the power source. Contact may result in personal injury.



## INSTRUCTIONS FOR SAFE OPERATION (continued)

### SAFETY SYMBOLS

This symbol is marked on the equipment when it is necessary for the user to refer to the manual for important safety information. This symbol is indicated in the Table of Contents to assist in locating pertinent information.



Dangerous voltages are present. Use extreme care.

**CAUTION:** The caution symbol denotes a potential hazard. Attention must be given to the statement to prevent damage, destruction or harm.

### RANGE OF ENVIRONMENTAL CONDITIONS

This equipment is designed to be safe under the following environmental conditions:

Indoor use  
Altitude up to 2000M  
Temperature of -5°C to +55°C  
Maximum relative humidity 90%  
Main supply voltage fluctuates not to exceed minimum and maximum autoranging values.

While the equipment will not cause a hazardous condition over this environmental range, performance may vary.

### HEATSINK

Care should be exercised not to block the cooling air inlets or outlets. Cooling air blockage can result in damage to the RF amplifier or intermittent shut-downs.

Forced air cooling should be provided at a rate of at least 50cfm.



## 2.0 General Information

### 2.1 SCPA Overview

The Kingfisher 40W SCPA (Unity Wireless P/N: 100.0195.001) is a compact unit designed for CDMA 1X operation over the frequency of 1930-1990MHz.

The amplifier is composed of an RF line-up and a function board. The RF line-up provides the necessary amplification of the input signal. The function board provides power supplies to the RF board, processes alarms and provides monitoring functions for the external user. The function board also provides for RF shut down in case of a major alarm condition.

The HPA requires forced-air cooling (50 to 75 ft<sup>3</sup>/minute depending on temperature) over its integral heatsink. The block diagram of the HPA is shown in figure 2.1-1 below.

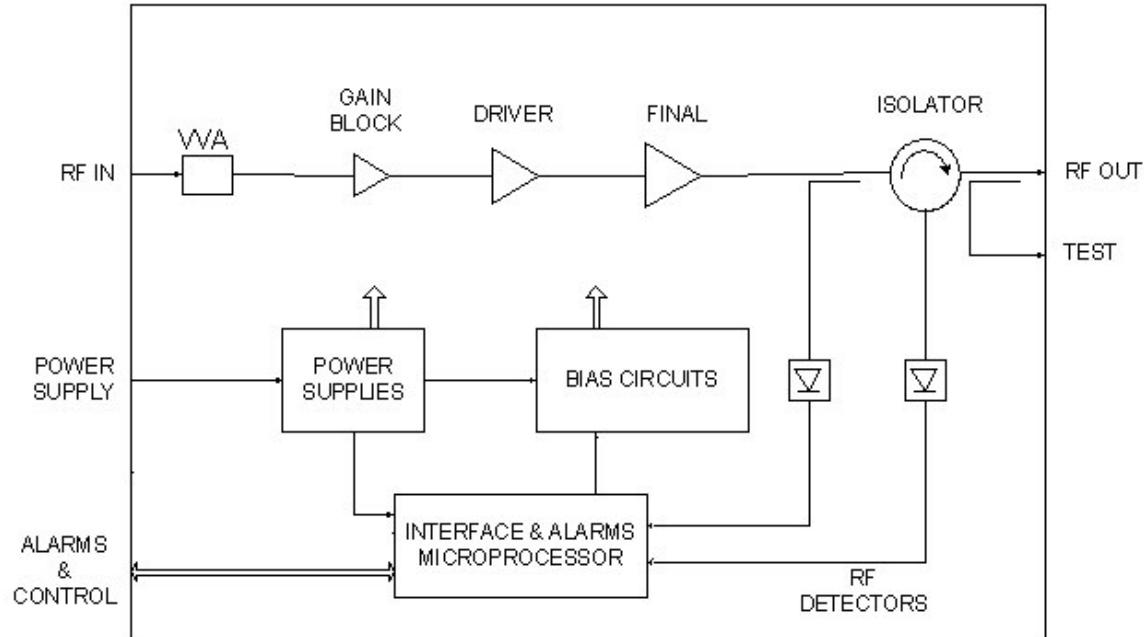



Figure 2.1-1



## 2.2 SCPA Installation

### 2.2.1 Mounting

The Kingfisher SCPA is to be mounted on a chassis with 8 #4 screws (see fig.2.2-1). The user is responsible for making sure the unit is installed with the proper fasteners for the installation type.

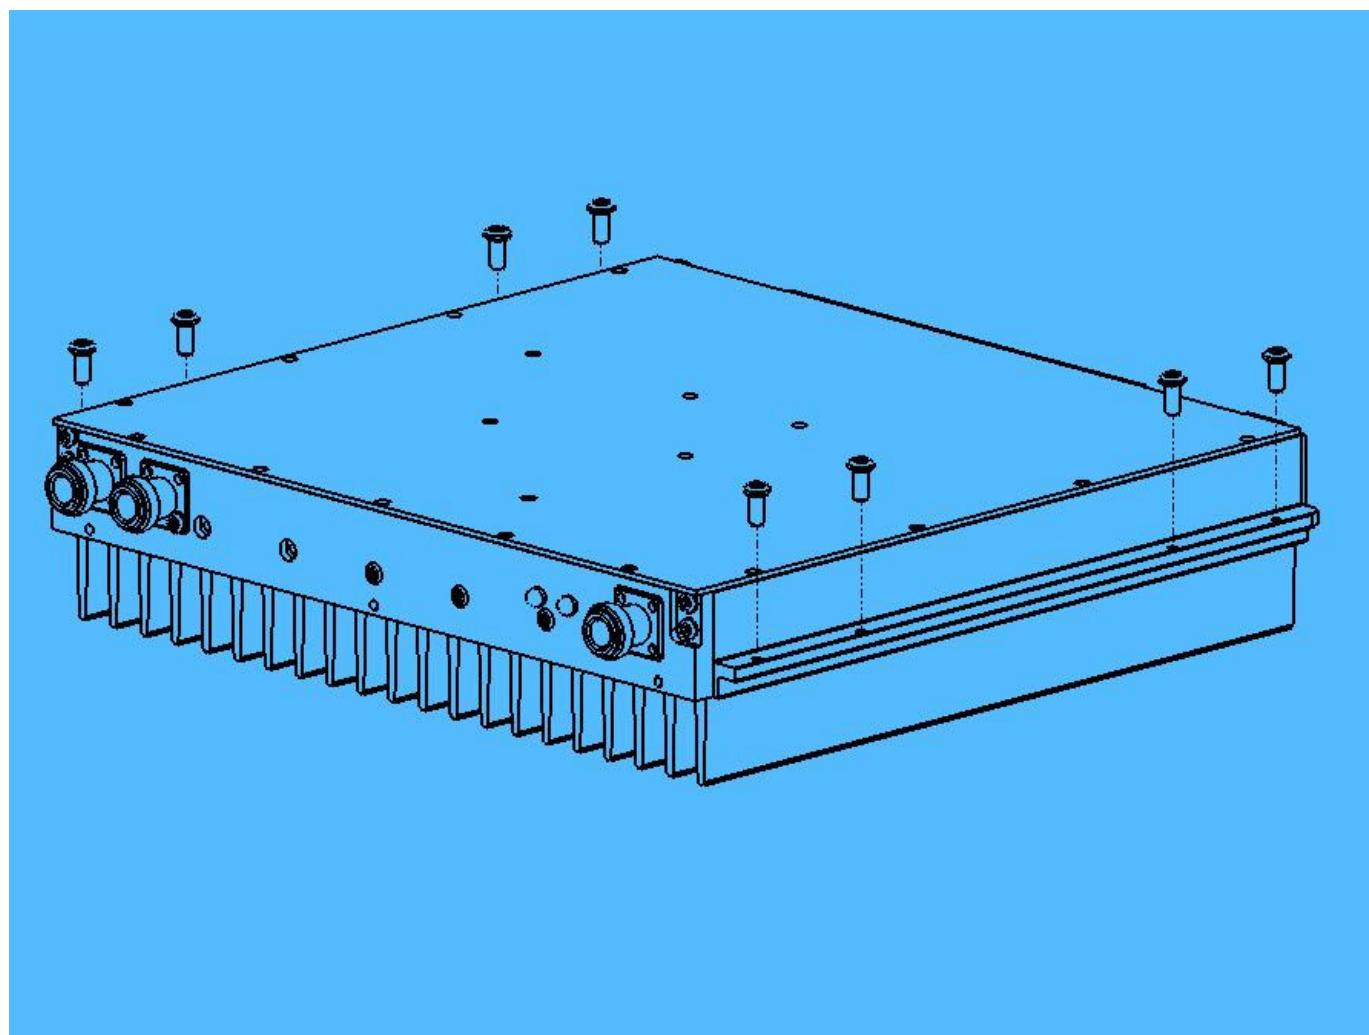

**Fig.2.2-1**



## 2.2.2 Grounding

The ground connection for the PA is provided by the user's rack-mount chassis. The rack-mount chassis should be properly grounded to protect the PA and personnel from lighting and other electrically induced transients.

## 2.2.3 RF Connections

Care must be taken when attaching the RF connections to the PA, to prevent costly damage to the equipment.

When fastening the connections, do not cross thread them. The "N"-type connectors used require 90 N-cm or 8 in-lb of torque for proper connection.

## 2.3 SCPA Operation

### 2.3.1 Powering the SCPA

The PA should be powered by a regulated DC power supply. The PA has a built in reverse polarity protection circuit. The PA should be supplied with -48VDC and shall consume less than 300W in a normal operational state. See PA's Technical Specification for DC connector pin assignment.

### 2.3.2 Tune Up Procedure

- Attach RF power meter and load to RF output port of PA
- Attach RF source to the input port of PA



---

Before applying DC power to the PA be sure it's output is connected to the appropriate load and the input power level is set to minimum in order to prevent RF overdrive.

---

- Apply DC power to PA
- Adjust RF input level to the desired level, making sure that the output power does not exceed the maximum rated level for the Kingfisher SCPA (40W).

### 2.3.3 Monitoring SCPA

See PA's Technical Specification for the alarm and control interface description.



## 2.4 SCPA Specifications

The detailed specifications are listed in the PA's Technical Specification. In the event of a conflict, the product specification takes precedent.



---

Under no circumstances should the specifications be exceeded, as serious injury or damage to the equipment may occur.

---

Operating Frequency Range: 1930 to 1990 MHz  
Operating DC Supply: -48 VDC Nominal, -36 to -75VDC  
Operating Temperature: -5 to +55 Degrees Celsius  
Operating Humidity: 0 to 95%  
Maximum Output Power: 40W at RF Output Port

## END OF DOCUMENT

*For questions or assistance with your products, please contact:*

*Unity Wireless Systems Corporation  
7438 Fraser Park Drive  
Burnaby, British Columbia  
CANADA V5J 5B9*

*Phone: +1 604 267 2700  
FAX: +1 604 267 2701  
[sales@unitywireless.com](mailto:sales@unitywireless.com)  
<http://www.unitywireless.com>*

