

---

## **Annex to Report**

# **Dosimetric Assessment of the Portable Device Datalogic Joya+ A (FCC ID: U4GA056) (IC ID: 3862E-MA056) (Contains FCC ID: U4G004W) (Contains IC: 3862E-004W)**

## **According to the FCC and IC Requirements**

April 15, 2011

**IMST GmbH  
Carl-Friedrich-Gauß-Str. 2  
D-47475 Kamp-Lintfort**

Customer  
7layers AG  
Borsigstrasse 11  
D-40880 Ratingen

The test results only relate to the items tested. This report shall not be reproduced except in full without the written approval of the testing laboratory.

# 1 Subject of Investigation



Fig. 1: Pictures of the Joya+ A.

## 8.9 Pictures of the Device under Test

Figure 16 - 17 show the devices under test.



Fig. 16: Front and back view of the test device Datalogic Joya+ A.



Fig. 17: Side view of the test device Datalogic Joya+ A.

### 8.10 Test positions for the Device under Test

Figure 18 shows the test position for the SAR measurements.

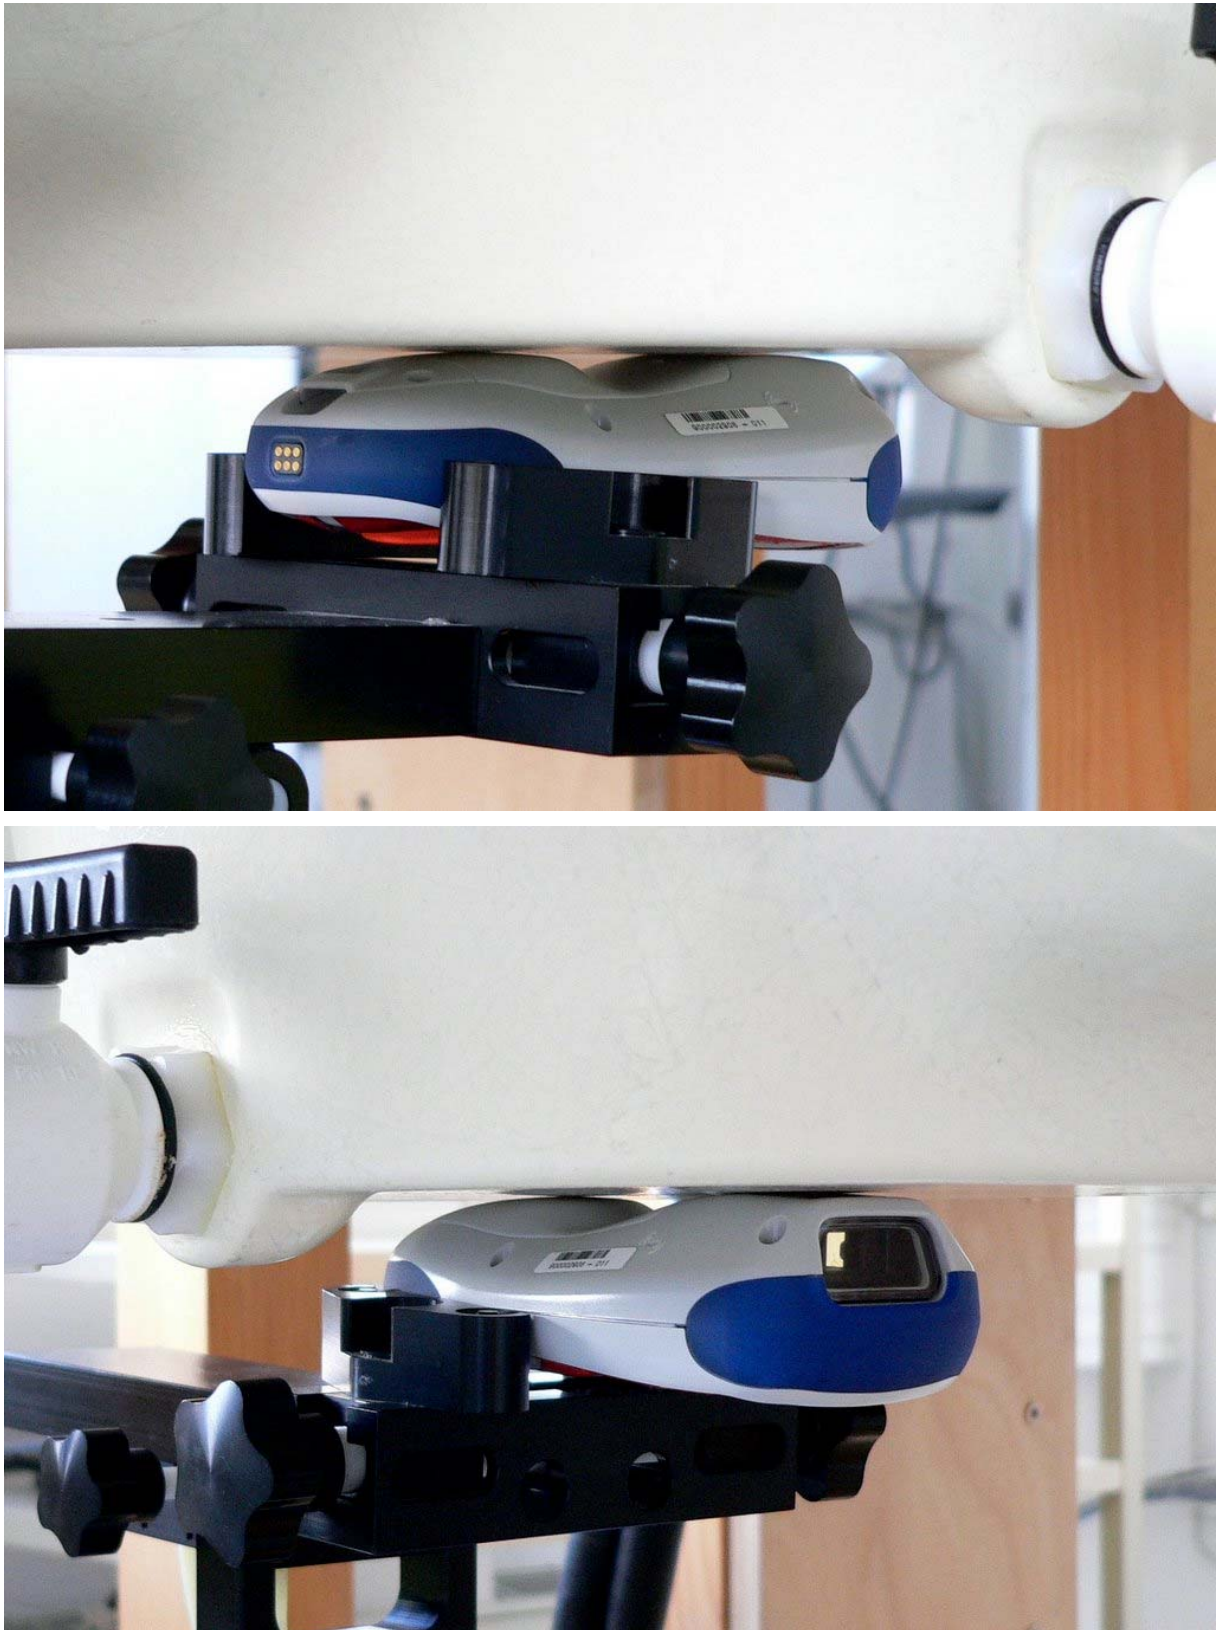


Fig. 18: Body worn configuration with the back of the device in direct contact against the flat phantom, display towards the ground