


## Schematic Diagrams

### WARNING

POWER MUST BE DISCONNECTED  
BEFORE SERVICING THIS APPLIANCE

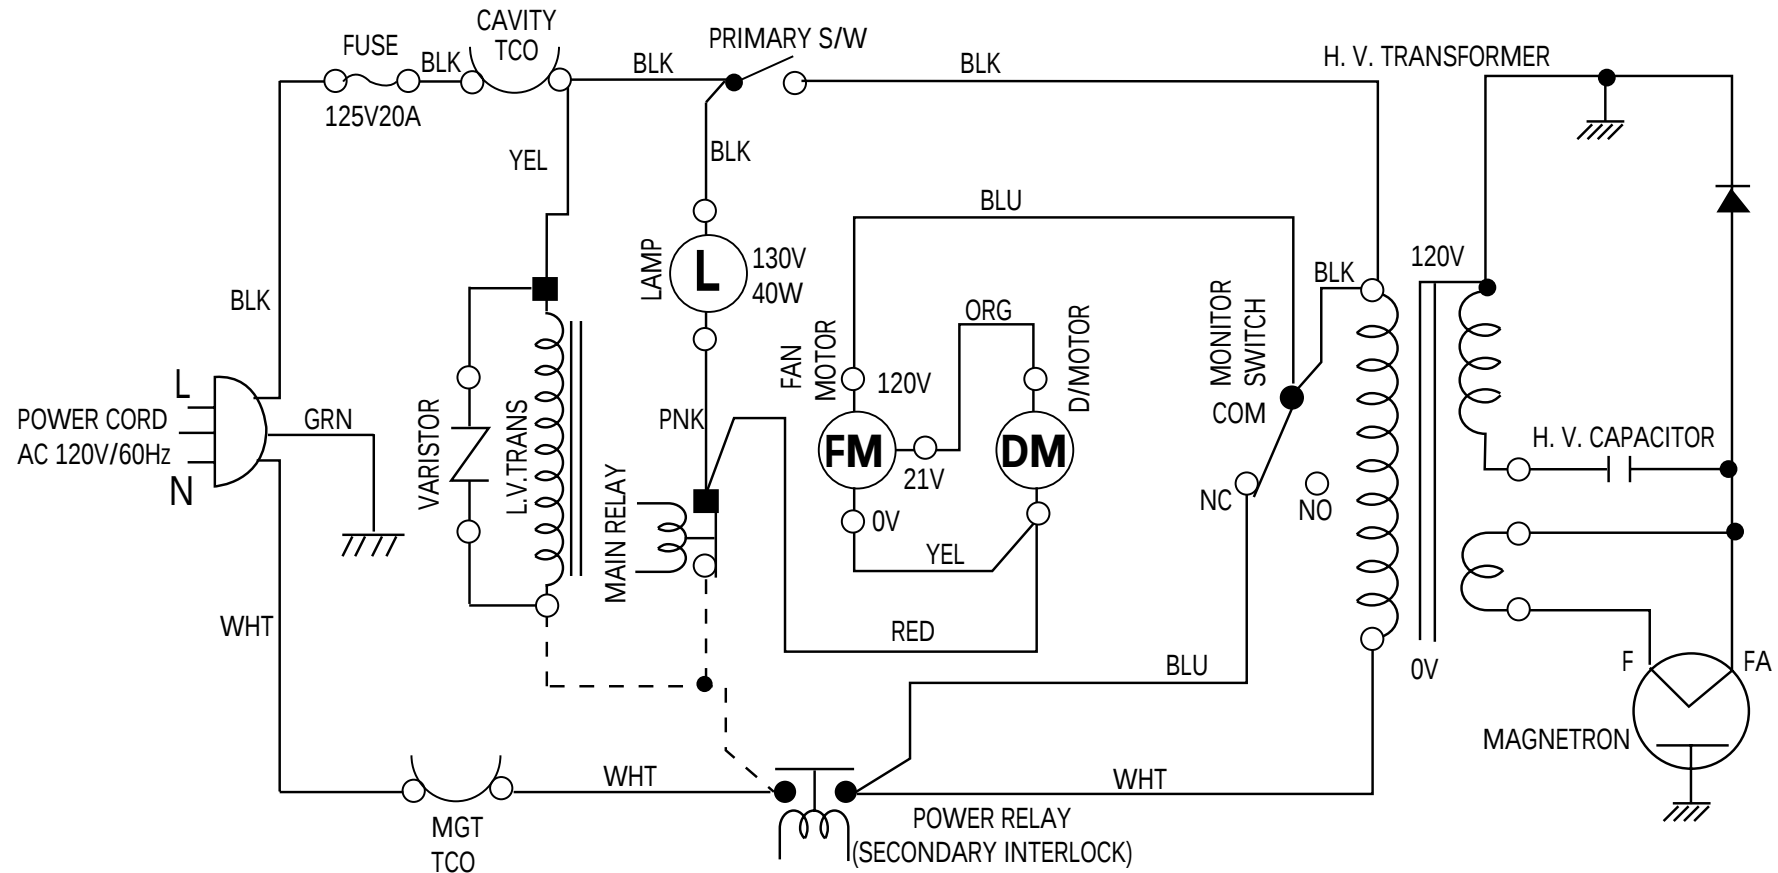


NOTE: CIRCUIT SHOWN WITH DOOR IS OPENED POSITION.

NOTE: FOR SERVICE REPLACEMENT USE 16 GA 105° C  
THERMOPLASTIC COVERED WIRE EXCEPT  
FOR HIGH VOLTAGE LEADS OR AS NOTED ON SPECIAL LEADS.

1. INPUT : 120V 60HZ
2. DOOR : OPEN
3. LAMP : ON
4. - - - - : P.C.B PATTERN
5. ■ : P.C.B IN/OUT POINT

P.C.B Diagrams

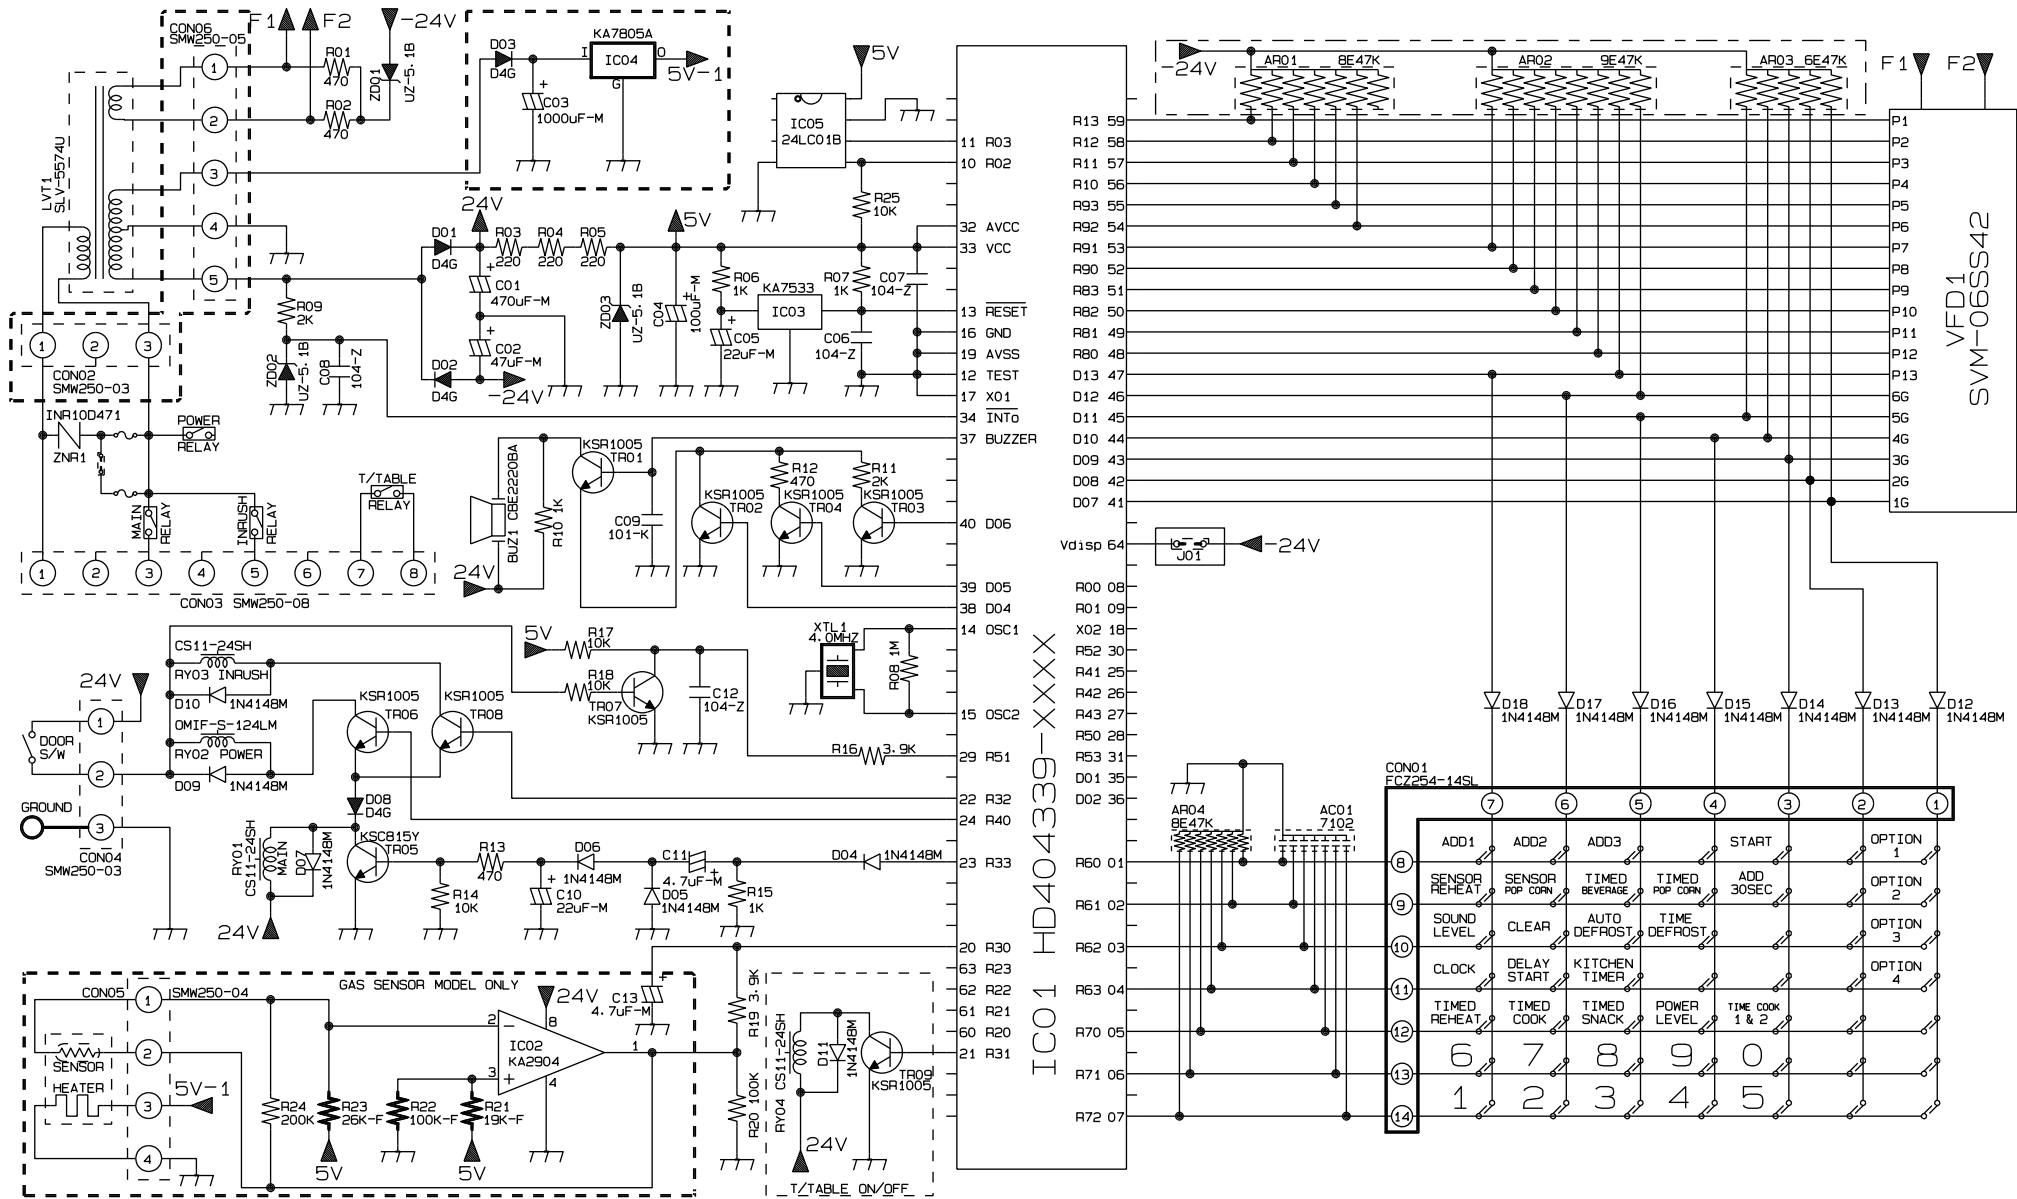

NOTE

- 1. DOOR IS OPENED.
- 2. L O.T.P MICOM → INSERT.
- 3. O.T.P MICOM → DELETE.

DIGRAM ELECTRIC

G. E-3rd (N/HELP-SCREEN)