

**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A: Test Setup Photo

FCC ID
A3LSMA233JPN

File No.

HCT-RF-2206-FC027-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC017-P
HCT-RF-2207-FC014-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC018-P


REVISION HISTORY

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	July 18, 2022	Initial Release

File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				


1. Radiated Test Setup Photo

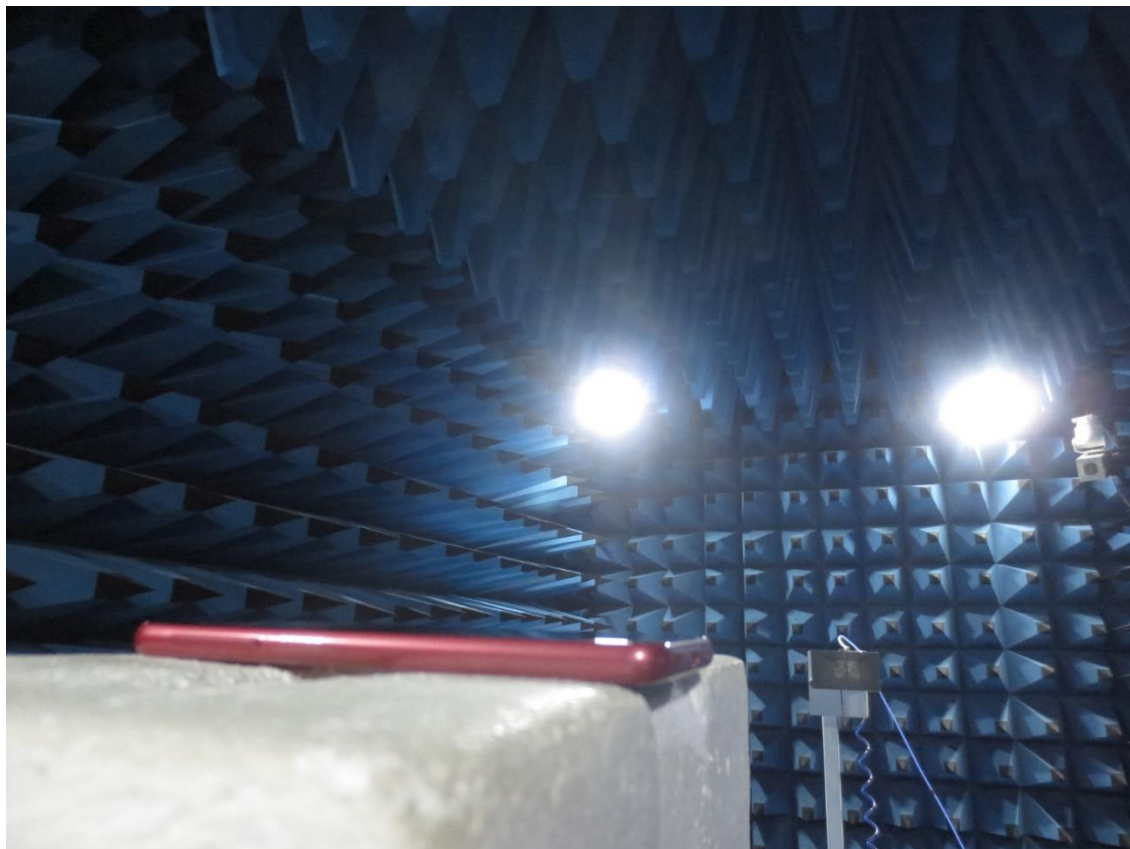


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

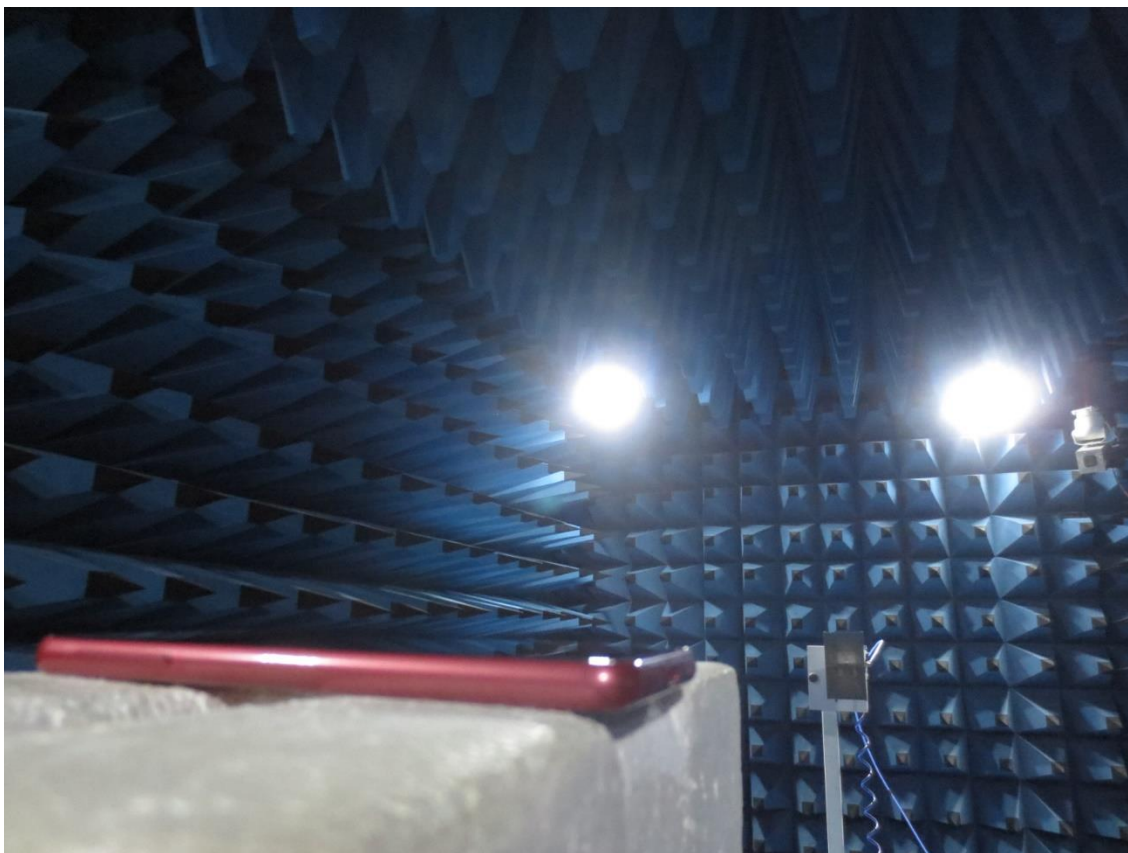


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

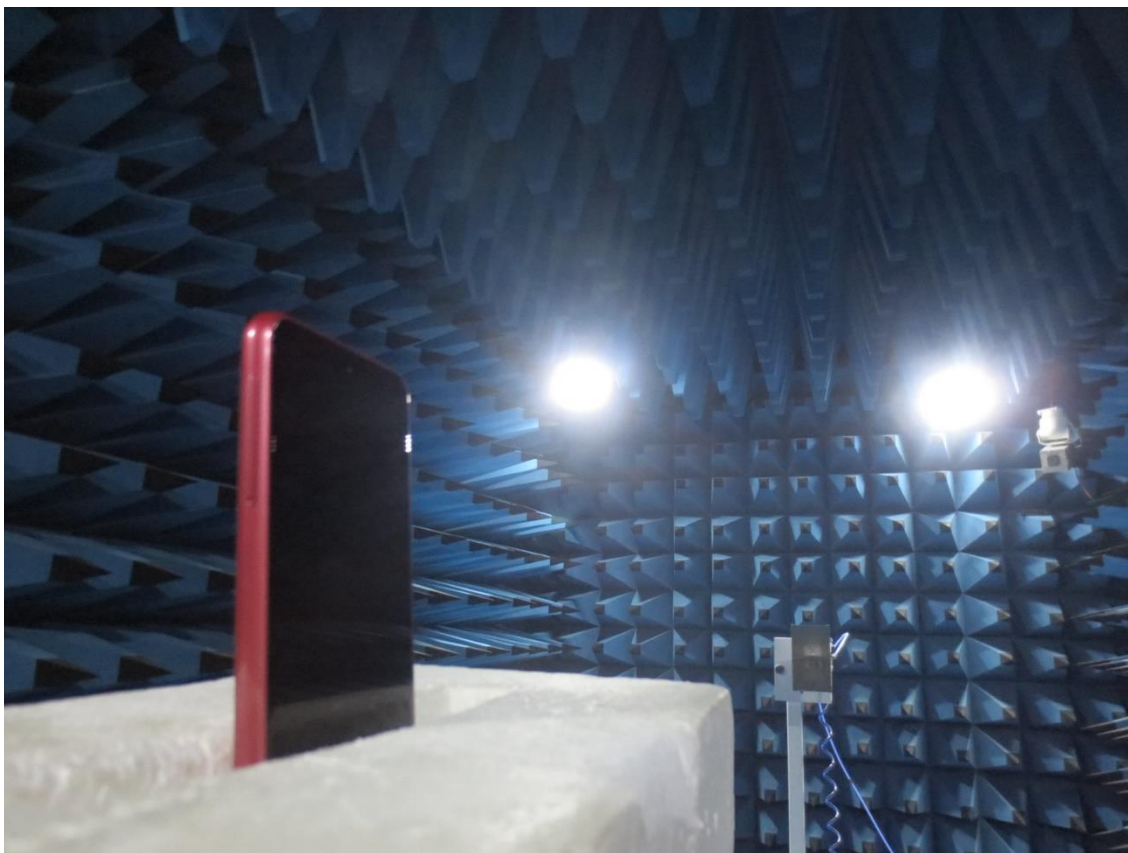


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

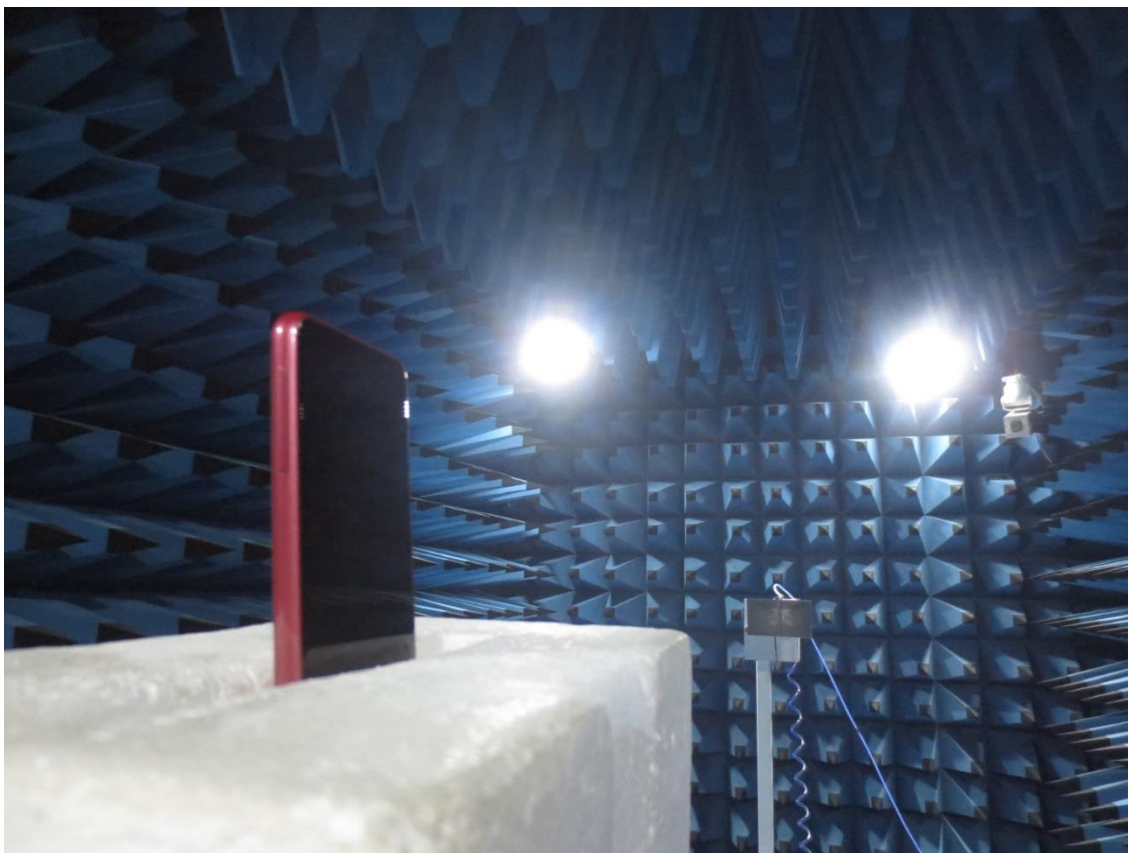


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

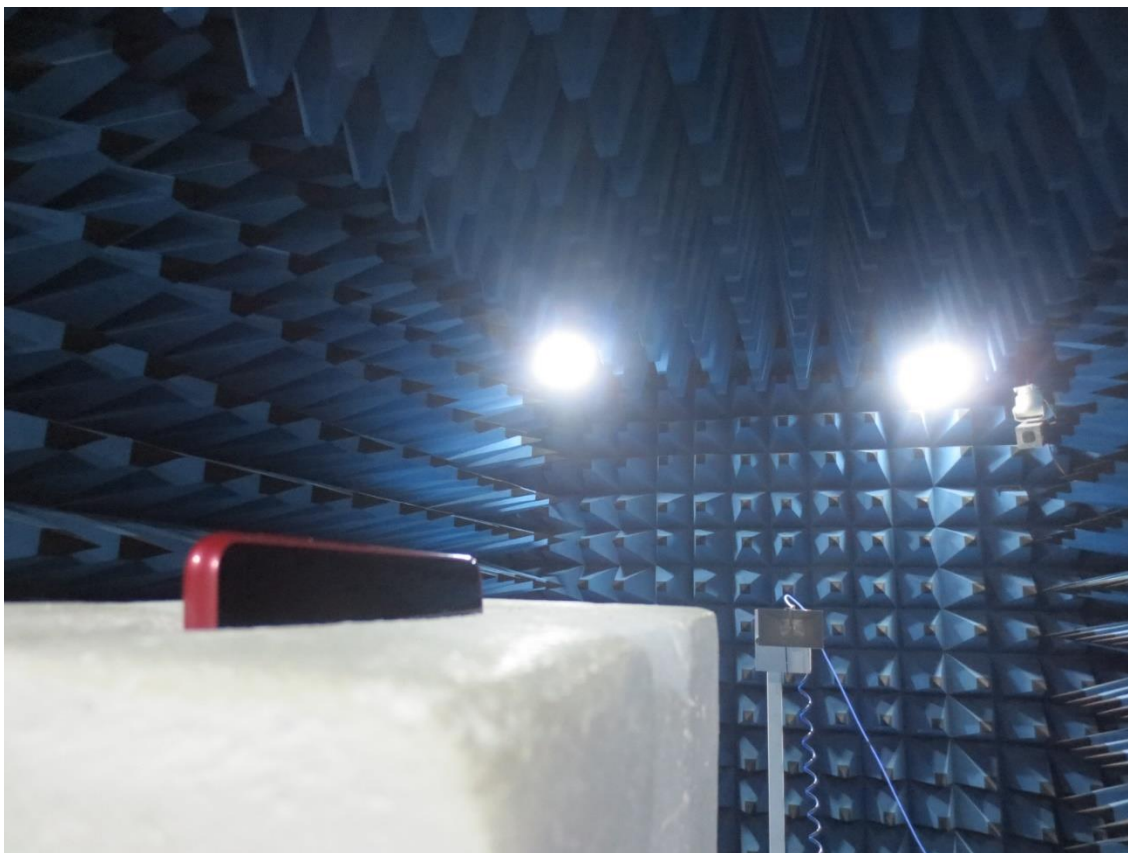


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

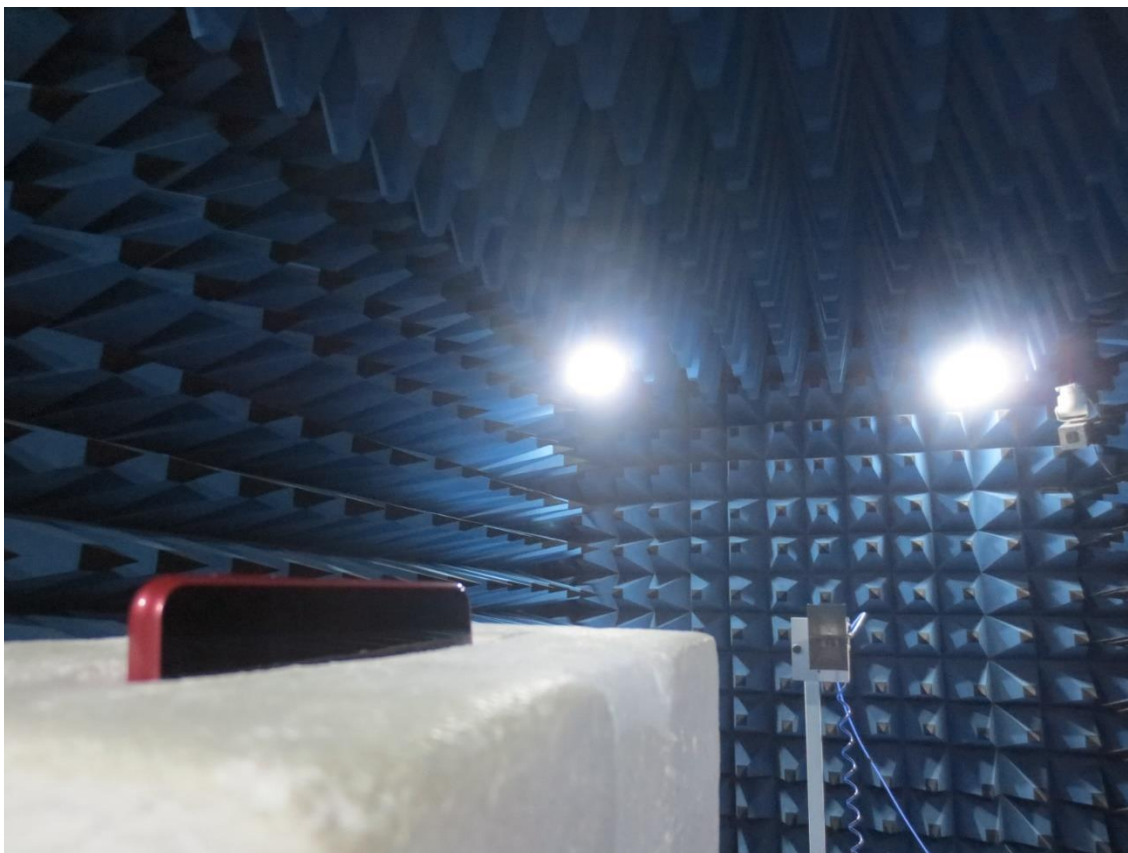


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

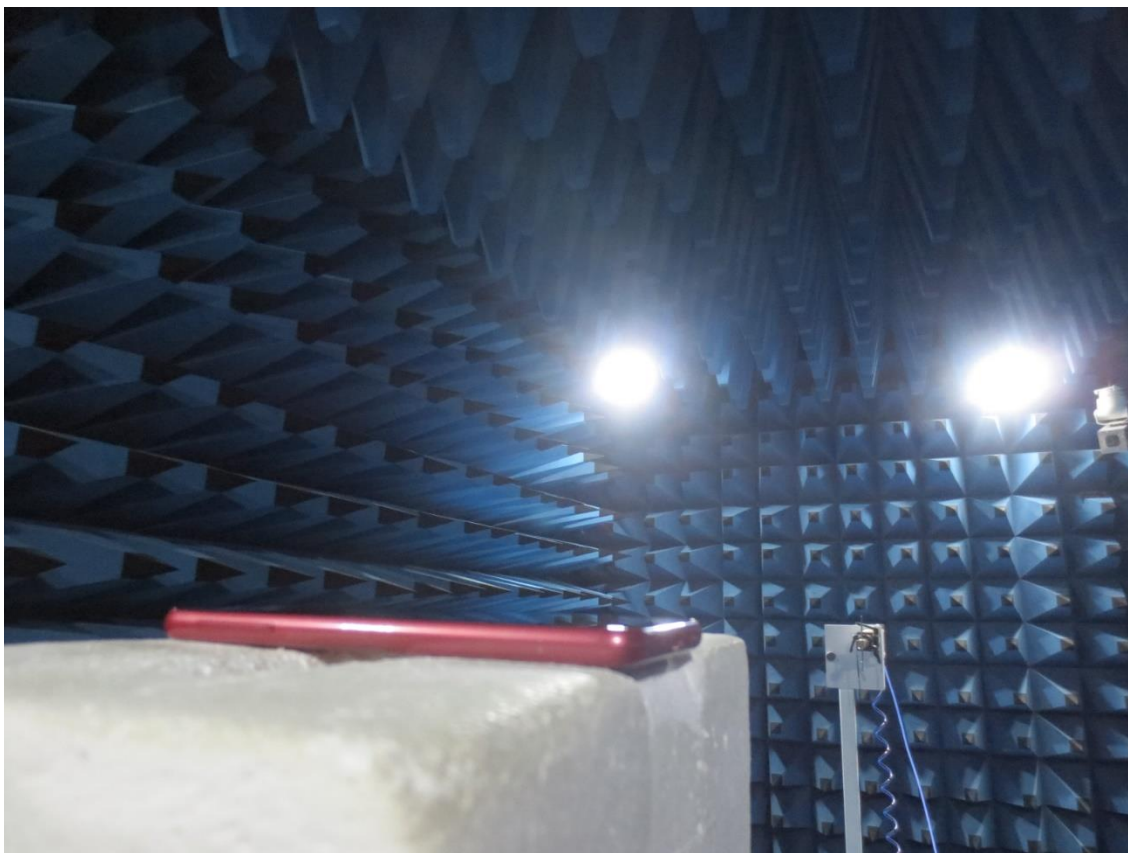



File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

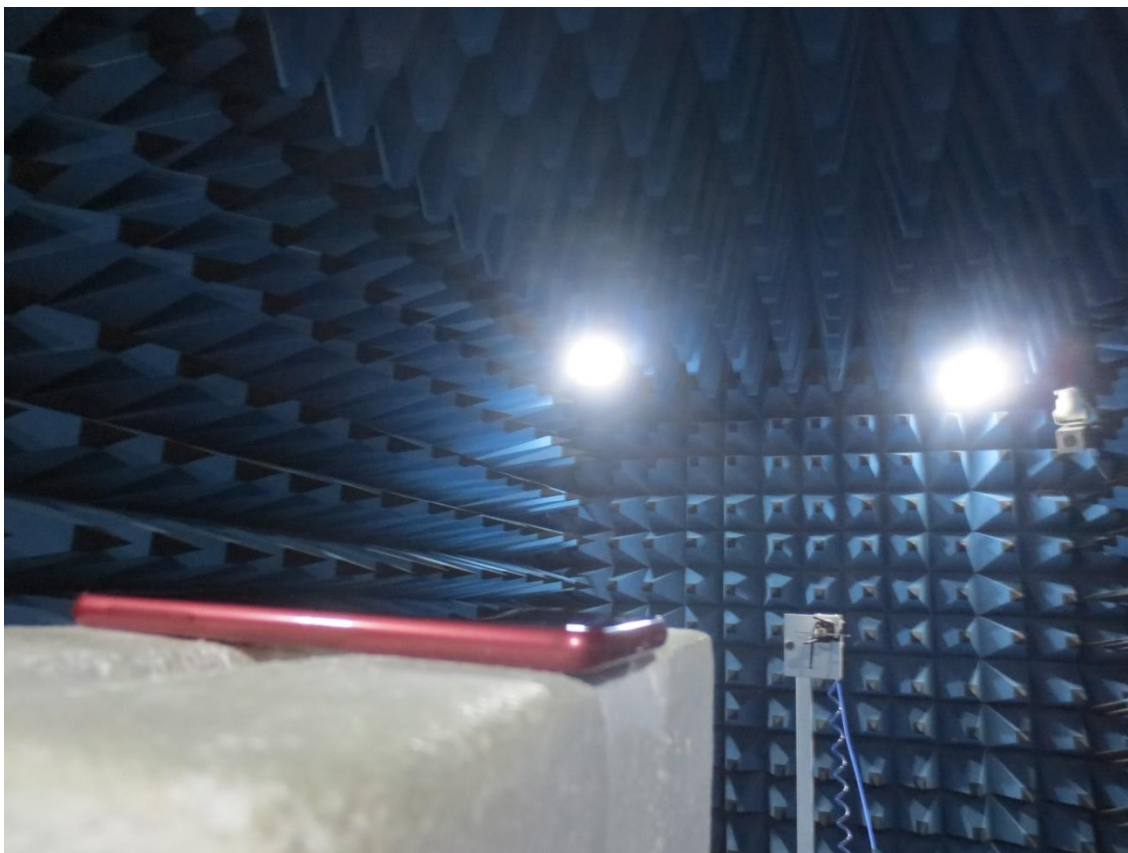


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

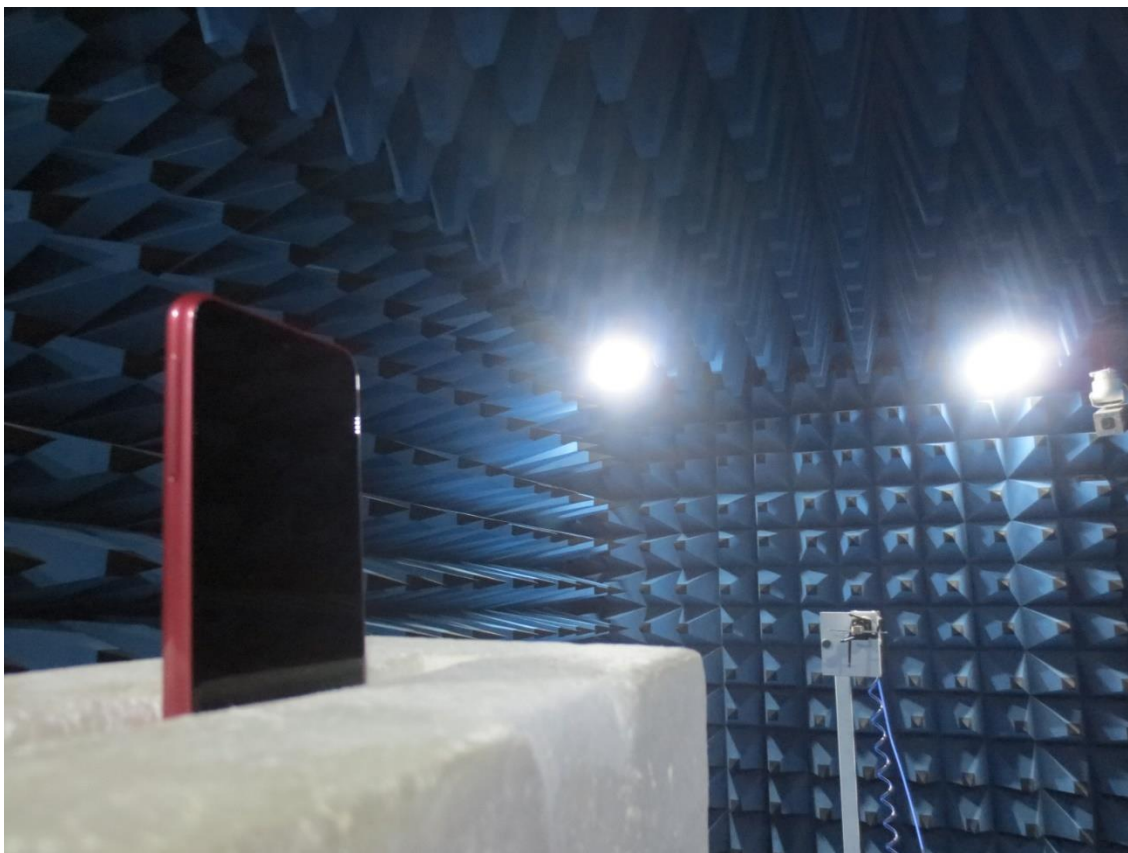

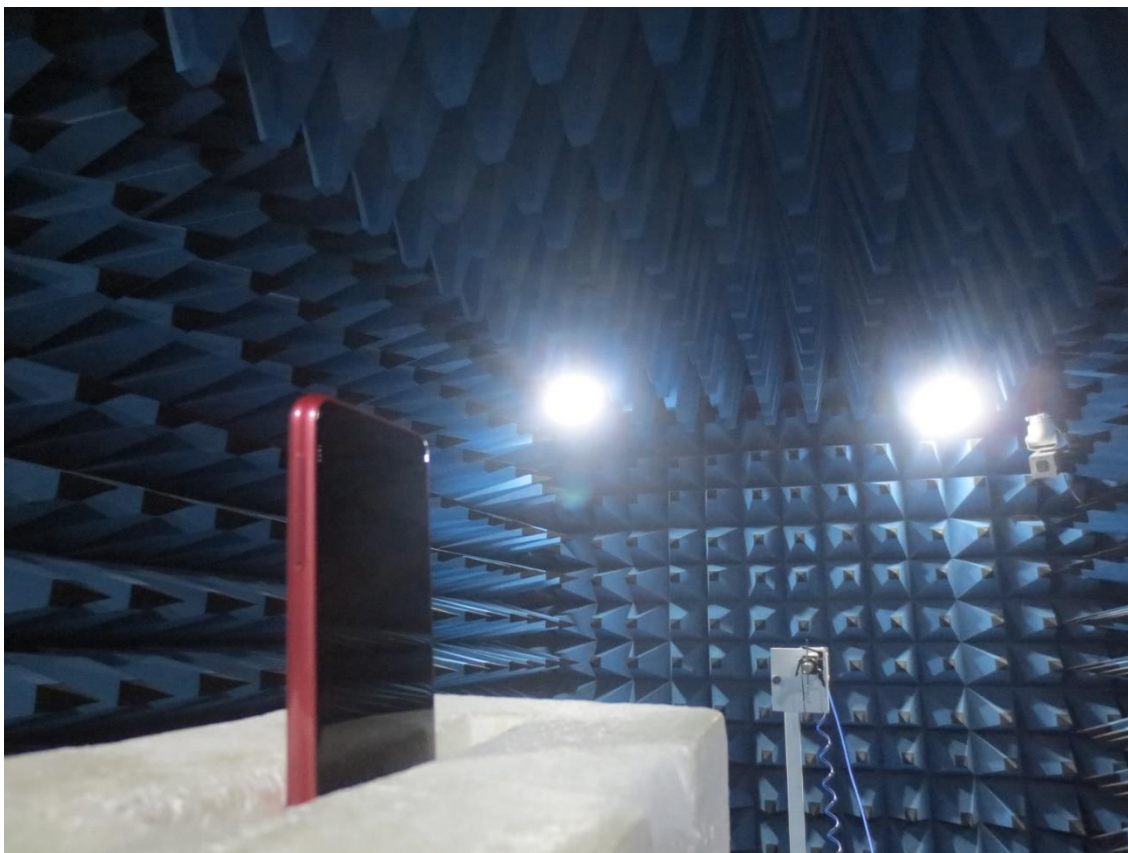

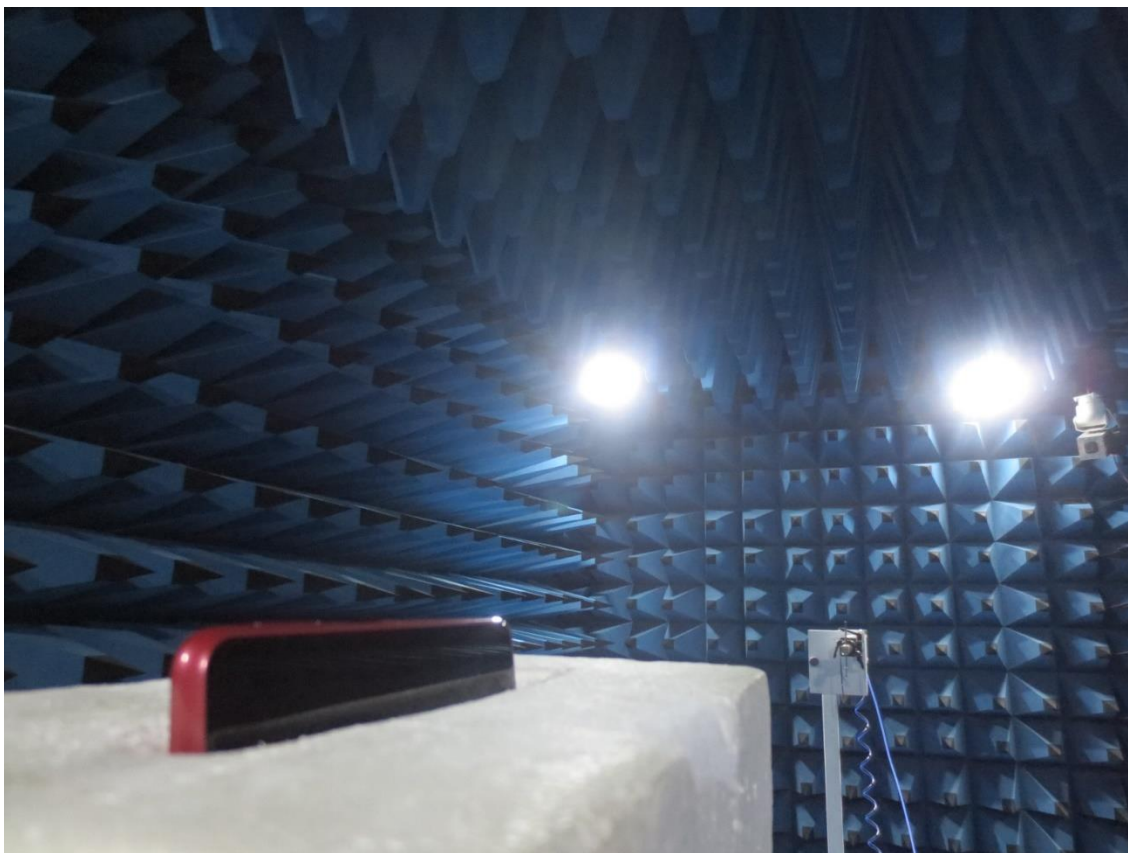


File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

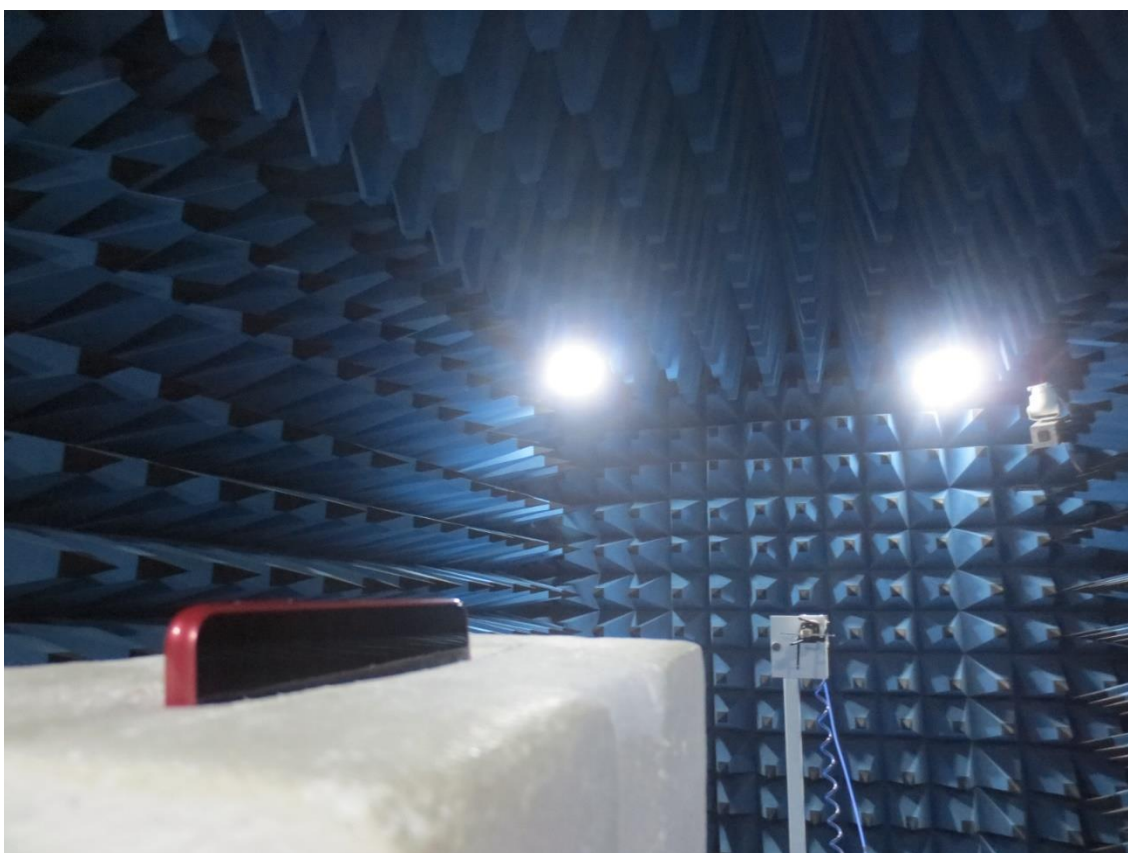

File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				

2. Conducted Test Setup Photo

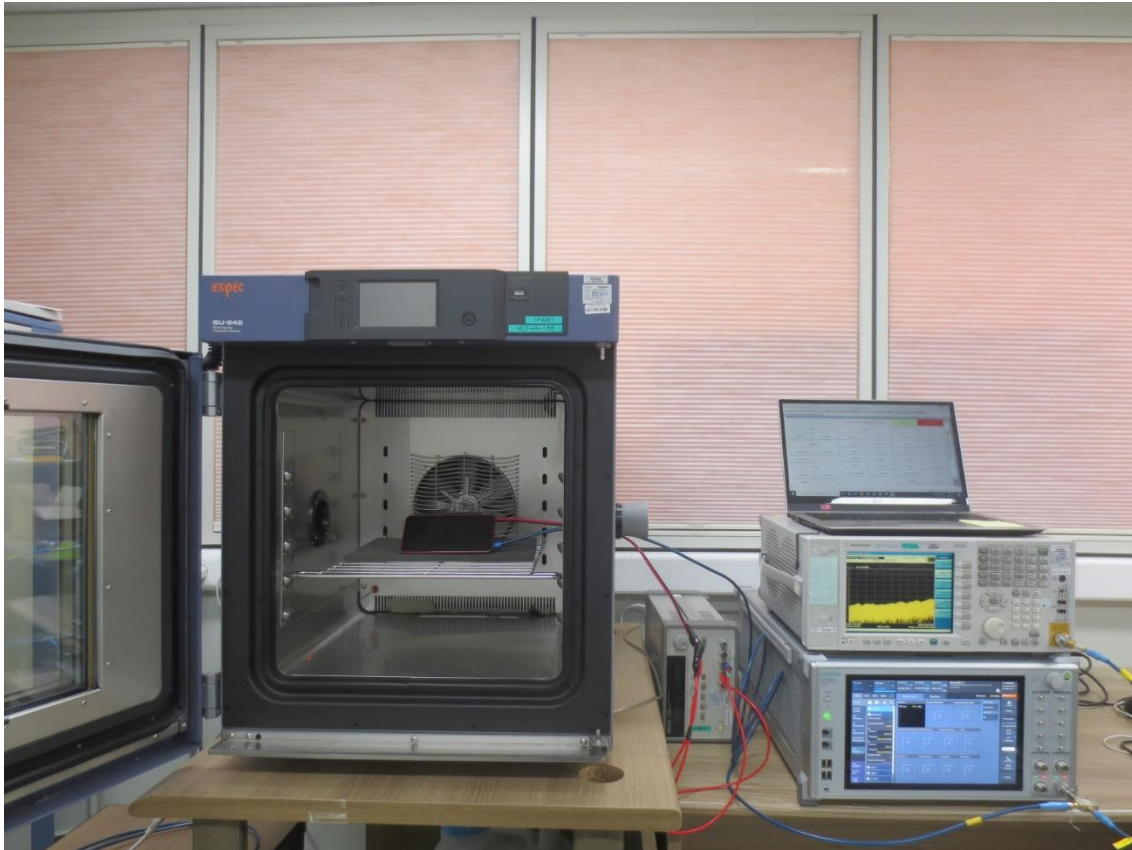

File	HCT-RF-2206-FC027-P	HCT-RF-2207-FC014-P	HCT-RF-2207-FC015-P	HCT-RF-2207-FC016-P	HCT-RF-2207-FC017-P
No.	HCT-RF-2207-FC018-P				